

**ASME B16.47-2025**  
(Revision of ASME B16.47-2020)

# **Large Diameter Steel Flanges**

**NPS 26 Through NPS 60  
Metric/Inch Standard**

---

**AN AMERICAN NATIONAL STANDARD**



**The American Society of  
Mechanical Engineers**

**ASME B16.47-2025**  
(Revision of ASME B16.47-2020)

# **Large Diameter Steel Flanges**

**NPS 26 Through NPS 60  
Metric/Inch Standard**

---

**AN AMERICAN NATIONAL STANDARD**



**The American Society of  
Mechanical Engineers**

Two Park Avenue • New York, NY • 10016 USA

Date of Issuance: May 30, 2025

The next edition of this Standard is scheduled for publication in 2028.

This code or standard was developed under procedures accredited as meeting the criteria for American National Standards. The standards committee that approved the code or standard was balanced to ensure that individuals from competent and concerned interests had an opportunity to participate. The proposed code or standard was made available for public review and comment, which provided an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not "approve," "certify," "rate," or "endorse" any item, construction, proprietary device, or activity. ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor does ASME assume any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representatives or persons affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.

The endnotes and preamble in this document (if any) are part of this American National Standard.



ASME Collective Membership Mark

All rights reserved. "ASME" and the above ASME symbol are registered trademarks of The American Society of Mechanical Engineers. No part of this document may be copied, modified, distributed, published, displayed, or otherwise reproduced in any form or by any means, electronic, digital, or mechanical, now known or hereafter invented, without the express written permission of ASME. No works derived from this document or any content therein may be created without the express written permission of ASME. Using this document or any content therein to train, create, or improve any artificial intelligence and/or machine learning platform, system, application, model, or algorithm is strictly prohibited.

The American Society of Mechanical Engineers  
Two Park Avenue, New York, NY 10016-5990

Copyright © 2025 by  
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS  
Printed in U.S.A.

# CONTENTS

Foreword .....	vi
Committee Roster .....	viii
Correspondence With the B16 Committee .....	ix
Summary of Changes .....	xi
List of Changes in Record Number Order .....	xiv
<b>1 General .....</b>	<b>1</b>
<b>2 Pressure-Temperature Ratings .....</b>	<b>2</b>
<b>3 Component Size: Nominal Pipe Size .....</b>	<b>3</b>
<b>4 Marking .....</b>	<b>3</b>
<b>5 Materials .....</b>	<b>4</b>
<b>6 Dimensions .....</b>	<b>5</b>
<b>7 Tolerances .....</b>	<b>6</b>
<b>8 Pressure Testing .....</b>	<b>7</b>
<b>Mandatory Appendix</b>	
I References .....	114
<b>Nonmandatory Appendices</b>	
A Methods Used for Establishing Pressure-Temperature Ratings .....	116
B Gaskets (Other Than Ring-Joint) .....	120
C Quality System Program .....	122
D Method for Calculating Bolt Lengths .....	123
<b>Figures</b>	
1 Welding Ends (Welding Neck Flanges, No Backing Rings) .....	8
2 Welding Ends (Welding Neck Flanges With Backing Rings) .....	9
3 Welding Ends (Welding Neck Flanges) .....	10
D-1 Specified Stud Bolt Length .....	123
<b>Tables</b>	
1 List of Material Specifications .....	11
2 List of Bolting Specifications (Applicable ASTM Specifications) .....	13
3 Pressure-Temperature Ratings for Group 1.1 Materials — SI Units .....	14
3C Pressure-Temperature Ratings for Group 1.1 Materials — U.S. Customary Units .....	15
4 Pressure-Temperature Ratings for Group 1.2 Materials — SI Units .....	16
4C Pressure-Temperature Ratings for Group 1.2 Materials — U.S. Customary Units .....	17
5 Pressure-Temperature Ratings for Group 1.3 Materials — SI Units .....	18
5C Pressure-Temperature Ratings for Group 1.3 Materials — U.S. Customary Units .....	19

6	Pressure-Temperature Ratings for Group 1.4 Materials — SI Units .....	20
6C	Pressure-Temperature Ratings for Group 1.4 Materials — U.S. Customary Units .....	21
7	Pressure-Temperature Ratings for Group 1.5 Materials — SI Units .....	22
7C	Pressure-Temperature Ratings for Group 1.5 Materials — U.S. Customary Units .....	23
8	Pressure-Temperature Ratings for Group 1.7 Materials — SI Units .....	24
8C	Pressure-Temperature Ratings for Group 1.7 Materials — U.S. Customary Units .....	25
9	Pressure-Temperature Ratings for Group 1.9 Materials — SI Units .....	26
9C	Pressure-Temperature Ratings for Group 1.9 Materials — U.S. Customary Units .....	27
10	Pressure-Temperature Ratings for Group 1.10 Materials — SI Units .....	28
10C	Pressure-Temperature Ratings for Group 1.10 Materials — U.S. Customary Units .....	29
11	Pressure-Temperature Ratings for Group 1.11 Materials — SI Units .....	30
11C	Pressure-Temperature Ratings for Group 1.11 Materials — U.S. Customary Units .....	31
12	Pressure-Temperature Ratings for Group 1.13 Materials — SI Units .....	32
12C	Pressure-Temperature Ratings for Group 1.13 Materials — U.S. Customary Units .....	33
13	Pressure-Temperature Ratings for Group 1.14 Materials — SI Units .....	34
13C	Pressure-Temperature Ratings for Group 1.14 Materials — U.S. Customary Units .....	35
14	Pressure-Temperature Ratings for Group 1.15 Materials — SI Units .....	36
14C	Pressure-Temperature Ratings for Group 1.15 Materials — U.S. Customary Units .....	37
15	Pressure-Temperature Ratings for Group 1.17 Materials — SI Units .....	38
15C	Pressure-Temperature Ratings for Group 1.17 Materials — U.S. Customary Units .....	39
16	Pressure-Temperature Ratings for Group 1.18 Materials — SI Units .....	40
16C	Pressure-Temperature Ratings for Group 1.18 Materials — U.S. Customary Units .....	41
17	Pressure-Temperature Ratings for Group 2.1 Materials — SI Units .....	42
17C	Pressure-Temperature Ratings for Group 2.1 Materials — U.S. Customary Units .....	43
18	Pressure-Temperature Ratings for Group 2.2 Materials — SI Units .....	44
18C	Pressure-Temperature Ratings for Group 2.2 Materials — U.S. Customary Units .....	45
19	Pressure-Temperature Ratings for Group 2.3 Materials — SI Units .....	46
19C	Pressure-Temperature Ratings for Group 2.3 Materials — U.S. Customary Units .....	47
20	Pressure-Temperature Ratings for Group 2.4 Materials — SI Units .....	48
20C	Pressure-Temperature Ratings for Group 2.4 Materials — U.S. Customary Units .....	49
21	Pressure-Temperature Ratings for Group 2.5 Materials — SI Units .....	50
21C	Pressure-Temperature Ratings for Group 2.5 Materials — U.S. Customary Units .....	51
22	Pressure-Temperature Ratings for Group 2.6 Materials — SI Units .....	52
22C	Pressure-Temperature Ratings for Group 2.6 Materials — U.S. Customary Units .....	53
23	Pressure-Temperature Ratings for Group 2.7 Materials — SI Units .....	54
23C	Pressure-Temperature Ratings for Group 2.7 Materials — U.S. Customary Units .....	55
24	Pressure-Temperature Ratings for Group 2.8 Materials — SI Units .....	56
24C	Pressure-Temperature Ratings for Group 2.8 Materials — U.S. Customary Units .....	56
25	Pressure-Temperature Ratings for Group 2.9 Materials — SI Units .....	57
25C	Pressure-Temperature Ratings for Group 2.9 Materials — U.S. Customary Units .....	58
26	Pressure-Temperature Ratings for Group 2.10 Materials — SI Units .....	59
26C	Pressure-Temperature Ratings for Group 2.10 Materials — U.S. Customary Units .....	60
27	Pressure-Temperature Ratings for Group 2.11 Materials — SI Units .....	61
27C	Pressure-Temperature Ratings for Group 2.11 Materials — U.S. Customary Units .....	62
28	Pressure-Temperature Ratings for Group 2.12 Materials — SI Units .....	63

28C	Pressure-Temperature Ratings for Group 2.12 Materials — U.S. Customary Units . . . . .	64
29	Pressure-Temperature Ratings for Group 2.13 Materials — SI Units . . . . .	65
29C	Pressure-Temperature Ratings for Group 2.13 Materials — U.S. Customary Units . . . . .	65
30	Dimensions of Ring-Joint Facings — SI Units . . . . .	66
30C	Dimensions of Ring-Joint Facings — U.S. Customary Units . . . . .	67
31	Permissible Imperfections in Flange Facing Finish — SI Units . . . . .	68
31C	Permissible Imperfections in Flange Facing Finish — U.S. Customary Units . . . . .	68
32	Dimensions of Class 150 Series A Flanges — SI Units . . . . .	69
32C	Dimensions of Class 150 Series A Flanges — U.S. Customary Units . . . . .	71
33	Dimensions of Class 300 Series A Flanges — SI Units . . . . .	73
33C	Dimensions of Class 300 Series A Flanges — U.S. Customary Units . . . . .	75
34	Dimensions of Class 400 Series A Flanges — SI Units . . . . .	77
34C	Dimensions of Class 400 Series A Flanges — U.S. Customary Units . . . . .	79
35	Dimensions of Class 600 Series A Flanges — SI Units . . . . .	81
35C	Dimensions of Class 600 Series A Flanges — U.S. Customary Units . . . . .	83
36	Dimensions of Class 900 Series A Flanges — SI Units . . . . .	85
36C	Dimensions of Class 900 Series A Flanges — U.S. Customary Units . . . . .	87
37	Dimensions of Class 75 Series B Flanges — SI Units . . . . .	89
37C	Dimensions of Class 75 Series B Flanges — U.S. Customary Units . . . . .	91
38	Dimensions of Class 150 Series B Flanges — SI Units . . . . .	93
38C	Dimensions of Class 150 Series B Flanges — U.S. Customary Units . . . . .	95
39	Dimensions of Class 300 Series B Flanges — SI Units . . . . .	97
39C	Dimensions of Class 300 Series B Flanges — U.S. Customary Units . . . . .	99
40	Dimensions of Class 400 Series B Flanges — SI Units . . . . .	101
40C	Dimensions of Class 400 Series B Flanges — U.S. Customary Units . . . . .	103
41	Dimensions of Class 600 Series B Flanges — SI Units . . . . .	105
41C	Dimensions of Class 600 Series B Flanges — U.S. Customary Units . . . . .	107
42	Dimensions of Class 900 Series B Flanges — SI Units . . . . .	109
42C	Dimensions of Class 900 Series B Flanges — U.S. Customary Units . . . . .	111
43	Flange Bolting Dimensional Recommendations . . . . .	113
A-1	Rating Ceiling Values — SI Units . . . . .	118
A-1C	Rating Ceiling Values — U.S. Customary Units . . . . .	119
B-1	Gasket Groups and Typical Materials . . . . .	121
D-1	<i>F</i> Values . . . . .	123
D-2	<i>n</i> Values for Stud Bolt Length, <i>A</i> . . . . .	123

## FOREWORD

In November 1980, a task force was appointed within Subcommittee C of the American National Standards Institute (ANSI) B16 Committee to develop a standard for pipe flanges in sizes NPS 26 through NPS 48. Every attempt was made to standardize those dimensions that existed within the industry for the materials covered by ANSI B16.5.

Prompted by suggestions from committee members, the task force was authorized to increase the size range to NPS 60. The first draft was developed in December 1982 to include Class 75 through Class 1500 for the size range NPS 26 through NPS 60. Flange dimensions were based on the Manufacturers Standardization Society, Standard Practice (MSS SP) 44 flanges, except for Class 75 flanges that are ANSI/API 605 flanges.

At the request of the American Petroleum Institute (API), flange dimensions, in accordance with the API Standard 605, were included in the subsequent drafts. Class 1500 flanges were deleted due to a lack of interest in using large-size flanges in that pressure-temperature rating.

The API 605 flanges for Classes 150 and 300 and for sizes NPS 36 and smaller for classes higher than Class 300 are not compatible with the MSS SP-44 flanges. Thus, the MSS SP-44 flanges are designated as Series A flanges, and the API 605 flanges are designated as Series B flanges in this Standard. Materials covered in this Standard are as in ANSI B16.5, except nickel base alloys are excluded. Pressure-temperature ratings are in accordance with ANSI B16.5.

In 1982, American National Standards Committee B16 was reorganized as the American Society of Mechanical Engineers (ASME) B16 Committee operating under procedures accredited by ANSI. Following approval by the Standards Committee and ASME, approval as an American National Standard was given by ANSI on June 12, 1990.

The 1996 edition allowed flanges marked with more than one material grade or specification, revised flange face finish requirements, revised pressure-temperature ratings for several material groups, added permissible flange facing imperfections, added blind flanges for Series B flanges, and included several other revisions. Following approval by the Standards Committee and ASME Boiler and Pressure Vessel Committee, ANSI approved the 1996 edition as an American National Standard on October 3, 1996, with the new designation ASME B16.47-1996.

In 2006, several revisions were made, including use of metric units as primary units, with U.S. Customary units in either parenthetical or separate forms. Mandatory Appendix I was provided after the main text for convenience to cover ratings and dimensions in U.S. Customary units. Inch dimension bolt holes were retained for flanges manufactured to metric dimensions to avoid fit-up problems. Development of metric dimensions was done to reflect the intended precision of the dimension rather than by numerical conversion. For some materials, pressure-temperature ratings were revised to reflect revisions to material strength properties (tensile and yield) listed in the ASME Boiler and Pressure Vessel Code, Section II. Some materials were assigned to different rating tables in order to minimize changes to ratings for commonly used materials. Following the approvals of the Standards Committee and ASME, approval for the revised edition was granted by ANSI on November 6, 2006.

In the 2011 edition, the References section was revised to cover the requirements of material specification editions other than those listed in Mandatory Appendix III. Following approval by the Standards Committee and the ASME Board on PTCS, the 2011 edition was approved as an American National Standard by ANSI on August 17, 2011, with the new designation ASME B16.47-2011.

In the 2017 edition, pressure-temperature ratings for Group 1.18 materials were revised at 650°C (1,200°F). A reference was made to MSS SP-44 for some classes of flanges made with materials having a high yield strength. A forging requirement was made explicit, and references were updated. Following approval by the ASME B16 Standards Committee, the 2017 edition was approved by ANSI as an American National Standard on March 6, 2017, with the new designation ASME B16.47-2017.

In the 2020 edition, the U.S. Customary tables formerly in Mandatory Appendix I were relocated to the main text and redesignated with a "C" suffix (e.g., Table I-1 became Table 3C). Former Mandatory Appendix I was deleted, and the subsequent Mandatory Appendix was redesignated. Cross-references were updated accordingly. In addition, ASME B16.47-2020 added bolt lengths to the dimension tables, new language describing ASME Cases, and Nonmandatory Appendix D. Following approval by the ASME B16 Standards Committee, ASME B16.47-2020 was approved by ANSI as an American National Standard on November 13, 2020.

In the 2025 edition, a new bolting material has been added to Table 2 and the table's Note (5) revised accordingly. Pressure-temperature ratings have been revised throughout the tables, and a new table for duplex materials has been introduced. Definitions of "may," "shall," and "should" have been added, and references have been updated. Following

approval by the ASME B16 Standards Committee, ASME B16.47-2025 was approved by ANSI as an American National Standard on March 4, 2025.

# ASME B16 COMMITTEE

## Standardization of Valves, Flanges, Fittings, and Gaskets

(The following is the roster of the committee at the time of approval of this Standard.)

### STANDARDS COMMITTEE OFFICERS

C. E. Davila, *Chair*  
R. M. Bojarczuk, *Vice Chair*  
S. Rossi, *Secretary*

### STANDARDS COMMITTEE PERSONNEL

A. Appleton, Appleton Quality Concepts, LLC	A. Kireta, Jr., Copper Development Association, Inc.
J. E. Barker, DeZURIK, Inc.	E. J. Lain, Constellation
R. Barnes, ANRIC Enterprises, Inc.	T. A. McMahon, Emerson Process Management
D. C. Bayreuther, Neles USA, Inc.	R. C. Merrick, Consultant
W. Bedesem, Consultant	W. H. Patrick, Dow, Inc.
R. M. Bojarczuk, Consultant	D. W. Rahoi, Consultant
A. M. Cheta, Shell Global Solutions (US)	D. F. Reid, VSP Technologies
G. A. Cuccio, Capitol Manufacturing Co.	S. Rossi, The American Society of Mechanical Engineers
C. E. Davila, Crane ChemPharma and Energy	R. A. Schmidt, Canadoil
J. G. Dominguez, Welding Outlets, Inc.	J. Sekerak, CSA America Standards, Inc.
B. G. Fabian, Pennsylvania Machine Works, LLC	F. Feng, <i>Delegate</i> , China Productivity Center for Machinery National Technical Committee
D. R. Frikken, Becht Engineering Co., Inc.	J. D. Grant, <i>Alternate</i> , DeZURIK, Inc.
J. R. Holstrom, Val-Matic Valve and Manufacturing Corp.	P. V. Craig, <i>Contributing Member</i> , Jomar Group, Ltd.
D. Hunt, Jr., Fastenal Co.	
G. A. Jolly, Samshin, Ltd.	

### SUBCOMMITTEE C — STEEL FLANGES AND FLANGED FITTINGS

D. R. Frikken, <i>Chair</i> , Becht Engineering Co., Inc.	J. R. Holstrom, Val-Matic Valve and Manufacturing Corp.
A. Carrion, <i>Secretary</i> , The American Society of Mechanical Engineers	G. A. Jolly, Samshin, Ltd.
A. Appleton, Appleton Quality Concepts, LLC	R. C. Merrick, Consultant
W. B. Bedesem, Consultant	W. H. Patrick, Dow, Inc.
A. Casteel, Flour Enterprises	D. W. Rahoi, Consultant
A. M. Cheta, Shell Global Solutions (US)	T. V. Ramakrishnan, Forged Components, Inc.
C. E. Davila, Crane ChemPharma and Energy	R. A. Schmidt, Canadoil
B. Dennis, Kerkau Manufacturing	D. E. Tezzo, Emerson
J. G. Dominguez, Welding Outlets, Inc.	J. A. Tubb, JCM Industries, Inc.
R. Faircloth, Faircloth Consulting Services, LLC	G. T. Walden, Ferguson
G. B. Hailegiorgis, Forged Components, Inc.	M. M. Zaidi, Worley
M. M. Haynie, Bechtel	

# CORRESPONDENCE WITH THE B16 COMMITTEE

**General.** ASME codes and standards are developed and maintained by committees with the intent to represent the consensus of concerned interests. Users of ASME codes and standards may correspond with the committees to propose revisions or cases, report errata, or request interpretations. Correspondence for this Standard should be sent to the staff secretary noted on the committee's web page, accessible at <https://go.asme.org/B16committee>.

**Revisions and Errata.** The committee processes revisions to this Standard on a continuous basis to incorporate changes that appear necessary or desirable as demonstrated by the experience gained from the application of the Standard. Approved revisions will be published in the next edition of the Standard.

In addition, the committee may post errata on the committee web page. Errata become effective on the date posted. Users can register on the committee web page to receive email notifications of posted errata.

This Standard is always open for comment, and the committee welcomes proposals for revisions. Such proposals should be as specific as possible, citing the paragraph number, the proposed wording, and a detailed description of the reasons for the proposal, including any pertinent background information and supporting documentation.

## Cases

(a) The most common applications for cases are

- (1) to permit early implementation of a revision based on an urgent need
- (2) to provide alternative requirements
- (3) to allow users to gain experience with alternative or potential additional requirements prior to incorporation directly into the Standard
- (4) to permit the use of a new material or process

(b) Users are cautioned that not all jurisdictions or owners automatically accept cases. Cases are not to be considered as approving, recommending, certifying, or endorsing any proprietary or specific design, or as limiting in any way the freedom of manufacturers, constructors, or owners to choose any method of design or any form of construction that conforms to the Standard.

(c) A proposed case shall be written as a question and reply in the same format as existing cases. The proposal shall also include the following information:

- (1) a statement of need and background information
- (2) the urgency of the case (e.g., the case concerns a project that is underway or imminent)
- (3) the Standard and the paragraph, figure, or table number
- (4) the editions of the Standard to which the proposed case applies

(d) A case is effective for use when the public review process has been completed and it is approved by the cognizant supervisory board. Approved cases are posted on the committee web page.

**Interpretations.** Upon request, the committee will issue an interpretation of any requirement of this Standard. An interpretation can be issued only in response to a request submitted through the online Inquiry Submittal Form at <https://go.asme.org/InterpretationRequest>. Upon submitting the form, the inquirer will receive an automatic email confirming receipt.

ASME does not act as a consultant for specific engineering problems or for the general application or understanding of the Standard requirements. If, based on the information submitted, it is the opinion of the committee that the inquirer should seek assistance, the request will be returned with the recommendation that such assistance be obtained. Inquirers can track the status of their requests at <https://go.asme.org/Interpretations>.

ASME procedures provide for reconsideration of any interpretation when or if additional information that might affect an interpretation is available. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME committee or subcommittee. ASME does not "approve," "certify," "rate," or "endorse" any item, construction, proprietary device, or activity.

Interpretations are published in the ASME Interpretations Database at <https://go.asme.org/Interpretations> as they are issued.

**Committee Meetings.** The B16 Standards Committee regularly holds meetings that are open to the public. Persons wishing to attend any meeting should contact the secretary of the committee. Information on future committee meetings can be found on the committee web page at <https://go.asme.org/B16committee>.

# ASME B16.47-2025

## SUMMARY OF CHANGES

Following approval by the ASME B16 Standards Committee and ASME, and after public review, ASME B16.47-2025 was approved by the American National Standards Institute on March 4, 2025.

In ASME B16.47-2025, titles of complementary tables have been editorially revised to indicate the applicable system of units. ASME B16.47-2025 also includes the following changes identified by a margin note, (25). The Record Numbers listed below are explained in more detail in the “List of Changes in Record Number Order” following this Summary of Changes.

<i>Page</i>	<i>Location</i>	<i>Change (Record Number)</i>
2	1.13	Added (22-2279)
2	2.2	Second sentence revised (22-2279)
2	2.4	Revised (21-1888)
2	2.5.3	Revised (21-1888)
4	5.3.4	Last sentence deleted (21-1888)
5	5.3.5	Second sentence of subpara. (a) revised (22-2279)
11	Table 1	Revised (21-1888, 23-2374)
13	Table 2	(1) A320-L7M added and Note (5) revised (22-651) (2) Note (7) deleted and subsequent notes renumbered (21-1888)
14	Table 3	Revised (21-1888, 22-2277, 23-2374)
15	Table 3C	Revised (21-1888, 23-2374)
16	Table 4	Revised (21-1888, 22-2277, 23-2374)
17	Table 4C	Revised (21-1888, 23-2374)
18	Table 5	Revised (21-1888, 22-2277, 23-2374)
19	Table 5C	Revised (21-1888, 23-2374)
20	Table 6	Revised (21-1888, 22-2277, 23-2374)
21	Table 6C	Revised (21-1888, 23-2374)
22	Table 7	Revised (21-1888, 23-2374)
23	Table 7C	Revised (21-1888, 23-2374)
24	Table 8	Revised (21-1888, 23-2374)
25	Table 8C	Revised (21-1888, 23-2374)
26	Table 9	Revised (21-1888, 23-2374)
27	Table 9C	Revised (21-1888, 23-2374)
28	Table 10	Revised (21-1888, 23-2374)
29	Table 10C	Revised (21-1888, 23-2374)
30	Table 11	Revised (21-1888, 23-2374)
31	Table 11C	Revised (21-1888, 23-2374)
32	Table 12	Revised (21-1888, 23-2374)
33	Table 12C	Revised (21-1888, 23-2374)
34	Table 13	Revised (21-1888, 23-2374)
35	Table 13C	Revised (21-1888, 23-2374)

<i>Page</i>	<i>Location</i>	<i>Change (Record Number)</i>
36	Table 14	Revised (21-1888, 23-2374)
37	Table 14C	Revised (21-1888, 23-2374)
38	Table 15	Revised (21-1888, 23-2374)
39	Table 15C	Revised (21-1888, 23-2374)
40	Table 16	Revised (21-1888, 23-2374)
41	Table 16C	Revised (21-1888, 23-2374)
42	Table 17	Revised (21-1888, 23-2374)
43	Table 17C	Revised (21-1888, 23-2374)
44	Table 18	Revised (21-1888, 23-2374)
45	Table 18C	Revised (21-1888, 23-2374)
46	Table 19	Revised (21-1888, 23-2374)
47	Table 19C	Revised (21-1888, 23-2374)
48	Table 20	(1) Revised (21-1888, 23-2374) (2) For Class 150, working pressure at 400°C corrected by errata to 5.5 bar (22-203)
49	Table 20C	Revised (21-1888, 23-2374)
50	Table 21	Revised (21-1888, 22-2277, 23-2374)
51	Table 21C	Revised (21-1888, 23-2374)
52	Table 22	Revised (21-1888, 23-2374)
53	Table 22C	Revised (21-1888, 23-2374)
54	Table 23	Revised (21-1888, 23-2374)
55	Table 23C	Revised (21-1888, 23-2374)
56	Table 24	Revised (21-1888, 23-2374)
56	Table 24C	Revised (21-1888, 23-2374)
57	Table 25	Revised (21-1888, 22-2277, 23-2374)
58	Table 25C	Revised (21-1888, 23-2374)
59	Table 26	Revised (21-1888, 23-2374)
60	Table 26C	Revised (21-1888, 23-2374)
61	Table 27	Revised (21-1888, 23-2374)
62	Table 27C	Revised (21-1888, 23-2374)
63	Table 28	Revised (21-1888, 23-2374)
64	Table 28C	Revised (21-1888, 23-2374)
65	Table 29	Added and subsequent tables redesignated (21-1888, 23-2374)
65	Table 29C	Added and subsequent tables redesignated (21-1888, 23-2374)
69	Table 32	Formerly Table 31; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
71	Table 32C	Formerly Table 31C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
73	Table 33	Formerly Table 32; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
75	Table 33C	Formerly Table 32C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
77	Table 34	Formerly Table 33; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
79	Table 34C	Formerly Table 33C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised

<i>Page</i>	<i>Location</i>	<i>Change (Record Number)</i>
81	Table 35	Formerly Table 34; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
83	Table 35C	Formerly Table 34C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
85	Table 36	(1) Formerly Table 35; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised (2) Minimum thickness for a weld neck flange of nominal pipe size 30 corrected by errata to 149.4 mm (22-99)
87	Table 36C	Formerly Table 35C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
89	Table 37	Formerly Table 36; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
91	Table 37C	Formerly Table 36C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
93	Table 38	Formerly Table 37; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
95	Table 38C	Formerly Table 37C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
97	Table 39	Formerly Table 38; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
99	Table 39C	Formerly Table 38C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
101	Table 40	Formerly Table 39; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
103	Table 40C	Formerly Table 39C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
105	Table 41	Formerly Table 40; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
107	Table 41C	Formerly Table 40C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
109	Table 42	Formerly Table 41; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
111	Table 42C	Formerly Table 41C; subheadings under "Minimum Thickness of Flange, $t_f$ " editorially revised
114	Mandatory Appendix I	Updated (23-2265)
118	Table A-1	(1) Title editorially revised (2) Under Temperature, °C, first entry revised (21-1888) (3) Ceiling pressures for Classes 300 through 900 revised (22-2110)
119	Table A-1C	(1) Formerly Table A-2; designator and title editorially revised (2) Under Temperature, °F, first entry revised (21-1888) (3) Ceiling pressures for Classes 300 through 900 revised (22-2110)
123	Table D-1	Editorially reformatted

# LIST OF CHANGES IN RECORD NUMBER ORDER

Record Number	Change
21-1888	Revised paras. 2.4, 2.5.3, and 5.3.4 as well as Table 1, Table 2, Tables 3 through 28 (Tables 3C through 28C), and Table A-1 [Table A-1C (formerly Table A-2)]. Updated references in Mandatory Appendix I.
22-99	Errata correction. See Summary of Changes for details.
22-203	Errata correction. See Summary of Changes for details.
22-651	Added bolting material to Table 2.
22-2110	Revised ceiling pressures for Classes 300 through 900 in Table A-1 [Table A-1C (formerly Table A-2)].
22-2277	In notes of Tables 3 through 6, 21, and 25, revised metric temperatures to the nearest degree.
22-2279	Added para. 1.13 to define "may," "shall," and "should." Revised "must" to "shall" in second sentence of paras. 2.2 and to "should" in second sentence of para. 5.3.5(a).
23-2265	Updated the references.
23-2374	Revised materials in Table 1 and pressure values and notes in Tables 3 through 28 (Tables 3C through 28C). Added Table 29 (Table 29C) for Group 2.13 materials.

# LARGE DIAMETER STEEL FLANGES

## NPS 26 Through NPS 60

### Metric/Inch Standard

## 1 GENERAL

### 1.1 Scope

This Standard covers pressure-temperature ratings, materials, dimensions, tolerances, marking, and testing for pipe flanges in sizes NPS 26 through NPS 60. Included are flanges with rating class designations 75, 150, 300, 400, 600, and 900 with requirements given in both SI (Metric) and U.S. Customary units, with diameter of bolts and flange bolt holes expressed in inch units.

This Standard is limited to

- (a) flanges made from cast or forged materials
- (b) blind flanges made from cast, forged, or plate materials (see [Tables 1](#) and [2](#))

Also included in this Standard are requirements and recommendations regarding flange bolting, flange gaskets, and flange joints.

### 1.2 Flange Series

This Standard provides two series of flange dimensions. Series A specifies flange dimensions for general use flanges. Series B specifies flange dimensions for compact flanges that, in most cases, have smaller bolt circle diameters than Series A flanges. These two series of flanges are, in general, not interchangeable. The user should recognize that some flanged valves, equipment bolted between flanges, and flanged equipment may be compatible with only one series of these flanges.

### 1.3 References

Codes, standards, and specifications, containing provisions to the extent referenced herein, constitute requirements of this Standard. These references are listed in [Mandatory Appendix I](#).

### 1.4 Time of Purchase, Manufacture, or Installation

The pressure-temperature ratings in this Standard are applicable upon its publication to all flanges within its scope that otherwise meet its requirement. For unused flanges maintained in inventory, the manufacturer of the flange may certify conformance to this edition, provided that it can be demonstrated that all require-

ments of this edition have been met. Where such components were installed in accordance with the pressure-temperature ratings of an earlier edition of this Standard, those ratings are applicable, except as may be governed by the applicable code or regulation.

### 1.5 User Accountability

This Standard cites responsibilities that are to be assumed by the flange user in the areas of, for example

- (a) application
- (b) installation
- (c) system pressure testing
- (d) operation
- (e) material selection

### 1.6 Quality Systems

Requirements relating to the product manufacturer's quality system program are described in [Nonmandatory Appendix C](#).

### 1.7 Relevant Units

This Standard states values in both SI (Metric) and U.S. Customary units. As an exception, diameter of bolts and flange bolt holes are expressed in inch units only. These systems of units are to be regarded separately as standard. Within the text, the U.S. Customary units are shown in parentheses. The values stated in each system are not exact equivalents; therefore, it is required that each system of units be used independently of the other. Except for diameter of bolts and flange bolt holes, combining values from the two systems constitutes nonconformance with the Standard.

### 1.8 Selection of Materials

Criteria for selection of materials suitable for particular fluid service are not within the scope of this Standard.

### 1.9 Convention

For determining conformance with this Standard, the convention for fixing significant digits where limits (maximum and minimum values) are specified shall be as defined in ASTM Practice E29. This requires that an observed or calculated value be rounded off to the

nearest unit in the last right-hand digit used for expressing the limit. Decimal values and tolerances do not imply a particular method of measurement.

## 1.10 Denotation

**1.10.1 Pressure Rating Designation.** Class, followed by a dimensionless number, is the designation for pressure-temperature ratings (i.e., Class 75, Class 150, Class 300, Class 400, Class 600, Class 900).

**1.10.2 Size.** NPS, followed by a dimensionless number, is the designation for nominal flange size. NPS is related to the reference nominal diameter, DN, used in international and other standards. For the sizes covered in this Standard, the relationship is  $DN = 25 \times NPS$ .

## 1.11 Similar Flanges

MSS SP-44 covers similar Class 150, 300, 400, 600, and 900 flanges for use with high strength pipe made from materials having yield strength greater than 276 MPa (40,000 psi) resulting in large inside pipe diameter and thinner pipe wall. See [para. 2.7](#).

## 1.12 Cases

ASME issues Cases that are applicable to this Standard by, for example, adding new materials or alternative construction requirements. The Cases

- (a) modify the requirements of this Standard
- (b) are applicable from their issue dates until the Cases are annulled
- (c) may be used only when agreed to by the purchaser and the manufacturer, and when so agreed, the marking shall include the Case number

## 1.13 Definitions

*may*: the term used to denote permission, neither a requirement nor a recommendation.

*shall*: the term used to denote a requirement.

*should*: the term used to denote a recommendation.

# 2 PRESSURE-TEMPERATURE RATINGS

## 2.1 General

Pressure-temperature ratings are maximum allowable working gage pressures, in bar units, at the temperatures in degrees Celsius shown in [Tables 3](#) through [29](#) for the applicable material and class designation. [Tables 3C](#) through [29C](#) list pressure-temperature ratings using pounds per square inch (psi) units for pressure at the temperature in degrees Fahrenheit. For intermediate temperatures, linear interpolation is permitted. Interpolation between class designations is not permitted.

## 2.2 Flanged Joints

(25)

A flanged joint is composed of separate and independent, although interrelated, components: the flanges, the gasket, and the bolting, which are assembled by another influence, the assembler. Proper controls shall be exercised in the selection and application for all of these elements to attain a joint that has acceptable leak tightness. Assembly and tightening techniques, such as controlled bolt tightening, are described in ASME PCC-1.

## 2.3 Ratings of Flanged Joints

**2.3.1 Basis.** Pressure-temperature ratings apply to flanged joints that conform to the limitations on bolting in [para. 5.3](#) and on gaskets in [para. 5.4](#), and that are made up in accordance with good practice for alignment and assembly (see [para. 2.2](#)). Use of these ratings for flanged joints not conforming to these limitations is the responsibility of the user.

**2.3.2 Mixed Flanged Joints.** If the two flanges in a flanged joint do not have the same pressure-temperature rating, the rating of the joint at any temperature is the lower of the two flange ratings at that temperature.

## 2.4 Rating Temperature

(25)

The temperature shown for a corresponding pressure rating is the temperature of the pressure-containing shell of the component. For any temperature below 38°C (100°F), the rating shall be no greater than the rating shown for 38°C (100°F). See also [para. 2.5.3](#).

## 2.5 Temperature Considerations

**2.5.1 General.** Use of flanges at either high or low temperatures shall take into consideration the risk of joint leakage due to forces and moments developed in the connected piping or equipment. Provisions in [paras. 2.5.2](#) and [2.5.3](#) are included as advisory with the aim of lessening these risks.

**2.5.2 High Temperature.** Application at temperatures in the creep range will result in decreasing bolt loads as relaxation of flanges, bolts, and gaskets takes place. Flanged joints subjected to thermal gradients may likewise be subject to decreasing bolt loads. Decreased bolt loads diminish the capacity of the flanged joint to sustain loads effectively without leakage. At temperatures above 200°C (400°F) for Classes 75 and 150, and above 400°C (750°F) for other class designations, flanged joints may develop leakage problems unless care is taken to avoid imposing severe external loads and/or severe thermal gradients.

**2.5.3 Low Temperature.** Some of the materials listed in [Tables 1](#) and [2](#), notably some carbon steels, may undergo a decrease in ductility when used at low temperatures to such an extent as to be unable to safely resist shock

loading, sudden changes of stress, or high stress concentration. Codes and regulations might have requirements for low-temperature applications that are a function of the flange dimensions as well as the material. See ASME B16.5, Nonmandatory Appendix G for a further explanation. When such requirements apply, it is the responsibility of the user to ensure these requirements are communicated to the manufacturer prior to the time of purchase.

## 2.6 System Pressure Testing

Flanged joints may be subjected to system pressure tests at a pressure of 1.5 times the 38°C (100°F) rating rounded off to the next higher 1 bar (25 psi) increment. Testing at any higher pressure is the responsibility of the user, taking into account the requirements of the applicable code or regulation.

## 2.7 Welding Neck Flanges

**2.7.1 Maximum Bore Size.** Ratings for welding neck flanges covered by this Standard are based upon their hubs at the welding end having a thickness at least equal to that calculated for pipe having a 276 MPa (40,000 psi) specified minimum yield strength. To ensure adequate flange hub thickness for flange sizes NPS 26 and larger, the bore of a welding neck flange, dimension  $B$  as shown in [Figures 1](#) and [2](#), shall not exceed  $B_{\max}$  determined as follows:

Class	$B_{\max}$
75	0.9971A
150	0.9942A
300	0.9850A
400	0.9800A
600	0.9700A
900	0.9550A

$A$  = tabulated hub diameter, beginning of chamfer as listed in the dimensional tables

$B_{\max}$  = maximum permissible diameter for the bore of a welding neck flang

The resultant units for diameter  $B_{\max}$  are the same as those entered for diameter  $A$ .

**2.7.2 Components of Unequal Strength.** The tabulated ratings for welding neck flanges are independent of components of unequal strength or unequal wall thickness to which they may be attached. For all attachments, the pressure rating of the flange shall not be exceeded.

**2.7.3 Attachment Welds.** Attachment welds should be made in accordance with the applicable code or regulation. See [para. 6.4](#) and [Figure 3](#) for weld end dimensional requirements.

## 2.8 Multiple Material Grades

Materials for flanges may meet the requirements of more than one specification or the requirements of more than one grade of a specification listed in [Table 1](#). In either case, the pressure-temperature ratings for any of these specifications or grades may be used provided that the material is marked in accordance with [para. 4.2.8](#).

## 3 COMPONENT SIZE: NOMINAL PIPE SIZE

As applied in this Standard, the use of the phrase "nominal pipe size" or the designation NPS followed by a dimensionless number is for the purpose of pipe or flange end connection size identification. The number is not the same as the flange inside diameter.

## 4 MARKING

### 4.1 General

Except as noted in [para. 4.2](#), flanges shall be marked as required in MSS SP-25.

### 4.2 Identification Markings

**4.2.1 Name.** The manufacturer's name or trademark shall be applied.

**4.2.2 Materials.** Materials shall be identified in the following ways:

(a) Cast flanges shall be marked with the ASTM specification,<sup>1</sup> grade identification symbol (letters and numbers), and the melt number or melt identification.

(b) Plate flanges and forged flanges shall be marked with the ASTM specification<sup>1</sup> number and grade identification symbol.

(c) A manufacturer may supplement these mandatory material markings with a trade designation for the material grade, but confusion of symbols shall be avoided.

(d) For flanges manufactured from material that meets the requirements for more than one specification or grade of a specification listed in [Table 1](#), see [para. 4.2.8](#).

**4.2.3 Rating Designation.** The flange shall be marked with the number that corresponds to its pressure rating class designation (i.e., 75, 150, 300, 400, 600, or 900).

**4.2.4 Conformance.** The designation B16 or B16.47 shall be applied to the flange, preferably adjacent to the class designation, to indicate conformance to this Standard. The use of the prefix "ASME" is optional.

<sup>1</sup> An ASME Boiler and Pressure Vessel Code, Section II specification number may be substituted for an ASTM specification number provided the requirements of the ASME specifications are identical or more stringent than the ASTM specification for the Grade, Class, or Type of material.

**4.2.5 Temperature.** Temperature markings are not required on flanges. However, if marked, the temperature shall be shown with its corresponding tabulated pressure rating for the material.

**4.2.6 Size.** The NPS identification number shall be marked on flanges.

**4.2.7 Ring-Joint Flange.** The edge (periphery) of each ring-joint flange shall be marked with the letter R and the corresponding ring-groove number.

**4.2.8 Multiple Material Marking.** Material for components that meet the requirements for more than one ASTM specification number or grade of a specification listed in [Table 1](#) may, at the manufacturer's option, be marked with more than one of the applicable specification numbers or grade symbols. These identification markings shall be placed so as to avoid confusion in identification. The multiple marking shall be in accordance with the guidelines set out in ASME Boiler and Pressure Vessel Code, Section II, Part D, Appendix 7.

**4.2.9 Case Number.** When a flange or flanged fitting meets the requirements of a Case, the Case number shall be included in the markings as "Case ##".

## 5 MATERIALS

### 5.1 General

(a) Materials required for flanges are listed in [Table 1](#) with the restriction that plate materials shall be used only for blind flanges. Flanges shall be manufactured as one piece in accordance with the applicable material specification. Assembly of multiple pieces into the finished product by welding or other means is not permitted by this Standard.

(b) Each forged flange shall be finished from a part that is brought as nearly as practicable to the finished shape and size by a compressive plastic hot working operation that consolidates the material to produce an essentially wrought structure, and shall be so processed during the operation as to cause metal flow in the direction most favorable for resisting the stresses encountered in service.

(c) Recommended bolting materials are listed in [Table 2](#) (see [para. 5.3](#)).

(d) Corresponding materials listed in the ASME Boiler and Pressure Vessel Code, Section II may be used provided that the requirements of the ASME specification are identical or more stringent than the ASTM specification for the Grade, Class, or Type of material.

**5.1.1 Application.** Criteria for the selection of materials are not within the scope of this Standard. The possibility of material deterioration in service should be considered by the user. Carbide phase conversion to graphite and excessive oxidation of ferritic materials, susceptibility to inter-

granular corrosion of austenitic materials, or grain boundary attack of nickel base alloys are among those items requiring attention. A detailed discussion of precautionary considerations can be found in

(a) ASME B31.3, Appendix F

(b) ASME Boiler and Pressure Vessel Code Section II, Part D, Appendix 6

(c) ASME Boiler and Pressure Vessel Code Section III, Division 1, Appendix W

**5.1.2 Responsibility.** When service conditions dictate the implementation of special material requirements [e.g., using a Group 2 material above 538°C (1,000°F)], it is the user's responsibility to so specify to the manufacturer to ensure compliance with metallurgical requirements listed in the notes in [Tables 3 through 29](#) ([Tables 3C through 29C](#)).

**5.1.3 Cast Surfaces.** Cast surfaces of flange pressure boundaries shall be in accordance with MSS SP-55, except that all Type I defects are unacceptable, and defects in excess of Plates "a" and "b" for Type II through Type XII are unacceptable.

### 5.2 Mechanical Properties

Mechanical properties shall be obtained from test specimens that represent the final heat-treated condition of the material required by the material specification.

### 5.3 Bolting

**5.3.1 General.** Bolting listed in [Table 2](#) is recommended for use with flanges covered by this Standard. Bolting of other material may be used if permitted by the applicable code or government regulation. Bolting materials are subject to the limitations given in [paras. 5.3.2 through 5.3.5](#).

**5.3.2 High Strength Bolting.** Bolting materials having allowable stresses not less than those for ASTM A193 Gr. B7 are listed as high strength in [Table 2](#). These and other materials of comparable strength may be used in any flanged joint.

**5.3.3 Intermediate Strength Bolting.** When bolting materials listed as intermediate strength in [Table 2](#) or other bolting of comparable strength are used in a flanged joint, it is recommended that the user verify the ability of the selected bolting to seat the selected gasket and maintain a leak-tight joint under expected operating condition.

**5.3.4 Low Strength Bolting.** Bolting materials having (25) no more than 206 MPa (30,000 psi) specified minimum yield strength are listed as low strength in [Table 2](#). These materials and others of comparable strength are to be used only in Classes 75, 150, and 300 flanged joints (see [para. 5.4.2](#) and [Nonmandatory Appendix B](#)).

(25) **5.3.5 Bolting to Gray Iron Flanges.** The following recommendations are made in recognition of the low ductility of gray iron:

(a) Alignment of flange faces is essential, along with control of assembly bolt torque, so as not to overstress gray iron flanges. Care should also be exercised to ensure that piping loads transmitted to gray iron flanges are controlled, taking into account its lack of ductility, and recognizing that gray iron flanges should not be used where suddenly applied loads such as rapid pressure fluctuation may occur.

(b) Where Class 150 steel flanges are bolted to Class 125 gray iron flanges, the gaskets should be made of Group No. Ia materials (see [Nonmandatory Appendix B, Table B-1](#)) and both flanges should have flat faces and either of the following:

(1) Low strength bolting within the limitations of [para. 5.3.4](#) should be used with ring gaskets extending to the bolt holes.

(2) Bolting of low ([para. 5.3.4](#)), intermediate ([para. 5.3.3](#)), or high ([para. 5.3.2](#)) strength may be used with full face gaskets extending to the outside diameters of the flanges.

(c) Where Class 300 steel flanges are bolted to Class 250 gray iron flanges, the gaskets should be made of Group No. Ia materials (see [Nonmandatory Appendix B, Table B-1](#)) and either of the following:

(1) Low strength bolting within the limitations of [para. 5.3.4](#) should be used with gaskets extending to the bolt holes and with flanges having either raised or flat faces.

(2) Bolting of low ([para. 5.3.4](#)), intermediate ([para. 5.3.3](#)), or high ([para. 5.3.2](#)) strength may be used with full face gaskets extending to the outside diameters of the flanges and with both the Class 300 steel and Class 250 gray iron flanges having flat faces.

## 5.4 Gaskets

**5.4.1 General.** Ring-joint gasket materials shall conform to ASME B16.20. Materials for other gaskets are described in [Nonmandatory Appendix B](#). The user is responsible for the selection of gasket materials that will withstand the expected bolt loading without injurious crushing and are suitable for the service conditions.

**5.4.2 Gaskets for Low Strength Bolting.** If bolting listed as low strength in [Table 2](#) is used, gaskets shown in [Nonmandatory Appendix B, Table B-1](#), Group No. Ia are recommended.

**5.4.3 Gaskets for Class 150 Flanged Joints.** It is recommended that only Group No. Ia or Group No. Ib gaskets from [Nonmandatory Appendix B, Table B-1](#) be used for Class 150 flanged joints.

**5.4.4 Gaskets for Class 75 Flanged Joints.** It is recommended that only Group No. Ia gaskets from [Nonmandatory Appendix B, Table B-1](#), with a gasket factor  $m = 2$  or less and minimum design seating stress  $y = 1,600$  psi or less, be used. The  $m$  and  $y$  factors are those given in Appendix 2 of the ASME Boiler and Pressure Vessel Code, Section VIII, Division 1.

## 6 DIMENSIONS

### 6.1 Flange Facings

**6.1.1 General.** Classes 75, 150, and 300 flanges are regularly furnished with a 1.5 mm (0.06 in.) raised face. Classes 400, 600, and 900 flanges are regularly furnished with a 6.4 mm (0.25 in.) raised face. The thickness of the raised face in all cases is in addition to the minimum flange thickness,  $t_f$ . It is recommended that the Class 75 flanges be used only with a 1.5 mm (0.06 in.) raised face or flat face. Dimensions for ring-joint facing are given in [Table 30 \(Table 30C\)](#) for Series A flanges.

**6.1.1.1 Raised Face Flanges.** The raised face thickness shall be in addition to the minimum flange thickness,  $t_f$ .

**6.1.1.2 Ring-Joint Flanges.** The thickness required to form the ring-joint groove [dimension  $E$  in [Table 30 \(Table 30C\)](#)] shall be in addition to the minimum flange thickness,  $t_f$ .

**6.1.2 Blind Flanges.** Blind flanges need not be faced in the center if, when this center part is raised, its diameter is at least 25 mm (1 in.) smaller than the mating pipe inside diameter. When the center part is depressed, its diameter shall not be greater than the inside diameter of the mating flange. Machining of the depressed center is not required.

**6.1.3 Flat Face Flanges.** The raised face may be removed by the user from a raised face flange to convert it to a flat face flange.

**6.1.4 Flange Facing Finish.** Flange facing finishes shall be in accordance with [paras. 6.1.4.1](#) and [6.1.4.2](#), except that other finishes may be furnished by agreement between the user and the manufacturer. The finish of the gasket contact faces shall be judged by visual comparison with  $Ra$  standards (see ASME B46.1) and not by instruments having stylus tracers and electronic amplification.

**6.1.4.1 Ring-Joint.** The side wall surface finish of the gasket groove shall not exceed 1.6  $\mu\text{m}$  (63  $\mu\text{in}$ .) roughness.

**6.1.4.2 Other Flange Facings.** Either a serrated concentric or serrated spiral finish having a resultant surface finish from 3.2  $\mu\text{m}$  to 6.3  $\mu\text{m}$  (125  $\mu\text{in}$ . to 250  $\mu\text{in}$ .) average roughness shall be furnished. The cutting tool employed should have an approximate 1.5 mm (0.06 in.) or larger radius, and there should be from

1.8 grooves/mm through 2.2 grooves/mm (45 grooves/in. through 55 grooves/in.).

**6.1.5 Flange Facing Finish Imperfections.** Imperfections in the flange facing finish shall not exceed the dimensions shown in [Table 31](#) ([Table 31C](#)). Adjacent imperfections shall be separated by a distance of at least 4 times the maximum radial projection. A radial projection shall be measured by the difference between an outer radius and an inner radius encompassing the imperfection where the radii are struck from the centerline of the bore. Imperfections less than half the depth of the serrations shall not be considered cause for rejection. Protrusions above the serrations are not permitted.

## 6.2 Flange Bolt Holes

Bolt holes are in multiples of four. Bolt holes shall be equally spaced.

## 6.3 Bolting Bearing Surfaces

Flanges shall have bearing surfaces for bolting that are parallel to the flange face within 1 deg. Back facing or spot facing shall not reduce the flange thickness below the dimensions  $t_f$  given in [Tables 32](#) through [42](#) ([Tables 32C](#) through [42C](#)). Spot facing or back facing shall be in accordance with MSS SP-9.

## 6.4 Welding End Preparation for Welding Neck Flanges

**6.4.1 Illustrations.** Welding ends are illustrated in [Figures 1](#) through [3](#).

**6.4.2 Bores.** Cylindrical bores shown in [Figure 1](#) are standard unless specifically ordered to suit the special conditions illustrated in [Figures 2](#) and [3](#). See [para. 2.7](#) for maximum bore sizes.

## 6.5 Flange Bolting Dimensions

**6.5.1 Dimensional Standards.** Stud bolts, threaded at both ends or threaded full length, or bolts may be used in flange joints. Dimensional recommendations for bolts, stud bolts, and nuts are shown in [Table 43](#). See [para. 5.3](#) for bolting material recommendations.

**6.5.2 Bolt Lengths.** Stud bolt lengths, including the height of two heavy hexagon nuts, are shown as dimension  $L$  in [Tables 32](#) through [42](#) ([Tables 32C](#) through [42C](#)). The tabulated stud bolt length  $L$  does not include the height of end points. An end point is defined as an unthreaded length, such as a chamfer, which extends beyond the thread. The method of calculating bolt lengths is explained in [Nonmandatory Appendix D](#). The tabulated bolt lengths are reference dimensions. Users may select other bolting lengths.

Tabulated values shown are for bolting together two welding neck flanges only. Other types of flanges, including blind flanges, may require different bolt lengths.

**6.5.3 Bolting Recommendations.** For flange joints, stud bolts with a nut at each end are recommended for all applications.

## 6.6 Gaskets

**6.6.1 Ring-Joint Gaskets.** Ring-joint gasket dimensions should conform to ASME B16.20.

**6.6.2 Nonmetallic Gaskets.** Nonmetallic gasket dimensions should conform to ASME B16.21.

**6.6.3 Spiral Wound and Double-Jacketed Gaskets.** Spiral wound and double-jacketed corrugated metal gaskets should conform to ASME B16.20.

## 6.7 Hub Dimensions

Any modification to hub dimensions shown in [Tables 32](#) through [42](#) ([Tables 32C](#) through [42C](#)) shall be by agreement between the purchaser and manufacturer and shall be confirmed by calculations in accordance with ASME Boiler and Pressure Vessel Code, Section VIII, Division 1, Appendix 2. Flanges so modified shall be marked with the material designation of the pipe to which they are to be welded in addition to the marking per [para. 4.2.2](#).

## 7 TOLERANCES

### 7.1 Facings

Required tolerances for various flange facings are as follows:

- (a) outside diameter of raised face,  $\pm 2$  mm ( $\pm 0.08$  in.)
- (b) 1.5 mm (0.06 in.) raised face,  $\pm 0.5$  mm ( $\pm 0.02$  in.)
- (c) 6.4 mm (0.25 in.) raised face,  $\pm 2$  mm ( $\pm 0.08$  in.)
- (d) ring-joint groove tolerances are shown in [Table 30](#) ([Table 30C](#))

### 7.2 Flange Thickness

Required tolerances for flange thickness,  $t_f$ , are as follows:

Flange Thickness, $t_f$ , mm (in.)	Tolerance, mm (in.)
$\leq 25$ ( $\leq 1.0$ )	$+3.0, -0.0$ ( $+0.12, -0.00$ )
$> 25$ to $\leq 50$ ( $> 1.0$ to $\leq 2.0$ )	$+5.0, -0.0$ ( $+0.20, -0.00$ )
$> 50$ to $\leq 75$ ( $> 2.0$ to $\leq 3.0$ )	$+8.0, -0.0$ ( $+0.31, -0.00$ )
$> 75$ ( $> 3.0$ )	$+10.0, -0.0$ ( $+0.39, -0.00$ )

The plus tolerance is applicable to bolting bearing surfaces whether as-forged, as-cast, spot-faced, or back-faced. See [para. 6.3](#).

### 7.3 Welding End Flange Ends and Hubs

**7.3.1 Outside Diameter.** The required tolerance for the nominal outside diameter, dimension *A* of [Figure 1](#), of welding ends of welding neck flanges is +5.0 mm, -2.0 mm (+0.20 in., -0.08 in.).

**7.3.2 Inside Diameter.** Required tolerances for the nominal inside diameter, dimension *B* of [Figures 1](#) and [2](#), of welding ends of welding neck flanges are as follows:

- (a) for [Figure 1](#): +3.0 mm, -2.0 mm (+0.12 in., -0.08 in.)
- (b) for [Figure 2](#): +0.0 mm, -2.0 mm (+0.00 in., -0.08 in.)

**7.3.3 Backing Ring Contact Surface.** The required tolerance for the bore of the backing ring contact surface of welding neck flanges, dimension *C* of [Figure 2](#), is +0.25 mm, -0.0 mm (+0.01 in., -0.00 in.).

**7.3.4 Hub Thickness.** Despite the tolerances specified for dimensions *A* and *B*, the thickness of the hub at the welding end shall not be less than 87.5% of the nominal thickness of the pipe having an undertolerance of 12.5% for the pipe wall thickness to which the flange is to be attached or the minimum wall thickness as specified by the purchaser.

### 7.4 Hub Length for Welding Neck Flanges

The required tolerance for the overall length of hubs for welding neck flanges is +3.0 mm, -5.0 mm (+0.12 in., -0.20 in.).

### 7.5 Drilling and Facing

**7.5.1 Bolt Circle Diameter.** The required tolerance for all bolt circle diameters is  $\pm 1.5$  mm ( $\pm 0.06$  in.).

**7.5.2 Bolt Hole to Bolt Hole.** The required tolerance for the center-to-center of adjacent bolt holes is  $\pm 0.8$  mm ( $\pm 0.03$  in.).


**7.5.3 Bolt Circle Concentricity.** The required tolerance for concentricity between the flange bolt circle diameter and machined facing diameter is 1.5 mm (0.06 in.).

## 8 PRESSURE TESTING


### 8.1 Flange Test

Flanges are not required to be pressure tested.

**Figure 1**  
**Welding Ends (Welding Neck Flanges, No Backing Rings)**

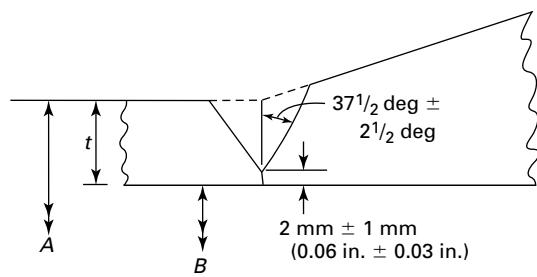

**(a) Bevel for Wall Thickness,  $t$ ,  
 From 5 mm to 22 mm (0.19 in. to 0.88 in.) Inclusive**

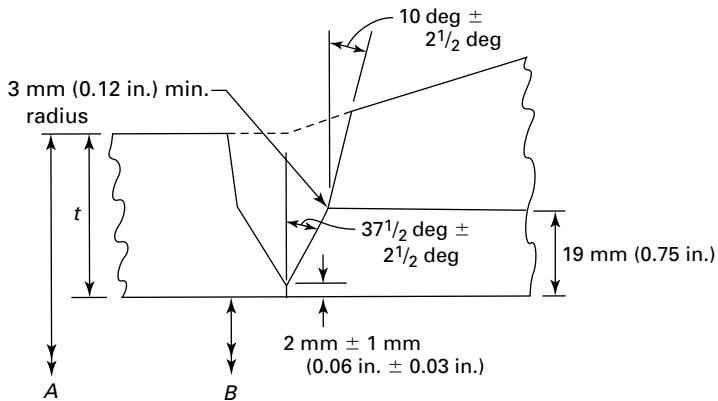

**(b) Bevel for Wall Thickness,  $t$ ,  
 Greater Than 22 mm (0.88 in.)**


**Legend:**

$A$  = nominal outside diameter of pipe  
 $B$  = nominal inside diameter of pipe  
 $t$  = nominal wall thickness of pipe

**GENERAL NOTES:**

- (a) See paras. 6.4 and 7.4 for details and tolerances.
- (b) See [Figure 2](#) for additional details of welding ends.
- (c) When the thickness of the hub at the bevel is greater than that of the pipe to which the flange is joined, the additional thickness may be provided on either the inside or outside, or partially on each side, but the total additional thickness shall not exceed  $\frac{1}{2}$  times the nominal wall thickness of the mating pipe (see [Figure 3](#)).

**Figure 2**  
**Welding Ends (Welding Neck Flanges With Backing Rings)**

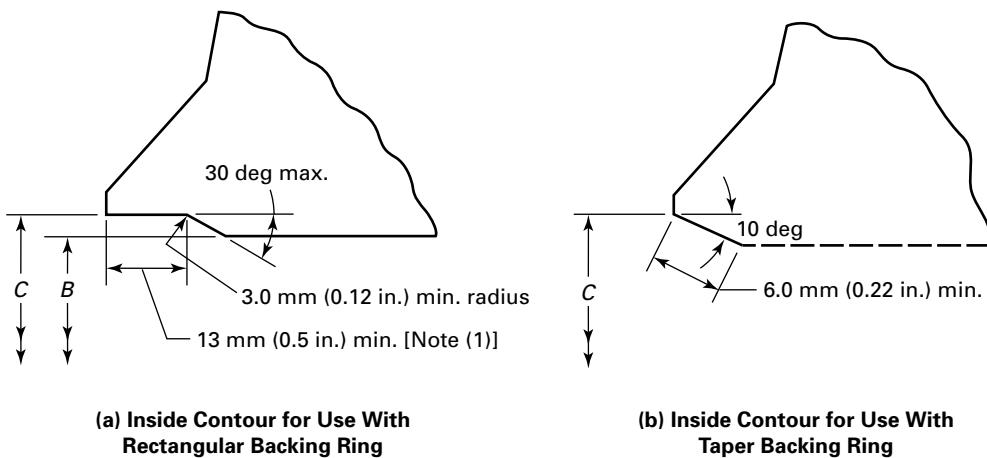

Legend:

$A$  = nominal outside diameter of welding end  
 $B$  = nominal inside diameter of pipe  
 $= A - 2t$   
 $C = A - 0.79 \text{ mm} - 1.75t - 0.25 \text{ mm}$  for SI units  
 $= A - 0.031 \text{ in.} - 1.75t - 0.010 \text{ in.}$  for U.S. customary units

where


$0.25 \text{ mm (0.010 in.)}$  = plus tolerance on diameter  $C$  (see [para 7.3.3](#))  
 $0.79 \text{ mm (0.031 in.)}$  = minus tolerance on O.D. of pipe  
 $1.75t = 87\frac{1}{2}\%$  of nominal wall multiplied by 2 to convert into terms of diameter  
 $t$  = nominal wall thickness of pipe

GENERAL NOTES:

- (a) See [paras. 6.4](#) and [7.4](#) for details and tolerances.
- (b) See [Figure 1](#) for welding and details of welding neck flanges.

NOTE: (1) 13 mm (0.5 in.) depth based on the use of a 19 mm (0.75 in) wide backing ring.

**Figure 3**  
**Welding Ends (Welding Neck Flanges)**

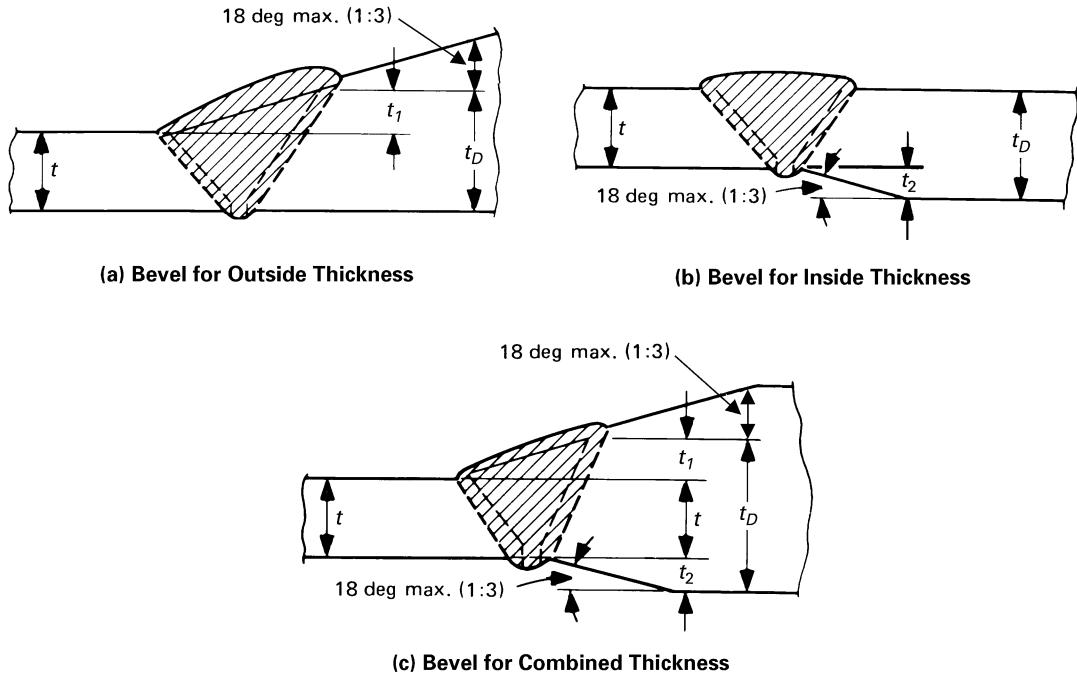

**GENERAL NOTES:**

- (a) Neither  $t_1$ ,  $t_2$ , nor their sum ( $t_1 + t_2$ ) shall exceed 0.5 $t$ .
- (b) When the minimum specified yield strengths of the sections to be joined are unequal, the value of  $t_D$  shall at least equal  $t$  times the ratio of minimum specified yield strength of the pipe to the minimum specified yield strength of the flange.
- (c) Welding shall be in accordance with the applicable code.
- (d) Additional thickness for welding to higher strength pipe.

**Table 1**  
**List of Material Specifications**

(25)

Material Group No.	Nominal Designation	Applicable ASTM Specifications		
		Forgings	Castings	Plates [Note (1)]
<b>Group 1 Materials</b>				
1.1	C-Si	A105	A216 Gr. WCB	A515 Gr. 70
	C-Mn-Si	A350 Gr. LF2	...	A516 Gr. 70
	C-Mn-Si	...	...	A537 Cl. 1
	C-Mn-Si-V	A350 Gr. LF6 Cl. 1	...	...
	3 $\frac{1}{2}$ Ni	A350 Gr. LF3	...	...
1.2	C-Mn-Si	...	A216 Gr. WCC	...
	C-Mn-Si	...	A352 Gr. LCC	...
	C-Mn-Si-V	A350 Gr. LF6 Cl. 2	...	...
	2 $\frac{1}{2}$ Ni	...	A352 Gr. LC2	A203 Gr. B
	3 $\frac{1}{2}$ Ni	...	A352 Gr. LC3	A203 Gr. E
1.3	C-Si	...	A352 Gr. LCB	A515 Gr. 65
	C-Mn-Si	...	...	A516 Gr. 65
	2 $\frac{1}{2}$ Ni	...	...	A203 Gr. A
	3 $\frac{1}{2}$ Ni	...	...	A203 Gr. D
	C- $\frac{1}{2}$ Mo	...	A217 Gr. WC1	...
	C- $\frac{1}{2}$ Mo	...	A352 Gr. LC1	...
1.4	C-Si	...	...	A515 Gr. 60
	C-Mn-Si	A350 Gr. LF1 Cl. 1	...	A516 Gr. 60
1.5	C- $\frac{1}{2}$ Mo	A182 Gr. F1	...	A204 Gr. A
	C- $\frac{1}{2}$ Mo	...	...	A204 Gr. B
1.7	$\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo	A182 Gr. F2	...	...
	Ni- $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo	...	A217 Gr. WC4	...
	$\frac{3}{4}$ Ni- $\frac{3}{4}$ Cr-1Mo	...	A217 Gr. WC5	...
1.9	$1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo	...	A217 Gr. WC6	...
	$1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si	A182 Gr. F11 Cl. 2	...	A387 Gr. 11 Cl. 2
1.10	$2\frac{1}{4}$ Cr-1Mo	A182 Gr. F22 Cl. 3	A217 Gr. WC9	A387 Gr. 22 Cl. 2
1.11	3Cr-1Mo	A182 F21	...	A387 Gr. 21 Cl 2
	C- $\frac{1}{2}$ Mo	...	...	A240 Gr. C
1.13	5Cr- $\frac{1}{2}$ Mo	A182 Gr. F5A	A217 Gr. C5	...
1.14	9Cr-1Mo	A182 Gr. F9	A217 Gr. C12	...
1.15	9Cr-1Mo-V	A182 Gr. F91 Type 1	A217 Gr. C12A	A387 Gr. 91 Cl. 2
1.17	1Cr- $\frac{1}{2}$ Mo	A182 Gr. F12 Cl. 2	...	...
	5Cr- $\frac{1}{2}$ Mo	A182 Gr. F5	...	...
1.18	9Cr-2W-V	A182 Gr. F92	...	...
<b>Group 2 Materials</b>				
2.1	18Cr-8Ni	A182 Gr. F304	A351 Gr. CF3	A240 Gr. 304
	18Cr-8Ni	A182 Gr. F304H	A351 Gr. CF8	A240 Gr. 304H
2.2	16Cr-12Ni-2Mo	A182 Gr. F316	A351 Gr. CF3M	A240 Gr. 316
	16Cr-12Ni-2Mo	A182 Gr. F316H	A351 Gr. CF8M	A240 Gr. 316H
	18Cr-13Ni-3Mo	A182 Gr. F317	...	A240 Gr. 317
	19Cr-10Ni-3Mo	...	A351 Gr. CG8M	...
2.3	18Cr-8Ni	A182 Gr. F304L	...	A240 Gr. 304L
	16Cr-12Ni-2Mo	A182 Gr. F316L	...	A240 Gr. 316L
	18Cr-13Ni-3Mo	A182 Gr. F317L	...	...
2.4	18Cr-10Ni-Ti	A182 Gr. F321	...	A240 Gr. 321
	18Cr-10Ni-Ti	A182 Gr. F321H	...	A240 Gr. 321H

**Table 1**  
**List of Material Specifications (Cont'd)**

Material Group No.	Nominal Designation	Applicable ASTM Specifications		
		Forgings	Castings	Plates <b>[Note (1)]</b>
<b>Group 2 Materials (Cont'd)</b>				
2.5	18Cr-10Ni-Cb	A182 Gr. F347	...	A240 Gr. 347
	18Cr-10Ni-Cb	A182 Gr. F347H	...	A240 Gr. 347H
	18Cr-10Ni-Cb	A182 Gr. F348	...	A240 Gr. 348
	18Cr-10Ni-Cb	A182 Gr. F348H	...	A240 Gr. 348H
2.6	23Cr-12Ni	...	...	A240 Gr. 309H
2.7	25Cr-20Ni	A182 Gr. F310H	...	A240 Gr. 310H
2.8	20Cr-18Ni-6Mo	A182 Gr. F44	A351 Gr. CK3MCuN	A240 Gr. S31254
2.9	23Cr-12Ni	...	...	A240 Gr. 309S
	25Cr-20Ni	...	...	A240 Gr. 310S
2.10	25Cr-12Ni	...	A351 Gr. CH8	...
	25Cr-12Ni	...	A351 Gr. CH20	...
2.11	18Cr-10Ni-Cb	...	A351 Gr. CF8C	...
2.12	25Cr-20Ni	...	A351 Gr. CK20	...
2.13	22Cr-5Ni-3Mo-N	A182 Gr. F51	A995 CD3MN (4A)	A240 Gr. S31803
	22Cr-5Ni-3Mo-N	A182 Gr. F60	...	...
	22Cr-5Ni-3Mo-N	...	...	A240 Gr. S32205
	25Cr-5Ni-3Mo-2Cu	...	...	A240 Gr. S32550
	25Cr-7Ni-4Mo-N	A182 Gr. F53	...	A240 Gr. S32750
	24Cr-10Ni-4Mo-N	...	A995 Gr. CE8MN (2A)	...
	25Cr-5Ni-3Cu-2Mo-N	...	A995 Gr. CD4MCuN (1B)	...
	25Cr-7Ni-3.5Mo-W-Cb	...	A995 Gr. CD3MWCuN (6A)	...
	25Cr-7Ni-3.5Mo-N-Cu-W	A182 Gr. F55	...	A240 Gr. S32760

## GENERAL NOTES:

(a) For upper temperature limitations, see notes in [Tables 3](#) through [28](#) ([Tables 3C](#) through [28C](#)).

(b) Lower temperature limits are discussed in [para. 2.5.3](#).

NOTE: (1) Plate materials are listed only for use as blind flanges and reducing flanges without hubs (see [para. 5.1](#)).

**Table 2**  
**List of Bolting Specifications (Applicable ASTM Specifications)**

(25)

Bolting Materials					
High Strength [Note (1)]		Intermediate Strength [Note (2)]		Low Strength [Note (3)]	
Spec.-Grade	Notes	Spec.-Grade	Notes	Spec.-Grade	Notes
A193-B7	...	A193-B5	...	A193-B8 Cl. 1	(4)
A193-B16	...	A193-B6	...	A193-B8C Cl. 1	(4)
		A193-B6X	...	A193-B8M Cl. 1	(4)
A320-L7	(5)	A193-B7M	...	A193-B8T Cl. 1	(4)
A320-L7A	(5)				
A320-L7B	(5)	A193-B8 Cl. 2, 2B	(6)	A193-B8A	(4)
A320-L7C	(5)	A193-B8C Cl. 2	(6)	A193-B8CA	...
A320-L43	(5)	A193-B8M Cl. 2, 2B, 2C	(6)	A193-B8MA	...
		A193-B8T Cl. 2	(6)	A193-B8TA	(4)
A354-BC	...				
A354-BD	...	A320-B8 Cl. 2	(6)	A307-B	...
		A320-B8C Cl. 2	(6)		
A540-B21	...	A320-B8F Cl. 2	(6)	A320-B8 Cl. 1	(4)
A540-B22	...	A320-B8M Cl. 2	(6)	A320-B8C Cl. 1	(4)
A540-B23	...	A320-B8T Cl. 2	(6)	A320-B8M Cl. 1	(4)
A540-B24	...	A320-L7M	(5)	A320-B8T Cl. 1	(4)
		A449	(7)		
		A453-651	(8)		
		A453-660	(8)		

## GENERAL NOTES:

- (a) Bolting material shall not be used beyond temperature limits specified in the governing code.
- (b) ASME Boiler and Pressure Vessel Code, Section II materials that also meet the requirements of the listed ASTM specifications may also be used.
- (c) Repair welding of bolting material is prohibited.

## NOTES:

- (1) These bolting materials may be used with all listed materials and gaskets. See [para. 5.3.2](#).
- (2) These bolting materials may be used with all listed materials and gaskets, provided it has been verified that a sealed joint can be maintained under rated working pressure and temperature. See [para. 5.3.3](#).
- (3) These bolting materials may be used with all listed materials but are limited to Classes 75, 150, and 300 joints (see [para. 5.3.4](#)). See [para. 5.4](#) for recommended gasket practices.
- (4) This austenitic stainless material has been carbide solution treated but not strain hardened. Use A194 nuts of corresponding material.
- (5) This ferritic material is intended for low temperature service. Use A194 Gr. 4 or Gr. 7 nuts. For A320-L7M bolting, use A194 Gr. 7M or Gr. 2HM nuts.
- (6) This austenitic stainless material has been carbide solution treated and strain hardened. Use A194 nuts of corresponding material.
- (7) Acceptable nuts for use with quenched and tempered bolts are A194 Gr. 2 and Gr. 2H. Mechanical property requirements for studs shall be the same as those for bolts.
- (8) This special alloy is intended for high temperature service with austenitic stainless steel.

(25)

**Table 3**  
**Pressure-Temperature Ratings for Group 1.1 Materials — SI Units**

Nominal Designation	Forgings	Castings		Plates	
		...	...	...	...
C-Si	A105 [Notes (1), (2)]	A216 Gr. WCB [Note (1)]	A515 Gr. 70 [Note (1)]		
C-Mn-Si	A350 Gr. LF2 [Note (1)]	...	A516 Gr. 70 [Notes (1), (2)]		
C-Mn-Si	...	...	A537 Cl. 1 [Note (3)]		
C-Mn-Si-V	A350 Gr. LF6 Cl. 1 [Note (4)]	...	...	...	
3½Ni	A350 Gr. LF3 [Note (5)]	...	...	...	
<b>Working Pressure by Classes, bar</b>					
Temperature, °C	75	150	300	400	600
min. to 38 [Note (6)]	9.8	19.6	51.0	68.0	102.0
50	9.6	19.1	49.8	66.4	99.6
100	8.8	17.7	46.7	62.3	93.4
150	7.9	15.8	45.1	60.1	90.1
200	6.9	13.8	43.8	58.4	87.6
250	6.0	12.1	42.0	56.0	83.9
300	5.1	10.2	39.9	53.2	79.6
325	4.6	9.3	38.7	51.6	77.3
350	3.1	8.4	37.6	50.2	75.3
375	...	7.4	36.4	48.5	72.8
400	...	6.5	34.6	46.2	69.3
425	...	5.5	28.7	38.3	57.5
450	...	4.6	23.0	30.6	45.9
475	...	3.7	17.5	23.3	35.0
500	...	2.8	11.5	15.4	23.0
538	...	1.4	5.8	7.7	11.6
					17.4

## NOTES:

- (1) Upon prolonged exposure to temperatures above 427°C, the carbide phase of steel may be converted to graphite. Permissible, but not recommended for prolonged use above 427°C.
- (2) Only killed steel shall be used above 455°C.
- (3) Not to be used over 371°C.
- (4) Not to be used over 260°C.
- (5) Not to be used over 343°C.
- (6) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 3C**  
**Pressure-Temperature Ratings for Group 1.1 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings	Castings	Plates			
C-Si	A105 [Notes (1), (2)]	A216 Gr. WCB [Note (1)]	A515 Gr. 70 [Note (1)]			
C-Mn-Si	A350 Gr. LF2 [Note (1)]	...	A516 Gr. 70 [Notes (1), (2)]			
C-Mn-Si	...	...	A537 Cl. 1 [Note (3)]			
C-Mn-Si-V	A350 Gr. LF6 Cl. 1 [Note (4)]	...	...			
3½Ni	A350 Gr. LF3 [Note (5)]	...	...			
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (6)]	140	285	740	985	1,480	2,220
200	130	260	680	905	1,360	2,035
300	115	230	655	870	1,310	1,965
400	100	200	635	845	1,265	1,900
500	85	170	605	805	1,205	1,810
600	70	140	570	755	1,135	1,705
650	60	125	550	730	1,100	1,650
700	...	110	530	710	1,060	1,590
750	...	95	505	675	1,015	1,520
800	...	80	410	550	825	1,235
850	...	65	320	425	640	955
900	...	50	230	305	460	690
950	...	35	135	185	275	410
1,000	...	20	85	115	170	255

## NOTES:

- (1) Upon prolonged exposure to temperatures above 800°F, the carbide phase of steel may be converted to graphite. Permissible, but not recommended for prolonged use above 800°F.
- (2) Only killed steel shall be used above 850°F.
- (3) Not to be used over 700°F.
- (4) Not to be used over 500°F.
- (5) Not to be used over 650°F.
- (6) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 4**  
**Pressure-Temperature Ratings for Group 1.2 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
C-Mn-Si	...		A216 Gr. WCC [Note (1)]		...	
C-Mn-Si	...		A352 Gr. LCC [Note (2)]		...	
C-Mn-Si-V	A350 Gr. LF6 Cl. 2 [Note (3)]		...		...	
2 <sup>1/2</sup> Ni	...		A352 Gr. LC2 [Note (4)]		A203 Gr. B [Note (1)]	
3 <sup>1/2</sup> Ni	...		A352 Gr. LC3 [Note (4)]		A203 Gr. E [Note (1)]	
<b>Working Pressure by Classes, bar</b>						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (5)]	9.9	19.8	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.8	17.7	51.5	68.7	103.0	154.6
150	7.9	15.8	50.2	66.9	100.3	150.5
200	6.9	13.8	48.6	64.8	97.2	145.8
250	6.0	12.1	46.3	61.8	92.7	139.0
300	5.1	10.2	43.6	58.1	87.2	130.8
325	4.6	9.3	42.0	56.0	83.9	125.9
350	3.1	8.4	40.1	53.5	80.2	120.3
375	...	7.4	38.1	50.7	76.1	114.2
400	...	6.5	34.6	46.2	69.3	103.9
425	...	5.5	28.7	38.3	57.5	86.2
450	...	4.6	23.0	30.6	45.9	68.9
475	...	3.7	16.9	22.6	33.9	50.8
500	...	2.8	11.5	15.4	23.0	34.6
538	...	1.4	5.8	7.7	11.6	17.4

## NOTES:

- (1) Upon prolonged exposure to temperatures above 427°C, the carbide phase of steel may be converted to graphite. Permissible, but not recommended for prolonged use above 427°C.
- (2) Not to be used over 371°C.
- (3) Not to be used over 260°C.
- (4) Not to be used over 343°C.
- (5) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 4C**  
**Pressure-Temperature Ratings for Group 1.2 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings	Castings	Plates			
C-Mn-Si	...	A216 Gr. WCC [Note (1)]	...			
C-Mn-Si	...	A352 Gr. LCC [Note (2)]	...			
C-Mn-Si-V	A350 Gr. LF6 Cl. 2 [Note (3)]	...	...			
2½Ni	...	A352 Gr. LC2 [Note (4)]	A203 Gr. B [Note (1)]			
3½Ni	...	A352 Gr. LC3 [Note (4)]	A203 Gr. E [Note (1)]			
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (5)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,405	2,110
500	85	170	665	885	1,330	1,995
600	70	140	615	825	1,235	1,850
650	60	125	590	785	1,175	1,765
700	...	110	555	740	1,110	1,665
750	...	95	505	675	1,015	1,520
800	...	80	410	550	825	1,235
850	...	65	320	425	640	955
900	...	50	225	295	445	670
950	...	35	135	185	275	410
1,000	...	20	85	115	170	255

## NOTES:

- (1) Upon prolonged exposure to temperatures above 800°F, the carbide phase of steel may be converted to graphite. Permissible, but not recommended for prolonged use above 800°F.
- (2) Not to be used over 700°F.
- (3) Not to be used over 500°F.
- (4) Not to be used over 650°F.
- (5) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 5**  
**Pressure-Temperature Ratings for Group 1.3 Materials — SI Units**

Nominal Designation	Forgings	Castings	Plates			
C-Si	...	A352 Gr. LCB [Note (1)]	A515 Gr. 65 [Note (2)]			
C-Mn-Si	...	...	A516 Gr. 65 [Note (2)]			
C- $\frac{1}{2}$ Mo	...	A217 Gr. WC1 [Notes (3)–(5)]	...			
C- $\frac{1}{2}$ Mo	...	A352 Gr. LC1 [Note Note (1)]	...			
2 $\frac{1}{2}$ Ni	...	...	A203 Gr. A			
3 $\frac{1}{2}$ Ni	...	...	A203 Gr. D			
<b>Working Pressure by Classes, bar</b>						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (6)]	9.2	18.4	48.0	64.0	96.0	144.0
50	9.1	18.4	48.0	64.0	96.0	144.0
100	8.7	17.3	45.3	60.3	90.5	135.8
150	7.9	15.8	44.0	58.7	88.0	132.1
200	6.9	13.8	42.6	56.8	85.2	127.7
250	6.0	12.1	40.7	54.3	81.5	122.2
300	5.1	10.2	38.7	51.6	77.3	116.0
325	4.6	9.3	37.6	50.2	75.3	112.9
350	3.1	8.4	36.4	48.5	72.8	109.2
375	...	7.4	35.0	46.6	69.9	104.9
400	...	6.5	32.6	43.4	65.1	97.7
425	...	5.5	27.3	36.4	54.6	81.9
450	...	4.6	21.7	28.9	43.3	65.0
475	...	3.7	15.5	20.7	31.1	46.6
500	...	2.8	10.9	14.5	22.7	32.6
538	...	1.4	5.8	7.7	11.6	17.4

## NOTES:

- (1) Not to be used over 371°C.
- (2) Upon prolonged exposure to temperatures above 427°C, the carbide phase of steel may be converted to graphite. Permissible, but not recommended for prolonged use above 427°C.
- (3) Upon prolonged exposure to temperatures above 470°C, the carbide phase of carbon-molybdenum steel may be converted to graphite. Permissible, but not recommended for prolonged use above 470°C.
- (4) Use normalized and tempered material only.
- (5) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (6) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 5C**  
**Pressure-Temperature Ratings for Group 1.3 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings	Castings	Plates			
3Cr-1Mo	A182 F21		A387 Gr. 21 Cl.2			
C-Si	... A352 Gr. LCB [Note (1)]	...	A515 Gr. 65 [Note (2)]			
C-Mn-Si	... ...	...	A516 Gr. 65 [Note (2)]			
C- $\frac{1}{2}$ Mo	... A217 Gr. WC1 [Notes (3)-(5)]		...			
C- $\frac{1}{2}$ Mo	... A352 Gr. LC1 [Note (1)]		...			
2 $\frac{1}{2}$ Ni	... ...	...	A203 Gr. A			
3 $\frac{1}{2}$ Ni	... ...	...	A203 Gr. D			
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (6)]	135	265	695	930	1,395	2,090
200	125	255	660	880	1,320	1,980
300	115	230	640	850	1,275	1,915
400	100	200	615	820	1,230	1,845
500	85	170	585	780	1,175	1,760
600	70	140	550	735	1,105	1,655
650	60	125	535	710	1,065	1,600
700	...	110	510	685	1,025	1,535
750	...	95	475	635	955	1,430
800	...	80	390	520	780	1,175
850	...	65	300	400	595	895
900	...	50	200	270	405	605
950	...	35	135	185	275	410
1,000	...	20	85	115	170	255

## NOTES:

- (1) Not to be used over 700°F.
- (2) Upon prolonged exposure to temperatures above 800°F, the carbide phase of steel may be converted to graphite. Permissible, but not recommended for prolonged use above 800°F.
- (3) Upon prolonged exposure to temperatures above 875°F, the carbide phase of carbon-molybdenum steel may be converted to graphite. Permissible, but not recommended for prolonged use above 875°F.
- (4) Use normalized and tempered material only.
- (5) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (6) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 6**  
**Pressure-Temperature Ratings for Group 1.4 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	C-Si	...	...	...	A515 Gr. 60 [Note (1)]	A516 Gr. 60 [Note (1)]
C-Mn-Si		A350 Gr. LF1 Cl. 1 [Note (1)]		...		
<b>Working Pressure by Classes, bar</b>						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (2)]	8.2	16.3	42.6	56.8	85.2	127.7
50	8.0	15.9	41.6	55.5	83.2	124.8
100	7.4	14.9	38.9	51.8	77.8	116.6
150	7.2	14.4	37.6	50.2	75.3	112.9
200	6.9	13.8	36.4	48.5	72.8	109.2
250	6.0	12.1	35.0	46.6	69.9	104.9
300	5.1	10.2	33.1	44.2	66.2	99.4
325	4.6	9.3	32.3	43.1	64.6	96.9
350	3.1	8.4	31.3	41.7	62.5	93.8
375	...	7.4	30.4	40.6	60.9	91.3
400	...	6.5	29.4	39.2	58.8	88.3
425	...	5.5	25.8	34.4	51.6	77.5
450	...	4.6	21.4	28.6	42.9	64.4
475	...	3.7	13.4	17.9	26.9	40.3
500	...	2.8	10.3	13.8	20.6	31.0
538	...	1.4	5.9	7.8	11.7	17.6

## NOTES:

(1) Upon prolonged exposure to temperatures above 427°C, the carbide phase of steel may be converted to graphite. Permissible, but not recommended for prolonged use above 427°C.

(2) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 6C**  
**Pressure-Temperature Ratings for Group 1.4 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	C-Si	...	...	...	A515 Gr. 60 [Note (1)]	...
C-Mn-Si	A350 Gr. LF1 Cl. 1 [Note (1)]		...	...	A516 Gr. 60 [Note (1)]	...
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (2)]	120	235	615	825	1,235	1,850
200	110	215	565	755	1,130	1,695
300	105	210	545	725	1,090	1,635
400	100	200	525	700	1,055	1,580
500	85	170	500	670	1,005	1,505
600	70	140	475	630	945	1,420
650	60	125	455	610	915	1,370
700	...	110	440	590	885	1,325
750	...	95	430	570	855	1,285
800	...	80	370	495	740	1,110
850	...	65	300	400	595	895
900	...	50	170	230	345	515
950	...	35	135	185	275	410
1,000	...	20	85	115	170	255

## NOTES:

(1) Upon prolonged exposure to temperature above 800°F, the carbide phase of steel may be converted to graphite. Permissible, but not recommended for prolonged use above 800°F.

(2) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 7**  
**Pressure-Temperature Ratings for Group 1.5 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	C- $\frac{1}{2}$ Mo	A182 Gr. F1 [Note (1)]	...	...	A204 Gr. A [Note (1)]	A204 Gr. B [Note (1)]
Working Pressure by Classes, bar						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (2)]	9.2	18.4	48.0	64.0	96.0	144.0
50	9.2	18.4	48.0	64.0	96.0	144.0
100	8.8	17.7	48.0	64.0	96.0	144.0
150	7.9	15.8	47.3	63.1	94.6	141.9
200	6.9	13.8	45.9	61.2	91.7	137.6
250	6.0	12.1	44.4	59.2	88.9	133.3
300	5.1	10.2	43.2	57.6	86.4	129.6
325	4.6	9.3	42.6	56.8	85.2	127.7
350	3.1	8.4	41.9	55.8	83.6	125.5
375	...	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.4	47.3	71.1	106.5
475	...	3.7	34.4	45.9	68.8	103.2
500	...	2.8	23.3	31.1	46.7	70.0
538	...	1.4	11.2	14.9	22.4	33.5

## NOTES:

(1) Upon prolonged exposure to temperatures above 470°C, the carbide phase of carbon-molybdenum steel may be converted to graphite. Permissible, but not recommended for prolonged use above 470°C.

(2) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 7C**  
**Pressure-Temperature Ratings for Group 1.5 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	C- $\frac{1}{2}$ Mo	A182 Gr. F1 [Note (1)]	...	...	A204 Gr. A [Note (1)]	A204 Gr. B [Note (1)]
Working Pressure by Classes, psig						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (2)]	135	265	695	930	1,395	2,090
200	130	260	695	930	1,395	2,090
300	115	230	685	915	1,375	2,060
400	100	200	660	885	1,325	1,985
500	85	170	640	855	1,285	1,925
600	70	140	620	830	1,245	1,865
650	60	125	610	815	1,220	1,835
700	...	110	600	795	1,190	1,790
750	...	95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	510	685	1,030	1,600
900	...	50	470	625	940	1,410
950	...	35	280	375	560	845
1,000	...	20	165	220	330	495

## NOTE:

(1) Upon prolonged exposure to temperatures above 875°F, the carbide phase of carbon-molybdenum steel may be converted to graphite. Permissible, but not recommended for prolonged use above 875°F.

(2) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 8**  
**Pressure-Temperature Ratings for Group 1.7 Materials — SI Units**

Nominal Designation	Forgings			Castings		Plates
	A182 Gr. F2 [Note (1)]	...	...	A217 Gr. WC4 [Notes (1)–(3)]	A217 Gr. WC5 [Notes (2), (3)]	...
$\frac{1}{2}\text{Cr}-\frac{1}{2}\text{Mo}$				...		...
$\text{Ni}-\frac{1}{2}\text{Cr}-\frac{1}{2}\text{Mo}$	...					...
$\frac{3}{4}\text{Ni}-\frac{3}{4}\text{Cr}-1\text{Mo}$	...					...
<b>Working Pressure by Classes, bar</b>						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (4)]	9.9	19.8	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.8	17.7	51.5	68.7	103.0	154.6
150	7.9	15.8	50.3	67.0	100.3	150.6
200	6.9	13.8	48.6	64.8	97.2	145.8
250	6.0	12.1	46.3	61.8	92.7	139.0
300	5.1	10.2	45.0	60.0	90.0	135.0
325	4.6	9.3	43.3	57.6	86.3	129.6
350	3.1	8.4	41.9	55.8	83.6	125.5
375	...	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.4	47.3	71.1	106.5
475	...	3.7	34.4	45.9	68.8	103.2
500	...	2.8	26.3	35.0	52.5	78.8
538	...	1.4	13.4	17.8	26.7	40.1
550	...	...	13.4	17.8	26.7	40.1
575	...	...	9.4	12.5	18.8	28.2
593	...	...	6.7	8.9	13.3	20.0

## NOTES:

- (1) Not to be used over 538°C.
- (2) Use normalized and tempered material only.
- (3) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (4) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 8C**  
**Pressure-Temperature Ratings for Group 1.7 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
$\frac{1}{2}\text{Cr}-\frac{1}{2}\text{Mo}$	A182 Gr. F2 [Note (1)]		...		...	
$\text{Ni}-\frac{1}{2}\text{Cr}-\frac{1}{2}\text{Mo}$	...		A217 Gr. WC4 [Notes (1)–(3)]		...	
$\frac{3}{4}\text{Ni}-\frac{3}{4}\text{Cr}-1\text{Mo}$	...		A217 Gr. WC5 [Notes (2), (3)]		...	
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (4)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,410	2,115
500	85	170	665	885	1,330	1,995
600	70	140	630	840	1,260	1,890
650	60	125	615	820	1,230	1,845
700	...	110	600	795	1,190	1,790
750	...	95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	510	685	1,030	1,540
900	...	50	475	635	955	1,430
950	...	35	315	420	630	945
1,000	...	20	200	270	405	605
1,050	...	...	160	210	315	475
1,100	...	...	95	130	190	290

## NOTES:

- (1) Not to be used over 1,000°F.
- (2) Use normalized and tempered material only.
- (3) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (4) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 9**  
**Pressure-Temperature Ratings for Group 1.9 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	1 $\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo	...	A217 Gr. WC6 [Notes (1)–(3)]	...	A387 Gr. 11 Cl. 2 [Note (4)]	...
	Working Pressure by Classes, bar					
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (5)]	9.9	19.8	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.8	17.7	51.5	68.6	103.0	154.6
150	7.9	15.8	49.8	66.4	99.6	149.3
200	6.9	13.8	47.9	63.9	95.9	143.8
250	6.0	12.1	46.3	61.7	92.6	138.9
300	5.1	10.2	45.0	60.0	90.0	135.0
325	4.6	9.3	43.3	57.6	86.3	129.6
350	3.1	8.4	41.9	55.8	83.6	125.5
375	...	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.4	47.3	71.1	106.5
475	...	3.7	34.4	45.9	68.8	103.2
500	...	2.8	25.0	33.3	50.0	75.0
538	...	1.4	15.1	20.1	30.1	45.2
550	...	...	12.4	16.6	24.9	37.3
575	...	...	8.6	11.5	17.3	25.9
600	...	...	6.0	8.0	12.1	18.1
625	...	...	4.3	5.7	8.5	12.8
649	...	...	2.8	3.8	5.7	8.5

## NOTES:

- (1) Use normalized and tempered material only.
- (2) Not to be used over 593°C.
- (3) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (4) Permissible, but not recommended for prolonged use above 595°C.
- (5) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 9C**  
**Pressure-Temperature Ratings for Group 1.9 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	1 $\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo	...	A217 Gr. WC6 [Notes (1)-(3)]	...	...	...
1 $\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si	A182 Gr. F11 Cl. 2 [Notes (1), (4)]			...	A387 Gr. 11 Cl. 2 [Note (4)]	
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (5)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	720	965	1,445	2,165
400	100	200	695	925	1,385	2,080
500	85	170	665	885	1,330	1,995
600	70	140	630	840	1,260	1,890
650	60	125	615	820	1,230	1,845
700	...	110	600	795	1,190	1,790
750	...	95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	510	685	1,030	1,540
900	...	50	470	625	940	1,410
950	...	35	320	425	640	955
1,000	...	20	215	290	430	650
1,050	...	...	145	190	290	430
1,100	...	...	95	130	190	290
1,150	...	...	65	85	130	195
1,200	...	...	40	55	80	125

## NOTES:

- (1) Use normalized and tempered material only.
- (2) Not to be used over 1,100°F.
- (3) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (4) Permissible, but not recommended for prolonged use above 1,100°F.
- (5) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 10**  
**Pressure-Temperature Ratings for Group 1.10 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates						
	2 $\frac{1}{4}$ Cr-1Mo	A182 Gr. F22 Cl. 3 [Note (1)]	A217 Gr. WC9 [Notes (2)-(3)]	A387 Gr. 22 Cl. 2 [Note (1)]	Working Pressure by Classes, bar	75	150	300	400	600	900
min. to 38 [Note (4)]	9.9	19.8	51.7	68.9	103.4	155.1					
50	9.8	19.5	51.7	68.9	103.4	155.1					
100	8.8	17.7	51.5	68.7	103.0	154.6					
150	7.9	15.8	50.3	67.0	100.3	150.6					
200	6.9	13.8	48.6	64.8	97.2	145.8					
250	6.0	12.1	46.3	61.8	92.7	139.0					
300	5.1	10.2	45.0	60.0	90.0	135.0					
325	4.6	9.3	43.3	57.6	86.3	129.6					
350	3.1	8.4	41.9	55.8	83.6	125.5					
375	0.0	7.4	40.5	53.9	80.7	121.2					
400	...	6.5	38.0	50.7	76.2	114.2					
425	...	5.5	36.8	48.9	73.2	109.8					
450	...	4.6	35.4	47.3	71.1	106.5					
475	...	3.7	34.4	45.9	68.8	103.2					
500	...	2.8	30.7	40.9	61.3	92.0					
538	...	1.4	18.6	24.7	37.1	55.7					
550	...	...	15.4	20.5	30.8	46.2					
575	...	...	10.3	13.8	20.6	31.0					
600	...	...	6.8	9.0	13.5	20.3					
625	...	...	4.4	5.9	8.8	13.3					
649	...	...	2.8	3.8	5.7	8.5					

## NOTES:

- (1) Permissible, but not recommended for prolonged use above 595°C.
- (2) Use normalized and tempered material only.
- (3) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (4) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

**Table 10C**  
**Pressure-Temperature Ratings for Group 1.10 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	2 1/4Cr-1Mo	A182 Gr. F22 Cl. 3 [Note (1)]	A217 Gr. WC9 [Notes (2)-(3)]	A387 Gr. 22 Cl. 2 [Note (1)]	Working Pressure by Classes, psig	Plates
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (4)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,410	2,115
500	85	170	665	885	1,330	1,995
600	70	140	630	840	1,260	1,890
650	60	125	615	820	1,230	1,845
700	...	110	600	795	1,190	1,790
750	...	95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	510	685	1,030	1,540
900	...	50	475	635	955	1,430
950	...	35	390	520	780	1,175
1,000	...	20	265	355	535	800
1,050	...	...	175	235	350	525
1,100	...	...	110	145	220	330
1,150	...	...	70	90	135	205
1,200	...	...	40	55	80	125

## NOTES:

- (1) Permissible, but not recommended for prolonged use above 1,100°F.
- (2) Use normalized and tempered material only.
- (3) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (4) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 11**  
**Pressure-Temperature Ratings for Group 1.11 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	3Cr-1Mo	A182 F21	...	...	A387 Gr. 21 Cl. 2	A204 Gr. C [Notes (1), (2)]
Temperature, °C	Working Pressure by Classes, bar					
	75	150	300	400	600	900
min. to 38 [Note (3)]	10.0	20.0	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.8	17.7	51.5	68.7	103.0	154.6
150	7.9	15.8	50.3	67.0	100.3	150.6
200	6.9	13.8	48.6	64.8	97.2	145.8
250	6.0	12.1	46.3	61.8	92.7	139.0
300	5.1	10.2	45.0	60.0	90.0	135.0
325	4.6	9.3	43.3	57.6	86.3	129.6
350	3.1	8.4	41.9	55.8	83.6	125.5
375	0.0	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.4	47.3	71.1	106.5
475	...	3.7	34.3	45.7	68.6	102.9
500	...	2.8	23.0	30.7	46.1	69.1
538	...	1.4	11.2	14.9	22.4	33.6
550	...	...	11.2	14.9	22.4	33.6
575	...	...	10.1	13.4	20.2	30.2
600	...	...	7.0	9.3	14.0	21.0
625	...	...	5.4	7.2	10.8	16.1
649	...	...	3.1	4.1	6.1	9.2

NOTES:

(1) Upon prolonged exposure to temperatures above 470°C, the carbide phase of carbon-molybdenum steel may be converted to graphite. Permissible, but not recommended for prolonged use above 470°C.

(2) Not to be used over 538°F.

(3) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 11C**  
**Pressure-Temperature Ratings for Group 1.11 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	3Cr-1Mo	A182 F21	...	...	A387 Gr. 21 CL2	A204 Gr. C [Notes (1), (2)]
	Working Pressure by Classes, psig					
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (3)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,410	2,115
500	85	170	665	885	1,330	1,995
600	70	140	630	840	1,260	1,890
650	60	125	615	820	1,230	1,845
700	...	110	600	795	1,190	1,790
750	...	95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	510	685	1,030	1,540
900	...	50	450	600	900	1,345
950	...	35	280	375	560	845
1,000	...	20	165	220	330	495
1,050	...	...	165	220	330	495
1,100	...	...	110	145	220	330
1,150	...	...	80	110	165	245
1,200	...	...	45	60	90	135

## NOTES:

(1) Upon prolonged exposure to temperatures above 875°F, the carbide phase of carbon-molybdenum steel may be converted to graphite. Permissible, but not recommended for prolonged use above 875°F.

(2) Not to be used over 1,000°F.

(3) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 12**  
**Pressure-Temperature Ratings for Group 1.13 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	5Cr- $\frac{1}{2}$ Mo	A182 Gr. F5a	A217 Gr. C5 [Notes (1), (2)]		...	...
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (3)]	10.0	20.0	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.8	17.7	51.5	68.7	103.0	154.6
150	7.9	15.8	50.3	67.0	100.3	150.6
200	6.9	13.8	48.6	64.8	97.2	145.8
250	6.0	12.1	46.3	61.8	92.7	139.0
300	5.1	10.2	45.0	60.0	90.0	135.0
325	4.6	9.3	43.3	57.6	86.3	129.6
350	3.1	8.4	41.9	55.8	83.6	125.5
375	0.0	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.3	47.1	70.6	105.9
475	...	3.7	27.6	36.8	55.3	82.9
500	...	2.8	21.3	28.3	42.5	63.8
538	...	1.4	13.8	18.4	27.6	41.5
550	...	...	11.9	15.9	23.9	35.8
575	...	...	8.8	11.8	17.7	26.5
600	...	...	6.2	8.2	12.3	18.5
625	...	...	3.9	5.3	7.9	11.8
649	...	...	2.4	3.1	4.7	7.1

## NOTES:

- (1) Use normalized and tempered material only.
- (2) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (3) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 12C**  
**Pressure-Temperature Ratings for Group 1.13 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	5Cr- $\frac{1}{2}$ Mo	A182 Gr. F5a	A217 Gr. C5 [Notes (1), (2)]		...	
Temperature, °F	Working Pressure by Classes, psig					
min. to 100 [Note (3)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,410	2,115
500	85	170	665	885	1,330	1,995
600	70	140	630	840	1,260	1,890
650	60	125	615	820	1,230	1,845
700	...	110	600	795	1,190	1,790
750	...	95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	490	655	980	1,470
900	...	50	375	500	745	1,120
950	...	35	275	365	550	825
1,000	...	20	200	265	400	595
1,050	...	...	145	190	290	430
1,100	...	...	100	135	200	300
1,150	...	...	60	80	125	185
1,200	...	...	35	45	70	105

## NOTES:

- (1) Use normalized and tempered material only.
- (2) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (3) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 13**  
**Pressure-Temperature Ratings for Group 1.14 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	9Cr-1Mo	A182 Gr. F9	A217 Gr. C12 [Notes (1), (2)]		...	...
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (3)]	10.0	20.0	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.8	17.7	51.5	68.7	103.0	154.6
150	7.9	15.8	50.3	67.0	100.3	150.6
200	6.9	13.8	48.6	64.8	97.2	145.8
250	6.0	12.1	46.3	61.8	92.7	139.0
300	5.1	10.2	45.0	60.0	90.0	135.0
325	4.6	9.3	43.3	57.6	86.3	129.6
350	3.1	8.4	41.9	55.8	83.6	125.5
375	...	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.4	47.3	71.1	106.5
475	...	3.7	34.4	45.9	68.8	103.2
500	...	2.8	30.2	40.3	60.5	90.7
538	...	1.4	17.7	23.6	35.3	53.0
550	...	...	14.7	19.7	29.5	44.2
575	...	...	10.3	13.7	20.6	30.9
600	...	...	7.1	9.4	14.1	21.2
625	...	...	4.9	6.6	9.9	14.8
649	...	...	3.6	4.7	7.1	10.7

## NOTES:

- (1) Use normalized and tempered material only.
- (2) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (3) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 13C**  
**Pressure-Temperature Ratings for Group 1.14 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	9Cr-1Mo	A182 Gr. F9	A217 Gr. C12 [Notes (1), (2)]			...
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (3)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,410	2,115
500	85	170	665	885	1,330	1,995
600	70	140	630	840	1,260	1,890
650	60	125	615	820	1,230	1,845
700	...	110	600	795	1,190	1,790
750	...	95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	510	685	1,030	1,540
900	...	50	475	635	955	1,430
950	...	35	375	505	755	1,130
1,000	...	20	255	340	505	760
1,050	...	...	170	230	345	515
1,100	...	...	115	150	225	340
1,150	...	...	75	100	150	225
1,200	...	...	50	70	105	155

## NOTES:

- (1) Use normalized and tempered material only.
- (2) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.
- (3) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 14**  
**Pressure-Temperature Ratings for Group 1.15 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	9Cr-1Mo-V	A182 Gr. F91 Type 1	A217 Gr. C12A [Note (1)]	A387 Gr. 91 Cl. 2		
Temperature, °C	Working Pressure by Classes, bar					
	75	150	300	400	600	900
min. to 38 [Note (2)]	10.0	20.0	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.8	17.7	51.5	68.7	103.0	154.6
150	7.9	15.8	50.3	67.0	100.3	150.6
200	6.9	13.8	48.6	64.8	97.2	145.8
250	6.0	12.1	46.3	61.8	92.7	139.0
300	5.1	10.2	45.0	60.0	90.0	135.0
325	4.6	9.3	43.3	57.6	86.3	129.6
350	3.1	8.4	41.9	55.8	83.6	125.5
375	...	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.4	47.3	71.1	106.5
475	...	3.7	34.4	45.9	68.8	103.2
500	...	2.8	32.1	42.9	64.4	96.6
538	...	1.4	29.0	38.5	57.5	86.5
550	...	...	28.8	38.3	57.3	86.0
575	...	...	25.9	34.5	51.8	77.7
600	...	...	18.6	24.8	37.2	55.9
625	...	...	12.6	16.8	25.2	37.9
649	...	...	8.4	11.2	16.8	25.2

## NOTES:

(1) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.

(2) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 14C**  
**Pressure-Temperature Ratings for Group 1.15 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	9Cr-1Mo-V	A182 Gr. F91 Type 1	A217 Gr. C12A [Note (1)]	A387 Gr. 91 Cl. 2		
Temperature, °F	Working Pressure by Classes, psig					
	75	150	300	400	600	900
min. to 100 [Note (2)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,410	2,115
500	85	170	665	885	1,330	1,995
600	70	140	630	840	1,260	1,890
650	60	125	615	820	1,230	1,845
700	...	110	600	795	1,190	1,790
750	...	95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	510	685	1,030	1,540
900	...	50	475	635	955	1,430
950	...	35	425	570	855	1,275
1,000	...	20	415	550	825	1,245
1,050	...	20	410	545	820	1,230
1,100	...	...	300	400	595	895
1,150	...	...	195	260	390	585
1,200	...	...	120	160	240	360

## NOTES:

(1) The deliberate addition of any element not listed in ASTM A217, Table 1 is prohibited, except that calcium (Ca) and manganese (Mn) may be added for deoxidation.

(2) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 15**  
**Pressure-Temperature Ratings for Group 1.17 Materials — SI Units**

Nominal Designation	Forgings			Castings		Plates
	1Cr- $\frac{1}{2}$ Mo	A182 Gr. F12 Cl. 2 [Notes (1), (2)]		...	...	...
5Cr- $\frac{1}{2}$ Mo	A182 Gr. F5		...	...	...	...
Working Pressure by Classes, bar						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (3)]	9.9	19.8	51.7	68.9	103.4	155.1
50	9.8	19.5	51.6	68.7	103.1	154.7
100	8.8	17.7	50.6	67.4	101.1	151.7
150	7.9	15.8	48.1	64.2	96.3	144.4
200	6.9	13.8	46.3	61.7	92.6	138.9
250	6.0	12.1	44.8	59.8	89.7	134.5
300	5.1	10.2	43.6	58.1	87.2	130.8
325	4.6	9.3	43.0	57.3	86.0	129.0
350	3.1	8.4	41.9	55.8	83.6	125.5
375	...	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.0	46.6	69.9	104.9
475	...	3.7	27.8	37.1	55.6	83.4
500	...	2.8	21.2	28.3	42.4	63.6
538	...	1.4	13.8	18.4	27.6	41.5
550	...	...	11.9	15.9	23.8	35.7
575	...	...	8.8	11.8	17.7	26.5
600	...	...	5.9	7.9	11.9	17.8
625	...	...	3.9	5.3	7.9	11.8
649	...	...	2.4	3.1	4.7	7.1

NOTES:

- (1) Use normalized and tempered material only.
- (2) Permissible, but not recommended for prolonged use above 595°C.
- (3) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 15C**  
**Pressure-Temperature Ratings for Group 1.17 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings			Castings	Plates
1Cr- $\frac{1}{2}$ Mo	A182 Gr. F12 Cl. 2 [Notes (1), (2)]			...	...
5Cr- $\frac{1}{2}$ Mo	A182 Gr. F5			...	...
<b>Working Pressure by Classes, psig</b>					
Temperature, °F	75	150	300	400	600
min. to 100 [Note (3)]	145	290	750	1,000	1,500
200	130	260	735	980	1,470
300	115	230	700	935	1,400
400	100	200	670	890	1,335
500	85	170	645	860	1,290
600	70	140	625	835	1,255
650	60	125	615	820	1,230
700	...	110	600	795	1,190
750	...	95	555	745	1,120
800	...	80	535	710	1,065
850	...	65	490	655	980
900	...	50	375	500	745
950	...	35	275	365	550
1,000	...	20	200	265	400
1,050	...	...	145	190	290
1,100	...	...	95	130	190
1,150	...	...	60	80	125
1,200	...	...	35	45	70
					105

## NOTES:

(1) Use normalized and tempered material only.  
 (2) Permissible, but not recommended for prolonged use above 1,100°F.  
 (3) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 16**  
**Pressure-Temperature Ratings for Group 1.18 Materials — SI Units**

Nominal Designation	Forgings			Castings		Plates
	9Cr-2W-V	A182 Gr. F92			...	...
Working Pressure by Classes, bar						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (1)]	10.0	20.0	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.9	17.7	51.5	68.7	103.0	154.6
150	7.9	15.8	50.3	66.8	100.3	150.6
200	6.9	13.8	48.6	64.8	97.2	145.8
250	6.1	12.1	46.3	61.8	92.7	139.0
300	5.1	10.2	45.0	60.0	90.0	135.0
325	4.7	9.3	43.3	57.6	86.3	129.6
350	4.2	8.4	41.9	55.8	83.6	125.5
375	...	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.4	47.3	71.1	106.5
475	...	3.7	34.4	45.9	68.8	103.2
500	...	2.8	32.1	42.9	64.4	96.6
538	...	1.4	29.0	38.5	57.5	86.5
550	...	...	28.8	38.3	57.3	86.0
575	...	...	27.8	37.1	55.6	83.3
600	...	...	25.3	33.6	50.2	75.1
625	...	...	19.4	25.8	38.7	58.1
649	...	...	13.4	17.8	26.8	40.1

NOTE: (1) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

**Table 16C**  
**Pressure-Temperature Ratings for Group 1.18 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	9Cr-2W-V	A182 Gr. F92	...	...	...	...
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (1)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,410	2,115
500	85	170	665	885	1,330	1,995
600	60	140	630	840	1,260	1,890
650	...	125	615	820	1,230	1,845
700	...	110	600	795	1,190	1,790
750	...	95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	510	685	1,030	1,540
900	...	50	475	635	955	1,430
950	...	35	425	570	855	1,275
1,000	...	20	415	550	825	1,245
1,050	...	...	410	545	820	1,230
1,100	...	...	375	500	750	1,120
1,150	...	...	285	380	570	855
1,200	...	...	180	240	365	545

NOTE: (1) See para. 2.5.3 for guidance on determining minimum temperatures.

(25)

**Table 17**  
**Pressure-Temperature Ratings for Group 2.1 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	18Cr-8Ni	A182 Gr. F304 [Note (1)]	A351 Gr. CF3 [Note (2)]	A240 Gr. 304 [Note (1)]	A240 Gr. 304H	
18Cr-8Ni	A182 Gr. F304H	A351 Gr. CF8 [Note (1)]	A240 Gr. 304H	Working Pressure by Classes, bar		
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (3)]	9.6	19.1	49.7	66.3	99.4	149.1
50	9.3	18.5	48.3	64.5	96.7	145.0
100	7.8	15.6	40.8	54.4	81.6	122.4
150	7.1	14.2	37.0	49.4	74.1	111.1
200	6.6	13.1	34.3	45.7	68.6	102.9
250	6.1	12.1	32.2	42.9	64.3	96.5
300	5.1	10.2	31.0	41.3	61.9	92.9
325	4.7	9.3	30.2	40.3	60.5	90.7
350	4.2	8.4	29.5	39.4	59.0	88.6
375	...	7.4	29.0	38.7	58.1	87.1
400	...	6.5	28.3	37.8	56.6	85.0
425	...	5.5	28.1	37.4	56.2	84.2
450	...	4.6	27.4	36.5	54.7	82.1
475	...	3.7	26.9	35.8	53.8	80.6
500	...	2.8	26.4	35.2	52.8	79.2
538	...	1.4	24.4	32.5	48.8	73.2
550	...	...	24.0	32.0	48.0	72.0
575	...	...	21.0	28.0	42.0	62.9
600	...	...	16.8	22.4	33.6	50.4
625	...	...	13.7	18.3	27.5	41.2
650	...	...	11.2	15.0	22.5	33.7
675	...	...	9.3	12.4	18.7	28.0
700	...	...	8.0	10.7	16.0	24.1
725	...	...	6.7	9.0	13.4	20.2
750	...	...	5.7	7.6	11.5	17.2
775	...	...	4.8	6.4	9.5	14.3
800	...	...	3.8	5.1	7.6	11.4
816	...	...	3.3	4.4	6.6	9.9

## NOTES:

(1) At temperatures over 538°C, use only when the carbon content is 0.04% or higher.

(2) Not to be used over 427°C.

(3) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 17C**  
**Pressure-Temperature Ratings for Group 2.1 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	18Cr-8Ni	A182 Gr. F304 [Note (1)]	A351 Gr. CF3 [Note (2)]	A240 Gr. 304 [Note (1)]	A240 Gr. 304H	
Working Pressure by Classes, psig						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (3)]	140	275	720	960	1,440	2,160
200	115	230	600	800	1,200	1,800
300	105	205	540	715	1,075	1,615
400	95	190	495	660	990	1,485
500	85	170	465	620	925	1,390
600	70	140	440	590	885	1,325
650	60	125	430	575	860	1,290
700	...	110	420	565	845	1,265
750	...	95	415	550	825	1,240
800	...	80	405	540	810	1,215
850	...	65	395	530	790	1,190
900	...	50	390	520	780	1,165
950	...	35	380	510	765	1,145
1,000	...	20	355	475	715	1,070
1,050	...	...	325	435	650	975
1,100	...	...	255	345	515	770
1,150	...	...	205	275	410	615
1,200	...	...	165	220	330	495
1,250	...	...	135	180	265	400
1,300	...	...	115	150	225	340
1,350	...	...	95	125	185	280
1,400	...	...	80	105	160	235
1,450	...	...	60	80	125	185
1,500	...	...	50	65	95	145

## NOTES:

(1) At temperatures over 1,000°F, use only when the carbon content is 0.04% or higher.

(2) Not to be used over 800°F.

(3) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 18**  
**Pressure-Temperature Ratings for Group 2.2 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	A182 Gr. F316 [Note (1)]	A182 Gr. F316H	A351 Gr. CF3M [Note (2)]	A351 Gr. CF8M [Note (1)]	A240 Gr. 316 [Note (1)]	A240 Gr. 316H
16Cr-12Ni-2Mo	A182 Gr. F317 [Note (1)]	...	...	...	A240 Gr. 317 [Note (1)]	...
18Cr-13Ni-3Mo	...	...	A351 Gr. CG8M [Note (3)]	...	...	...
Working Pressure by Classes, bar						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (4)]	9.6	19.1	49.7	66.3	99.4	149.1
50	9.3	18.5	48.3	64.5	96.7	145.0
100	8.1	16.2	42.2	56.2	84.3	126.5
150	7.4	14.7	38.4	51.2	76.8	115.2
200	6.8	13.7	35.7	47.5	71.3	107.0
250	6.0	12.1	33.4	44.5	66.7	100.1
300	5.1	10.2	31.4	41.9	62.9	94.3
325	4.6	9.3	31.0	41.3	61.9	92.9
350	3.1	8.4	30.2	40.3	60.5	90.7
375	...	7.4	29.8	39.7	59.5	89.3
400	...	6.5	29.5	39.4	59.0	88.6
425	...	5.5	29.0	38.7	58.1	87.1
450	...	4.6	28.8	38.4	57.6	86.4
475	...	3.7	28.6	38.1	57.1	85.7
500	...	2.8	28.3	37.8	56.6	85.0
538	...	1.4	26.7	35.6	53.4	80.1
550	...	...	26.6	35.5	53.2	79.8
575	...	...	25.3	33.7	50.5	75.8
600	...	...	19.9	26.5	39.7	59.6
625	...	...	15.8	21.0	31.5	47.3
650	...	...	12.7	16.9	25.3	38.0
675	...	...	10.3	13.8	20.6	31.0
700	...	...	8.3	11.1	16.7	25.0
725	...	...	7.0	9.3	13.9	20.9
750	...	...	5.8	7.8	11.7	17.5
775	...	...	4.6	6.1	9.2	13.8
800	...	...	3.6	4.8	7.1	10.7
816	...	...	3.1	4.1	6.1	9.2

## NOTES:

(1) At temperatures over 538°C, use only when the carbon content is 0.04% or higher.

(2) Not to be used over 454°C.

(3) Not to be used over 538°C.

(4) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

**Table 18C**  
**Pressure-Temperature Ratings for Group 2.2 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings	Castings	Plates			
16Cr-12Ni-2Mo	A182 Gr. F316 [Note (1)]	A351 Gr. CF3M [Note (2)]	A240 Gr. 316 [Note (1)]			
16Cr-12Ni-2Mo	A182 Gr. F316H	A351 Gr. CF8M [Note (1)]	A240 Gr. 316H			
18Cr-13Ni-3Mo	A182 Gr. F317 [Note (1)]	...	A240 Gr. 317 [Note (1)]			
19Cr-10Ni-3Mo	...	A351 Gr. CG8M [Note (3)]	...			
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (4)]	140	275	720	960	1,440	2,160
200	120	235	620	825	1,240	1,860
300	105	215	560	745	1,120	1,680
400	100	195	515	685	1,025	1,540
500	85	170	480	635	955	1,435
600	70	140	450	600	900	1,355
650	60	125	440	590	885	1,325
700	...	110	435	580	870	1,305
750	...	95	425	570	855	1,280
800	...	80	420	565	845	1,265
850	...	65	420	555	835	1,255
900	...	50	415	550	825	1,240
950	...	35	410	545	815	1,225
1,000	...	20	385	515	775	1,160
1,050	...	...	385	510	770	1,150
1,100	...	...	305	405	610	915
1,150	...	...	235	315	475	710
1,200	...	...	185	245	370	555
1,250	...	...	145	195	295	440
1,300	...	...	115	155	235	350
1,350	...	...	95	130	190	290
1,400	...	...	80	105	160	235
1,450	...	...	60	80	115	175
1,500	...	...	45	60	90	135

## NOTES:

(1) At temperatures over 1,000°F, use only when the carbon content is 0.04% or higher.  
 (2) Not to be used over 850°F.  
 (3) Not to be used over 1,000°F.  
 (4) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 19**  
**Pressure-Temperature Ratings for Group 2.3 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
18Cr-8Ni	A182 Gr. F304L [Note (1)]		...		A240 Gr. 304L [Note (1)]	
16Cr-12Ni-2Mo	A182 Gr. F316L [Note (1)]		...		A240 Gr. 316L [Note (1)]	
18Cr-13Ni-3Mo	A182 Gr. F317L [Note (1)]		...		...	
<b>Working Pressure by Classes, bar</b>						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (2)]	7.9	15.8	41.1	54.9	82.3	123.4
50	7.8	15.5	40.5	53.9	80.9	121.4
100	6.7	13.4	35.0	46.6	69.9	104.9
150	6.1	12.1	31.4	41.9	62.9	94.3
200	5.6	11.1	29.0	38.7	58.1	87.1
250	5.3	10.5	27.4	36.5	54.7	82.1
300	5.0	9.9	25.9	34.6	51.8	77.8
325	4.7	9.3	25.4	33.9	50.9	76.3
350	4.3	8.4	25.0	33.3	49.9	74.9
375	...	7.4	24.7	33.0	49.4	74.2
400	...	6.5	24.2	32.3	48.5	72.7
425	...	5.5	23.9	31.8	47.7	71.6
454	...	4.6	23.4	31.2	46.8	70.3

## NOTES:

(1) Not to be used over 454°C.  
 (2) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 19C**  
**Pressure-Temperature Ratings for Group 2.3 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
18Cr-8Ni	A182 Gr. F304L [Note (1)]		...		A240 Gr. 304L [Note (1)]	
16Cr-12Ni-2Mo	A182 Gr. F316L [Note (1)]		...		A240 Gr. 316L [Note (1)]	
18Cr-13Ni-3Mo	A182 Gr. 317L [Note (1)]		...		...	
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (2)]	115	230	600	800	1,200	1,800
200	100	195	510	680	1,020	1,535
300	85	175	455	610	910	1,370
400	80	160	420	560	840	1,260
500	75	150	395	525	785	1,180
600	70	140	370	495	745	1,115
650	60	125	365	485	730	1,095
700	...	110	360	480	720	1,080
750	...	95	355	470	705	1,060
800	...	80	345	460	690	1,035
850	...	65	340	450	675	1,015

## NOTES:

(1) Not to be used over 850°F.

(2) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 20**  
**Pressure-Temperature Ratings for Group 2.4 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	18Cr-10Ni-Ti	A182 Gr. F321 [Note (1)]	...	...	A240 Gr. 321 [Note (1)]	A240 Gr. 321H [Note (2)]
Working Pressure by Classes, bar						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (3)]	9.6	19.1	49.7	66.3	99.4	149.1
50	9.4	18.7	48.7	64.9	97.4	146.1
100	8.5	17.0	44.2	59.0	88.5	132.7
150	7.9	15.8	41.1	54.9	82.3	123.4
200	6.9	13.8	38.4	51.2	76.8	115.2
250	6.0	12.1	36.0	48.0	72.0	108.0
300	5.1	10.2	34.1	45.4	68.2	102.2
325	4.6	9.3	33.4	44.5	66.7	100.1
350	3.1	8.4	32.6	43.5	65.3	97.9
375	...	7.4	31.9	42.6	63.8	95.8
400	...	5.5	31.7	42.2	63.4	95.0
425	...	5.5	31.2	41.6	62.4	93.6
450	...	4.6	30.7	41.0	61.4	92.2
475	...	3.7	30.5	40.6	61.0	91.4
500	...	2.8	30.2	40.3	60.5	90.7
538	...	1.4	27.5	36.7	55.0	82.5
550	...	...	27.5	36.7	55.0	82.5
575	...	...	26.6	35.5	53.3	79.9
600	...	...	20.1	26.8	40.3	60.4
625	...	...	15.8	21.0	31.5	47.3
650	...	...	12.7	16.9	25.3	38.0
675	...	...	9.8	13.1	19.7	29.5
700	...	...	7.9	10.5	15.7	23.6
725	...	...	6.3	8.4	12.6	18.9
750	...	...	4.9	6.6	9.9	14.8
775	...	...	3.9	5.3	7.9	11.8
800	...	...	3.1	4.2	6.3	9.4
816	...	...	2.6	3.5	5.2	7.8

## NOTES:

(1) Not to be used over 538°C.

(2) At temperatures over 538°C, use only if the material is heat treated by heating to a minimum temperature of 1 095°C.

(3) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 20C**  
**Pressure-Temperature Ratings for Group 2.4 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	18Cr-10Ni-Ti	A182 Gr. F321 [Note (1)]	...	...	A240 Gr. 321 [Note (1)]	A240 Gr. 321H [Note (2)]
Working Pressure by Classes, psig						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (3)]	140	275	720	960	1,440	2,160
200	125	250	650	865	1,295	1,945
300	115	230	595	795	1,190	1,785
400	100	200	550	735	1,105	1,655
500	85	170	515	690	1,030	1,550
600	70	140	485	650	975	1,460
650	60	125	475	635	950	1,425
700	...	110	465	620	930	1,395
750	...	95	460	610	915	1,375
800	...	80	450	600	900	1,355
850	...	65	445	595	895	1,340
900	...	50	440	590	885	1,325
950	...	35	425	570	855	1,275
1,000	...	20	410	550	825	1,235
1,050	...	...	410	545	815	1,225
1,100	...	...	310	415	625	935
1,150	...	...	235	315	475	710
1,200	...	...	185	245	370	555
1,250	...	...	140	185	280	420
1,300	...	...	110	145	220	330
1,350	...	...	85	115	170	255
1,400	...	...	65	85	130	195
1,450	...	...	50	70	105	155
1,500	...	...	40	50	75	115

## NOTES:

(1) Not to be used over 1,000°F.  
 (2) At temperatures over 1,000°F, use only if the material is heat treated by heating to a minimum temperature of 2,000°F.  
 (3) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 21**  
**Pressure-Temperature Ratings for Group 2.5 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
18Cr-10Ni-Cb	A182 Gr. F347 [Note (1)]		...		A240 Gr. 347 [Note (1)]	
18Cr-10Ni-Cb	A182 Gr. F347H [Note (2)]		...		A240 Gr. 347H [Note (2)]	
18Cr-10Ni-Cb	A182 Gr. F348 [Note (1)]		...		A240 Gr. 348 [Note (1)]	
18Cr-10Ni-Cb	A182 Gr. F348H [Note (2)]		...		A240 Gr. 348H [Note (3)]	
<b>Working Pressure by Classes, bar</b>						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (4)]	9.6	19.1	49.7	66.3	99.4	148.1
50	9.4	18.8	49.0	65.4	98.1	147.1
100	8.7	17.3	45.3	60.3	90.5	135.8
150	7.9	15.8	42.5	56.7	85.0	127.5
200	6.9	13.8	39.8	53.0	79.5	119.3
250	6.0	12.1	37.7	50.3	75.4	113.1
300	5.1	10.2	36.0	48.0	72.0	108.0
325	4.6	9.3	35.3	47.1	70.6	105.9
350	3.1	8.4	35.0	46.6	69.9	104.9
375	...	7.4	34.1	45.4	68.2	102.2
400	...	6.5	33.8	45.1	67.7	101.5
425	...	5.5	33.6	44.8	67.2	100.8
450	...	4.6	33.4	44.5	66.7	100.1
475	...	3.7	33.4	44.5	63.7	100.1
500	...	2.8	32.1	42.9	64.4	96.6
538	...	1.4	29.0	38.5	57.5	86.5
550	...	...	28.8	38.3	57.3	86.0
575	...	...	27.8	37.1	55.6	83.3
600	...	...	25.3	33.6	50.2	74.1
625	...	...	21.5	28.7	43.0	64.5
650	...	...	16.6	22.1	33.2	50.2
675	...	...	14.2	18.9	28.4	42.6
700	...	...	10.9	14.5	21.8	32.7
725	...	...	8.2	10.9	16.4	24.6
750	...	...	6.4	8.6	12.9	19.3
775	...	...	5.0	6.7	10.0	15.0
800	...	...	3.7	4.9	7.4	11.1
816	...	...	3.1	4.1	6.1	9.2

## NOTES:

- (1) Not to be used over 538°C.
- (2) For temperatures over 538°C, use only if the material is heat treated by heating to a minimum temperature of 1093°C.
- (3) Not to be used over 425°C.
- (4) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 21C**  
**Pressure-Temperature Ratings for Group 2.5 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings	Castings	Plates			
18Cr-10Ni-Cb	A182 Gr. F347 [Note (1)]	...	A240 Gr. 347 [Note (1)]			
18Cr-10Ni-Cb	A182 Gr. F347H [Note (2)]	...	A240 Gr. 347H [Note (2)]			
18Cr-10Ni-Cb	A182 Gr. F348 [Note (1)]	...	A240 Gr. 348 [Note (1)]			
18Cr-10Ni-Cb	A182 Gr. F348H [Note (2)]	...	A240 Gr. 348H [Note (3)]			
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (4)]	140	275	720	960	1,440	2,160
200	125	255	660	885	1,325	1,985
300	115	230	615	820	1,235	1,850
400	100	200	575	770	1,150	1,730
500	85	170	540	725	1,085	1,625
600	70	140	515	690	1,030	1,550
650	60	125	505	675	1,015	1,520
700	...	110	495	660	995	1,490
750	...	95	490	655	985	1,475
800	...	80	485	650	975	1,460
850	...	65	485	645	970	1,455
900	...	50	475	635	955	1,430
950	...	35	425	570	855	1,275
1,000	...	20	415	550	825	1,245
1,050	...	...	410	545	820	1,230
1,100	...	...	375	500	750	1,120
1,150	...	...	320	425	640	960
1,200	...	...	240	320	480	725
1,250	...	...	200	270	405	605
1,300	...	...	150	200	300	455
1,350	...	...	110	145	220	330
1,400	...	...	85	115	170	255
1,450	...	...	60	80	125	185
1,500	...	...	45	55	90	135

## NOTES:

- (1) Not to be used over 1,000°F.
- (2) For temperatures over 1,000°F, use only if the material is heat treated by heating to a minimum temperature of 2,000°F.
- (3) Not to be used over 800°F.
- (4) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 22**  
**Pressure-Temperature Ratings for Group 2.6 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	23Cr-12Ni	...	...	...	A240 Gr. 309H	
Temperature, °C	Working Pressure by Classes, bar					
	75	150	300	400	600	900
min. to 38 [Note (1)]	9.6	19.1	49.7	66.3	99.4	149.1
50	9.3	18.5	48.3	64.5	96.7	145.0
100	8.2	16.4	42.9	57.1	85.7	128.6
150	7.7	15.4	40.1	53.5	80.2	120.3
200	6.9	13.8	37.7	50.3	75.4	113.1
250	6.0	12.1	36.0	48.0	72.0	108.0
300	5.1	10.2	35.0	46.6	69.9	104.9
325	4.6	9.3	34.3	45.7	68.6	102.9
350	3.1	8.4	33.8	45.1	67.7	101.5
375	...	7.4	33.4	44.5	66.7	100.1
400	...	6.5	33.1	44.2	66.2	99.4
425	...	5.5	32.6	43.5	65.3	97.9
450	...	4.6	32.2	42.9	64.3	96.5
475	...	3.7	31.7	42.2	63.4	95.0
500	...	2.8	31.2	41.6	62.4	93.6
538	...	1.4	28.1	37.5	56.2	84.3
550	...	...	27.1	36.1	54.1	81.2
575	...	...	22.4	29.8	44.7	67.1
600	...	...	16.7	22.2	33.3	50.0
625	...	...	12.4	16.6	24.9	37.3
650	...	...	9.4	12.5	18.7	28.1
675	...	...	7.2	9.6	14.5	21.7
700	...	...	5.5	7.3	10.9	16.4
725	...	...	4.3	5.7	8.6	12.9
750	...	...	3.4	4.5	6.8	10.2
775	...	...	2.7	3.6	5.3	8.0
800	...	...	2.1	2.8	4.2	6.3
816	...	...	1.8	2.3	3.5	5.3

NOTE: (1) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

**Table 22C**  
**Pressure-Temperature Ratings for Group 2.6 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	23Cr-12Ni	...	...	...	A240 Gr. 309H	
Temperature, °F	Working Pressure by Classes, psig					
	75	150	300	400	600	900
min. to 100 [Note (1)]	140	275	720	960	1,440	2,160
200	120	240	630	840	1,260	1,895
300	110	225	580	775	1,160	1,740
400	100	200	545	725	1,090	1,635
500	85	170	520	690	1,035	1,555
600	70	140	500	665	1,000	1,500
650	60	125	490	655	985	1,475
700	...	110	485	645	970	1,455
750	...	95	480	640	960	1,440
800	...	80	475	630	945	1,420
850	...	65	465	620	930	1,395
900	...	50	460	610	915	1,375
950	...	35	425	570	855	1,275
1,000	...	20	415	550	825	1,245
1,050	...	...	355	470	705	1,060
1,100	...	...	260	345	520	780
1,150	...	...	190	250	375	565
1,200	...	...	135	185	275	410
1,250	...	...	105	135	205	310
1,300	...	...	75	100	150	225
1,350	...	...	60	80	115	175
1,400	...	...	45	60	90	135
1,450	...	...	35	45	70	105
1,500	...	...	25	35	50	75

NOTE: (1) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 23**  
**Pressure-Temperature Ratings for Group 2.7 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	25Cr-20Ni	A182 Gr. F310H	...	...	A240 Gr. 310H	...
Working Pressure by Classes, bar						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (1)]	9.6	19.1	49.7	66.3	99.4	149.1
50	9.4	18.7	48.7	64.9	97.4	146.1
100	8.4	16.7	43.5	58.1	87.1	130.6
150	7.7	15.4	40.1	53.5	80.2	120.3
200	6.9	13.8	37.7	50.3	75.4	113.1
250	6.0	12.1	35.7	47.5	71.3	107.0
300	5.1	10.2	34.6	46.2	69.3	103.9
325	4.6	9.3	33.8	45.1	67.7	101.5
350	3.1	8.4	33.4	44.5	66.7	100.1
375	...	7.4	32.9	43.8	65.8	98.6
400	...	6.5	32.4	43.2	64.8	97.2
425	...	5.5	32.2	42.9	64.3	96.5
450	...	4.6	31.7	42.2	63.4	95.0
475	...	3.7	31.2	41.6	62.4	93.6
500	...	2.8	30.7	41.0	61.4	92.2
538	...	1.4	28.0	37.4	56.1	84.1
550	...	...	27.4	36.5	54.7	82.1
575	...	...	22.2	29.6	44.4	66.5
600	...	...	16.7	22.2	33.3	50.0
625	...	...	12.4	16.5	24.8	37.2
650	...	...	9.4	12.5	18.7	28.1
675	...	...	7.2	9.6	14.5	21.7
700	...	...	5.5	7.3	10.9	16.4
725	...	...	4.3	5.7	8.6	12.9
750	...	...	3.4	4.5	6.8	10.2
775	...	...	2.6	3.5	5.2	7.9
800	...	...	2.0	2.7	4.1	6.1
816	...	...	1.8	2.3	3.5	5.3

NOTE: (1) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

**Table 23C**  
**Pressure-Temperature Ratings for Group 2.7 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	25Cr-20Ni	A182 Gr. F310H	...	...	A240 Gr. 310H	
Temperature, °F	Working Pressure by Classes, psig					
	75	150	300	400	600	900
min. to 100 [Note (1)]	140	275	720	960	1,440	2,160
200	120	245	635	850	1,270	1,910
300	110	225	580	775	1,160	1,740
400	100	200	540	725	1,085	1,625
500	85	170	515	685	1,025	1,540
600	70	140	495	660	990	1,485
650	60	125	485	645	970	1,455
700	...	110	480	635	955	1,435
750	...	95	470	625	940	1,410
800	...	80	465	620	930	1,395
850	...	65	460	610	915	1,375
900	...	50	450	600	900	1,355
950	...	35	425	570	855	1,275
1,000	...	20	415	550	825	1,245
1,050	...	...	355	470	705	1,060
1,100	...	...	260	345	520	780
1,150	...	...	190	250	375	565
1,200	...	...	135	185	275	410
1,250	...	...	105	135	205	310
1,300	...	...	75	100	150	225
1,350	...	...	60	80	115	175
1,400	...	...	45	60	90	135
1,450	...	...	35	45	65	100
1,500	...	...	25	35	50	75

NOTE: (1) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 24**  
**Pressure-Temperature Ratings for Group 2.8 Materials — SI Units**

Nominal Designation	Forgings		Castings		Plates	
	A182 Gr. F44	A351 Gr. CK3MCuN	A240 Gr. S31254			
<b>Working Pressure by Classes, bar</b>						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (1)]	10.0	20.0	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.8	17.7	50.7	67.7	101.5	152.2
150	7.9	15.8	45.9	61.3	91.9	137.8
200	6.9	13.8	42.9	57.1	85.7	128.6
250	6.0	12.1	40.5	53.9	80.9	121.4
300	5.1	10.2	38.7	51.7	77.5	116.2
325	4.6	9.3	38.1	50.7	76.1	114.2
350	3.1	8.4	37.6	50.3	75.4	113.1
375	...	7.4	37.4	49.8	74.7	112.1
399	...	6.5	37.0	49.4	74.1	111.1

NOTE: (1) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 24C**  
**Pressure-Temperature Ratings for Group 2.8 Materials — U.S. Customary Units**

Nominal Designation	Forgings		Castings		Plates	
	A182 Gr. F44	A351 Gr. CK3MCuN	A240 Gr. S31254			
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (1)]	145	290	750	1,000	1,500	2,250
200	130	260	745	990	1,490	2,230
300	115	230	665	890	1,335	2,000
400	100	200	615	820	1,230	1,845
500	85	170	580	775	1,160	1,740
600	70	140	555	740	1,115	1,670
650	60	125	545	730	1,095	1,640
700	...	110	540	725	1,085	1,625
750	...	95	540	715	1,075	1,615

NOTE: (1) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

**Table 25**  
**Pressure-Temperature Ratings for Group 2.9 Materials — SI Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	23Cr-12Ni	...	...	...	A240 Gr. 309S [Notes (1)-(3)]	A240 Gr. 310S [Notes (1)-(3)]
Working Pressure by Classes, bar						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (4)]	9.5	19.1	49.7	66.3	99.4	149.1
50	9.3	18.5	48.3	64.5	96.7	145.0
100	8.3	16.4	42.9	57.1	85.7	128.6
150	7.7	15.4	40.1	53.5	80.2	120.3
200	6.9	13.8	37.7	50.3	75.4	113.1
250	6.0	12.1	35.7	47.5	71.3	107.0
300	5.1	10.2	34.6	46.2	69.3	103.9
325	4.6	9.3	33.8	45.1	67.7	101.5
350	3.1	8.4	33.4	44.5	66.7	100.1
375	...	7.4	32.9	43.8	65.8	98.6
400	...	6.5	32.4	43.2	64.8	97.2
425	...	5.5	32.2	42.9	64.3	96.5
450	...	4.6	31.7	42.2	63.4	95.0
475	...	3.7	31.2	41.6	62.4	93.6
500	...	2.8	30.7	41.0	61.4	92.2
538	...	1.4	23.3	31.1	46.7	70.0
550	...	...	20.3	27.1	40.6	60.9
575	...	...	15.2	20.2	30.3	45.5
600	...	...	10.9	14.5	21.8	32.7
625	...	...	8.1	10.8	16.3	24.4
650	...	...	5.8	7.7	11.6	17.4
675	...	...	3.7	4.9	7.3	11.0
700	...	...	2.1	2.8	4.2	6.3
725	...	...	1.3	1.8	2.6	3.9
750	...	...	1.0	1.4	2.0	3.0
775	...	...	0.8	1.1	1.6	2.5
800	...	...	0.6	0.8	1.2	1.8
816	...	...	0.5	0.6	0.9	1.4

## NOTES:

- (1) At temperatures over 538°C, use only when the carbon content is 0.04% or higher.
- (2) At temperatures above 538°C, use only if the material is solution heat treated to the minimum temperature specified in the specification, but not lower than 1040°C, and quenching in water or rapidly cooling by other means.
- (3) This material should be used for service temperatures 566°C and above only when assurance is provided that grain size is not finer than ASTM 6.
- (4) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 25C**  
**Pressure-Temperature Ratings for Group 2.9 Materials — U.S. Customary Units**

<b>Nominal Designation</b>	<b>Forgings</b>		<b>Castings</b>		<b>Plates</b>	
	23Cr-12Ni	...	...	...	A240 Gr. 309S [Notes (1)-(3)]	
25Cr-20Ni	...	...	...	...	A240 Gr. 310S [Notes (1)-(3)]	
			<b>Working Pressure by Classes, psig</b>			
<b>Temperature, °F</b>	<b>75</b>	<b>150</b>	<b>300</b>	<b>400</b>	<b>600</b>	<b>900</b>
min. to 100 [Note (4)]	140	275	720	960	1,440	2,160
200	120	240	630	840	1,260	1,895
300	110	225	580	775	1,160	1,740
400	100	200	540	725	1,085	1,625
500	85	170	515	685	1,025	1,540
600	70	140	495	660	990	1,485
650	60	125	485	645	970	1,455
700	...	110	480	635	955	1,435
750	...	95	470	625	940	1,410
800	...	80	465	620	930	1,395
850	...	65	460	610	915	1,375
900	...	50	450	600	900	1,355
950	...	35	425	570	855	1,275
1,000	...	20	340	455	680	1,020
1,050	...	...	245	325	485	730
1,100	...	...	170	230	345	515
1,150	...	...	125	165	245	370
1,200	...	...	85	115	170	255
1,250	...	...	50	70	105	155
1,300	...	...	25	35	55	80
1,350	...	...	15	25	35	50
1,400	...	...	15	20	25	40
1,450	...	...	10	15	20	30
1,500	...	...	5	10	15	20

## NOTES:

- (1) At temperatures over 1,000°F, use only when the carbon content is 0.04% or higher.
- (2) At temperatures above 1,000°F, use only if the material is solution heat treated to the minimum temperature specified in the specification, but not lower than 1,900°F, and quenching in water or rapidly cooling by other means.
- (3) This material should be used for service temperatures 1,050°F and above only when assurance is provided that grain size is not finer than ASTM 6.
- (4) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 26**  
**Pressure-Temperature Ratings for Group 2.10 Materials — SI Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
25Cr-12Ni	...		A351 Gr. CH8 [Note (1)]		...	
25Cr-12Ni	...		A351 Gr. CH20 [Note (1)]		...	
<b>Working Pressure by Classes, bar</b>						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (2)]	8.9	17.7	46.3	61.7	92.6	138.9
50	8.6	17.2	44.9	59.9	89.8	134.7
100	7.2	14.3	37.4	49.8	74.7	112.1
150	6.7	13.4	35.0	46.6	69.9	104.9
200	6.4	12.9	33.6	44.8	67.2	100.8
250	6.0	12.1	32.6	43.5	65.3	97.9
300	5.1	10.2	31.7	42.2	63.4	95.0
325	4.6	9.3	31.2	41.6	62.4	93.6
350	3.1	8.4	30.5	40.6	61.0	91.4
375	...	7.4	29.8	39.7	59.5	89.3
400	...	6.5	29.0	38.7	58.1	87.1
425	...	5.5	28.3	37.8	56.6	85.0
450	...	4.6	27.6	36.8	55.2	82.8
475	...	3.7	26.6	35.5	53.3	79.9
500	...	2.8	25.9	34.6	51.8	77.8
538	...	1.4	22.8	30.4	45.7	68.5
550	...	...	21.9	29.2	43.8	65.7
575	...	...	18.4	24.5	36.8	55.2
600	...	...	14.4	19.2	28.9	43.3
625	...	...	11.4	15.2	22.8	34.1
650	...	...	8.9	11.8	17.8	26.6
675	...	...	7.0	9.3	13.9	20.9
700	...	...	5.6	7.5	11.2	16.9
725	...	...	4.6	6.1	9.1	13.7
750	...	...	3.5	4.7	7.0	10.5
775	...	...	2.5	3.3	5.0	7.5
800	...	...	2.0	2.6	3.9	5.9
816	...	...	1.9	2.5	3.8	5.6

## NOTES:

(1) At temperatures over 538°C, use only when the carbon content is 0.04% or higher.

(2) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 26C**  
**Pressure-Temperature Ratings for Group 2.10 Materials — U.S. Customary Units**

Nominal Designation	Forgings		Castings		Plates	
	25Cr-12Ni	...	A351 Gr. CH8 [Note (1)]	A351 Gr. CH20 [Note (1)]	...	...
Working Pressure by Classes, psig						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (2)]	130	260	670	895	1,345	2,015
200	105	210	550	735	1,100	1,650
300	95	195	505	675	1,015	1,520
400	95	185	485	645	970	1,455
500	85	170	470	625	940	1,410
600	70	140	455	610	910	1,370
650	60	125	445	595	895	1,340
700	...	110	435	580	870	1,305
750	...	95	420	565	845	1,265
800	...	80	410	545	820	1,230
850	...	65	400	530	795	1,195
900	...	50	385	510	770	1,150
950	...	35	370	495	740	1,110
1,000	...	20	340	455	680	1,020
1,050	...	...	290	390	585	875
1,100	...	...	225	295	445	670
1,150	...	...	170	230	345	515
1,200	...	...	130	175	260	390
1,250	...	...	100	135	200	300
1,300	...	...	80	105	160	235
1,350	...	...	60	80	125	165
1,400	...	...	45	60	90	135
1,450	...	...	30	40	60	95
1,500	...	...	25	35	55	80

## NOTES:

(1) At temperatures over 1,000°F, use only when the carbon content is 0.04% or higher.

(2) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 27**  
**Pressure-Temperature Ratings for Group 2.11 Materials — SI Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	18Cr-10Ni-Cb	...	A351 Gr. CF8C [Note (1)]			...
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (2)]	9.6	19.1	49.7	66.3	99.4	149.1
50	9.4	18.8	49.0	65.4	98.1	147.1
100	8.7	17.3	45.3	60.3	90.5	135.8
150	7.9	15.8	42.5	56.7	85.0	127.5
200	6.9	13.8	39.8	53.0	79.5	119.3
250	6.0	12.1	37.7	50.3	75.4	113.1
300	5.1	10.2	36.0	48.0	72.0	108.0
325	4.6	9.3	35.3	47.1	70.6	105.9
350	3.1	8.4	35.0	46.6	69.9	104.9
375	...	7.4	34.1	45.4	68.2	102.2
400	...	6.5	33.8	45.1	67.7	101.5
425	...	5.5	33.6	44.8	67.2	100.8
450	...	4.6	33.4	44.5	66.7	100.1
475	...	3.7	33.4	44.5	66.7	100.1
500	...	2.8	34.1	42.9	64.4	96.6
538	...	1.4	29.0	38.5	57.5	86.5
550	...	...	28.8	38.3	57.3	86.0
575	...	...	26.5	35.3	52.9	79.4
600	...	...	19.8	26.4	39.6	59.3
625	...	...	13.7	18.2	27.4	41.0
650	...	...	10.3	13.7	20.6	30.9
675	...	...	8.0	10.6	15.9	23.9
700	...	...	5.6	7.5	11.2	16.8
725	...	...	3.8	5.3	7.7	11.5
750	...	...	3.1	4.1	6.1	9.2
775	...	...	2.4	3.3	4.9	7.3
800	...	...	2.0	2.7	4.0	5.9
816	...	...	1.9	2.5	3.8	5.6

## NOTES:

(1) At temperatures over 538°C, use only when the carbon content is 0.04% or higher.

(2) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 27C**  
**Pressure-Temperature Ratings for Group 2.11 Materials — U.S. Customary Units**

Nominal Designation	Forgings		Castings		Plates	
	18Cr-10Ni-Cb	...	A351 Gr. CF8C [Note (1)]			...
Working Pressure by Classes, psig						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (2)]	140	275	720	960	1,440	2,160
200	125	255	660	885	1,325	1,985
300	115	230	615	820	1,235	1,850
400	100	200	575	770	1,150	1,730
500	85	170	540	725	1,085	1,625
600	70	140	515	690	1,030	1,550
650	60	125	505	675	1,015	1,520
700	...	110	495	660	995	1,490
750	...	95	490	655	985	1,475
800	...	80	485	650	975	1,460
850	...	65	485	645	970	1,455
900	...	50	475	635	955	1,430
950	...	35	425	570	855	1,275
1,000	...	20	415	550	825	1,245
1,050	...	...	410	545	820	1,230
1,100	...	...	310	415	625	935
1,150	...	...	210	280	420	625
1,200	...	...	150	200	300	455
1,250	...	...	115	150	225	340
1,300	...	...	75	100	150	225
1,350	...	...	50	70	105	155
1,400	...	...	40	55	80	125
1,450	...	...	30	40	60	95
1,500	...	...	25	35	55	80

## NOTES:

(1) At temperatures over 1,000°F, use only when the carbon content is 0.04% or higher.

(2) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 28**  
**Pressure-Temperature Ratings for Group 2.12 Materials — SI Units**

(25)

Nominal Designation	Forgings		Castings		Plates	
	25Cr-20Ni	...	A351 Gr. CK20 [Note (1)]			...
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (2)]	8.9	17.7	46.3	61.7	92.6	138.9
50	8.6	17.2	44.9	59.9	89.8	134.7
100	7.2	14.3	37.4	49.8	74.7	112.1
150	6.7	13.4	35.0	46.6	69.9	104.9
200	6.4	12.9	33.6	44.8	67.2	100.8
250	6.0	12.1	32.6	43.5	65.3	97.9
300	5.1	10.2	31.7	42.2	63.4	95.0
325	4.6	9.3	31.2	41.6	62.4	93.6
350	3.1	8.4	30.5	40.6	61.0	91.4
375	...	7.4	29.8	39.7	59.5	89.3
400	...	6.5	29.0	38.7	58.1	87.1
425	...	5.5	28.3	37.8	56.6	85.0
450	...	4.6	27.6	36.8	55.2	82.8
475	...	3.7	26.6	35.5	53.3	79.9
500	...	2.8	25.9	34.6	51.8	77.8
538	...	1.4	23.4	31.2	46.8	70.1
550	...	...	23.0	30.6	45.9	68.9
575	...	...	21.7	28.9	43.3	65.0
600	...	...	19.5	26.0	38.9	58.4
625	...	...	16.8	22.4	33.7	50.5
650	...	...	14.1	18.7	28.1	42.2
675	...	...	11.5	15.4	23.0	34.6
700	...	...	8.7	11.7	17.5	26.2
725	...	...	6.3	8.4	12.5	18.8
750	...	...	4.4	5.9	8.8	13.2
775	...	...	3.1	4.1	6.1	9.2
800	...	...	2.3	3.0	4.5	6.8
816	...	...	1.9	2.5	3.8	5.6

## NOTES:

(1) At temperatures over 538°C, use only when the carbon content is 0.04% or higher.

(2) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

(25)

**Table 28C**  
**Pressure-Temperature Ratings for Group 2.12 Materials — U.S. Customary Units**

Nominal Designation	Forgings		Castings		Plates	
	25Cr-20Ni	...	A351 Gr. CK20 [Note (1)]			...
Working Pressure by Classes, psig						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (2)]	130	260	670	895	1,345	2,015
200	105	210	550	735	1,100	1,650
300	95	195	505	675	1,015	1,520
400	95	185	485	645	970	1,455
500	85	170	470	625	940	1,410
600	70	140	455	610	910	1,370
650	60	125	445	595	895	1,340
700	...	110	435	580	870	1,305
750	...	95	420	565	845	1,265
800	...	80	410	545	820	1,230
850	...	65	400	530	795	1,195
900	...	50	385	510	770	1,150
950	...	35	370	495	740	1,110
1,000	...	20	340	455	680	1,020
1,050	...	...	325	435	650	975
1,100	...	...	290	390	585	875
1,150	...	...	250	335	500	750
1,200	...	...	205	275	410	615
1,250	...	...	165	220	330	495
1,300	...	...	120	160	240	360
1,350	...	...	80	110	165	245
1,400	...	...	55	75	110	165
1,450	...	...	40	50	75	115
1,500	...	...	25	35	55	80

## NOTES

(1) At temperatures over 1,000°F, use only when the carbon content is 0.04% or higher.

(2) See para. 2.5.3 for guidance on determining minimum temperatures.

**Table 29**  
**Pressure-Temperature Ratings for Group 2.13 Materials — SI Units**

(25)

Nominal Designation	Forgings	Castings	Plates			
22Cr-5Ni-3Mo-N	A182 Gr. F51 [Note (1)]	A995 CD3MN (4A) [Note(2)]	A240 Gr. S31803 [Note (1)]			
22Cr-5Ni-3Mo-N	A182 Gr. F60 [Note (1)]	...	...			
22Cr-5Ni-3Mo-N	...	...	A240 Gr. S32205 [Note(1)]			
25Cr-5Ni-3Mo-2Cu	...	...	A240 Gr. S32550 [Note (2)]			
25Cr-7Ni-4Mo-N	A182 Gr. F53 [Note (1)]	...	A240 Gr. S32750 [Note (1)]			
24Cr-10Ni-4Mo-N	...	A995 Gr. CE8MN (2A) [Note (1)]	...			
25Cr-5Ni-3Cu-2Mo-N	...	A995 Gr. CD4MCuN (1B) [Note (1)]	...			
25Cr-7Ni-3.5Mo-W-Cb	...	A995 Gr. CD3MWCuN (6A) [Note (1)]	...			
25Cr-7Ni-3.5Mo-N-Cu-W	A182 Gr. F55 [Note (1)]	...	A240 Gr. S32760 [Note (1)]			
<b>Working Pressure by Classes, psig</b>						
Temperature, °C	75	150	300	400	600	900
min. to 38 [Note (3)]	10.0	20.0	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.9	17.7	51.5	68.7	103.0	154.6
150	7.9	15.8	50.3	67.0	100.3	150.6
200	6.9	13.8	48.6	64.8	97.2	145.8
250	6.1	12.1	46.3	61.8	92.7	139.0
300	...	10.2	45.0	60.0	90.0	135.0
316	...	9.6	43.9	58.5	87.6	131.5

## NOTES:

(1) This steel may become brittle after service at moderately elevated temperatures. Not to be used over 316°C.

(2) Not to be used over 260°C.

(3) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

**Table 29C**  
**Pressure-Temperature Ratings for Group 2.13 Materials — U.S. Customary Units**

(25)

Nominal Designation	Forgings	Castings	Plates			
22Cr-5Ni-3Mo-N	A182 Gr. F51 [Note (1)]	A995 CD3MN (4A) [Note(2)]	A240 Gr. S31803 [Note (1)]			
22Cr-5Ni-3Mo-N	A182 Gr. F60 [Note (1)]	...	...			
22Cr-5Ni-3Mo-N	...	...	A240 Gr. S32205 [Note(1)]			
25Cr-5Ni-3Mo-2Cu	...	...	A240 Gr. S32550 [Note (2)]			
25Cr-7Ni-4Mo-N	A182 Gr. F53 [Note (1)]	...	A240 Gr. S32750 [Note (1)]			
24Cr-10Ni-4Mo-N	...	A995 Gr. CE8MN (2A) [Note (1)]	...			
25Cr-5Ni-3Cu-2Mo-N	...	A995 Gr. CD4MCuN (1B) [Note (1)]	...			
25Cr-7Ni-3.5Mo-W-Cb	...	A995 Gr. CD3MWCuN (6A) [Note (1)]	...			
25Cr-7Ni-3.5Mo-N-Cu-W	A182 Gr. F55 [Note (1)]	...	A240 Gr. S32760 [Note (1)]			
<b>Working Pressure by Classes, psig</b>						
Temperature, °F	75	150	300	400	600	900
min. to 100 [Note (3)]	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,410	2,115
500	85	170	665	885	1,330	1,995
600	70	140	630	840	1,260	1,890


## NOTES:

(1) This steel may become brittle after service at moderately elevated temperatures. Not to be used over 600°F.

(2) Not to be used over 500°F.

(3) See [para. 2.5.3](#) for guidance on determining minimum temperatures.

**Table 30**  
**Dimensions of Ring-Joint Facings — SI Units**

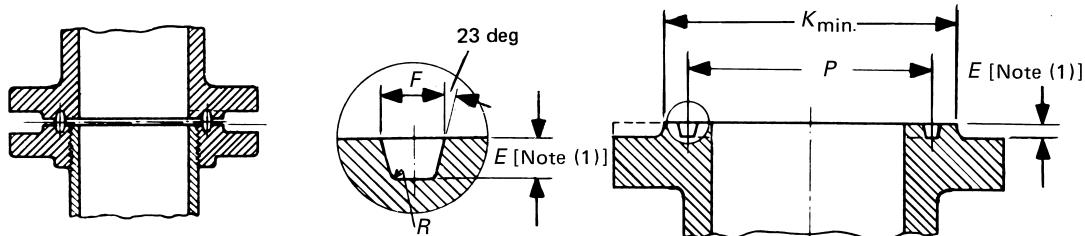

Nominal Pipe Size for Class					Groove Dimensions			
300	400	600	900	Groove Number	Pitch Diameter, $P$	Depth, $E$	Width, $F$	Radius at Bottom, $R$
26	26	26	...	R93	749.30	12.70	19.84	1.5
28	28	28	...	R94	800.10	12.70	19.84	1.5
30	30	30	...	R95	857.25	12.70	19.84	1.5
32	32	32	...	R96	914.40	14.27	23.01	1.5
34	34	34	...	R97	965.20	14.27	23.01	1.5
36	36	36	...	R98	1022.35	14.27	23.01	1.5
...	...	...	26	R100	749.30	17.48	30.18	2.3
...	...	...	28	R101	800.10	17.48	33.32	2.3
...	...	...	30	R102	857.25	17.48	33.32	2.3
...	...	...	32	R103	914.40	17.48	33.32	2.3
...	...	...	34	R104	965.20	20.62	36.53	2.3
...	...	...	36	R105	1022.35	20.62	36.53	2.3


Dimension	Tolerance
$E$ (depth)	+0.41, -0.00
$F$ (width)	$\pm 0.20$
$P$ (pitch diameter)	$\pm 0.13$
$R$ (radius at bottom)	+0.8, -0.0 for $R \leq 1.5$ $\pm 0.8$ for $R > 1.5$
23 deg angle	$\pm \frac{1}{2}$ deg

## GENERAL NOTES:

- (a) Dimensions are in millimeters.
- (b) Ring-joint gaskets are not contemplated for NPS 38 and larger flanges.
- (c) For facing requirements for flanges, see para. 6.1.
- (d) See para. 4.2 for marking requirements.

NOTE: (1) Height of raised portion is equal to the depth of groove dimension  $E$ , but is not subjected to the tolerances for  $E$ . Full face contour may be used.

**Table 30C**  
**Dimensions of Ring-Joint Facings — U.S. Customary Units**

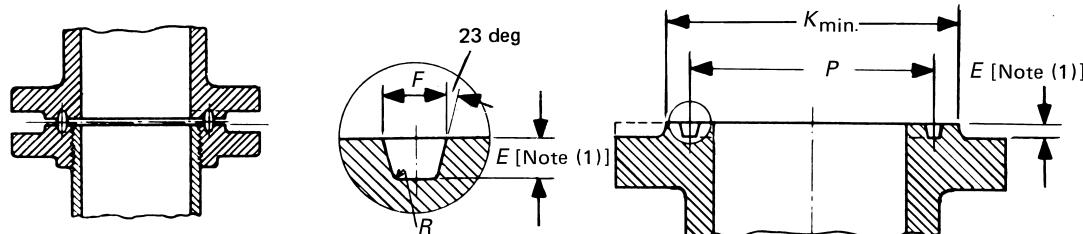

Nominal Pipe Size for Class				Groove Number	Groove Dimensions			Diameter of Raised Portion, K
300	400	600	900		Pitch Diameter, P	Depth, E	Width, F	
26	26	26	...	R93	29.500	0.500	0.781	0.06
28	28	28	...	R94	31.500	0.500	0.781	0.06
30	30	30	...	R95	33.750	0.500	0.781	0.06
32	32	32	...	R96	36.000	0.562	0.906	0.06
34	34	34	...	R97	38.000	0.562	0.906	0.06
36	36	36	...	R98	40.250	0.562	0.906	0.06
...	...	...	26	R100	29.500	0.688	1.188	0.09
...	...	...	28	R101	31.500	0.688	1.312	0.09
...	...	...	30	R102	33.750	0.688	1.312	0.09
...	...	...	32	R103	36.000	0.688	1.312	0.09
...	...	...	34	R104	38.000	0.812	1.438	0.09
...	...	...	36	R105	40.250	0.812	1.438	0.09

Dimension	Tolerance
E (depth)	+0.016, -0.0
F (width)	±0.008
P (pitch diameter)	±0.005
R (radius at bottom)	+0.03, -0.0 for $R \leq 0.06$ ±0.03 for $R > 0.09$
23 deg angle	± $\frac{1}{2}$ deg

## GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) Ring-joint gaskets are not contemplated for NPS 38 and larger flanges.
- (c) For facing requirements for flanges, see [para 6.1](#).
- (d) See [para. 4.2](#) for marking requirements.

NOTE: (1) Height of raised portion is equal to the depth of groove dimension E, but is not subjected to the tolerances for E. Full face contour may be used.

**Table 31**  
**Permissible Imperfections in Flange Facing Finish — SI Units**

Nominal Pipe Size	Maximum Radial Projection of Imperfections That Are No Deeper Than Bottom of Serration, mm	Maximum Depth or Maximum Radial Projection of Imperfections That Are Deeper Than Bottom of Serration, mm
26-36	12.7	6.4
38-48	14.2	7.1
50-60	15.7	7.9

GENERAL NOTE: See [para. 6.1.5](#).


**Table 31C**  
**Permissible Imperfections in Flange Facing Finish — U.S. Customary Units**

Nominal Pipe Size	Maximum Radial Projection of Imperfections That Are No Deeper Than Bottom of Serration, in.	Maximum Depth or Maximum Radial Projection of Imperfections That Are Deeper Than Bottom of Serration, in.
26-36	0.50	0.25
38-48	0.56	0.28
50-60	0.62	0.31

GENERAL NOTE: See [para. 6.1.5](#).

**Table 32**  
**Dimensions of Class 150 Series A Flanges — SI Units**

(25)

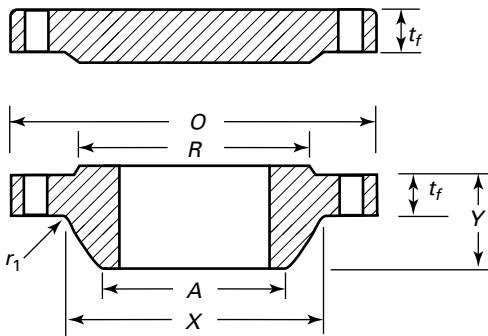

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling				Length of Bolts, $L$ [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$			Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, $r_1$	
26	870	66.8	66.8	119	676	660.4	749	806.4	24	1 $\frac{3}{8}$	1 $\frac{1}{4}$	10	225
28	927	69.8	69.8	124	727	711.2	800	863.6	28	1 $\frac{3}{8}$	1 $\frac{1}{4}$	11	230
30	984	73.2	73.2	135	781	762.0	857	914.4	28	1 $\frac{3}{8}$	1 $\frac{1}{4}$	11	235
32	1060	79.5	79.5	143	832	812.8	914	977.9	28	1 $\frac{5}{8}$	1 $\frac{1}{2}$	11	265
34	1111	81.0	81.0	148	883	863.6	965	1028.7	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	13	270
36	1168	88.9	88.9	156	933	914.4	1022	1085.8	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	13	285
38	1238	85.9	85.9	156	991	965.2	1073	1149.4	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	13	280
40	1289	88.9	88.9	162	1041	1016.0	1124	1200.2	36	1 $\frac{5}{8}$	1 $\frac{1}{2}$	13	285
42	1346	95.2	95.2	170	1092	1066.8	1194	1257.3	36	1 $\frac{5}{8}$	1 $\frac{1}{2}$	13	300
44	1403	100.1	100.1	176	1143	1117.6	1245	1314.4	40	1 $\frac{5}{8}$	1 $\frac{1}{2}$	13	305
46	1454	101.6	101.6	184	1197	1168.4	1295	1365.2	40	1 $\frac{5}{8}$	1 $\frac{1}{2}$	13	310
48	1511	106.4	106.4	191	1248	1219.2	1359	1422.4	44	1 $\frac{5}{8}$	1 $\frac{1}{2}$	13	320
50	1568	109.7	109.7	202	1302	1270.0	1410	1479.6	44	1 $\frac{7}{8}$	1 $\frac{3}{4}$	13	340
52	1626	114.3	114.3	208	1353	1320.8	1461	1536.7	44	1 $\frac{7}{8}$	1 $\frac{3}{4}$	13	350
54	1683	119.1	119.1	214	1403	1371.6	1511	1593.8	44	1 $\frac{7}{8}$	1 $\frac{3}{4}$	13	360

**Table 32**  
**Dimensions of Class 150 Series A Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]		Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling					Length of Bolts, <i>L</i> [Notes (4), (5)]	
		Weld Neck Flange	Blind Flange				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, <i>r<sub>1</sub></i>	
56	1746	122.4	122.4	227	1457	1422.4	1575	1651.0	48	1 $\frac{7}{8}$	1 $\frac{3}{4}$	13	365
58	1803	127.0	127.0	233	1508	1473.2	1626	1708.2	48	1 $\frac{7}{8}$	1 $\frac{3}{4}$	13	380
60	1854	130.3	130.3	238	1559	1524.0	1676	1759.0	52	1 $\frac{7}{8}$	1 $\frac{3}{4}$	13	380

GENERAL NOTES:


- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the inside diameter of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 32C**  
**Dimensions of Class 150 Series A Flanges — U.S. Customary Units**

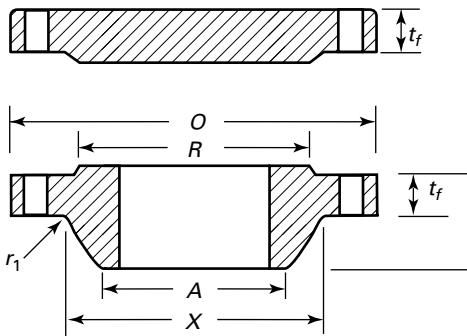

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling						Length of Bolts, $L$ [Notes (4), (5)]
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$			Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$	Raised Face 0.06 in.
26	34.25	2.63	2.63	4.69	26.62	26.00	29.50	31.75	24	1 $\frac{3}{8}$	1 $\frac{1}{4}$	0.38	8.75
28	36.50	2.75	2.75	4.88	28.62	28.00	31.50	34.00	28	1 $\frac{3}{8}$	1 $\frac{1}{4}$	0.44	9.00
30	38.75	2.88	2.88	5.32	30.75	30.00	33.75	36.00	28	1 $\frac{3}{8}$	1 $\frac{1}{4}$	0.44	9.25
32	41.75	3.13	3.13	5.63	32.75	32.00	36.00	38.50	28	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.44	10.50
34	43.75	3.19	3.19	5.82	34.75	34.00	38.00	40.50	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.50	10.50
36	46.00	3.50	3.50	6.13	36.75	36.00	40.25	42.75	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.50	11.25
38	48.75	3.38	3.38	6.13	39.00	38.00	42.25	45.25	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.50	11.00
40	50.75	3.50	3.50	6.38	41.00	40.00	44.25	47.25	36	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.50	11.25
42	53.00	3.75	3.75	6.69	43.00	42.00	47.00	49.50	36	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.50	11.75
44	55.25	3.94	3.94	6.94	45.00	44.00	49.00	51.75	40	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.50	12.00
46	57.25	4.00	4.00	7.25	47.12	46.00	51.00	53.75	40	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.50	12.25
48	59.50	4.19	4.19	7.50	49.12	48.00	53.50	56.00	44	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.50	12.50
50	61.75	4.32	4.32	7.94	51.25	50.00	55.50	58.25	44	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.50	13.50
52	64.00	4.50	4.50	8.19	53.25	52.00	57.50	60.50	44	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.50	13.75
54	66.25	4.69	4.69	8.44	55.25	54.00	59.50	62.75	44	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.50	14.00

**Table 32C**  
**Dimensions of Class 150 Series A Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]		Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling				Minimum Fillet Radius, <i>r<sub>1</sub></i>	Length of Bolts, <i>L</i> [Notes (4), (5)]	Stud Bolts
		Weld Neck Flange	Blind Flange				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt		
56	68.75	4.82	4.82	8.94	57.38	56.00	62.00	65.00	48	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.50	14.50
58	71.00	5.00	5.00	9.19	59.38	58.00	64.00	67.25	48	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.50	14.75
60	73.00	5.13	5.13	9.38	61.38	60.00	66.00	69.25	52	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.50	15.00

GENERAL NOTES:


- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 33**  
**Dimensions of Class 300 Series A Flanges — SI Units**

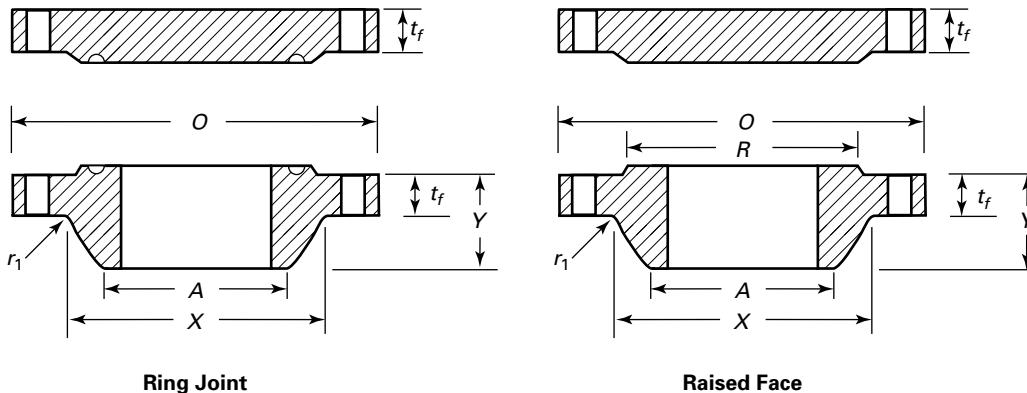

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Hub Diam. Top, $A$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$ [Note (2)]			Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, $r_1$	Stud Bolts	Raised Face 1.6 mm
26	972	78.0	82.6	183	721	660.4	749	876.3	28	1 $\frac{3}{4}$	1 $\frac{5}{8}$	10	270	290
28	1035	84.3	88.9	195	775	711.2	800	939.8	28	1 $\frac{3}{4}$	1 $\frac{5}{8}$	11	280	300
30	1092	90.7	93.7	208	827	762.0	857	997.0	28	1 $\frac{7}{8}$	1 $\frac{3}{4}$	11	300	320
32	1149	97.0	98.6	221	881	812.8	914	1054.1	28	2	1 $\frac{7}{8}$	11	320	345
34	1206	100.1	103.4	230	937	863.6	965	1104.9	28	2	1 $\frac{7}{8}$	13	330	350
36	1270	103.4	109.7	240	991	914.4	1022	1168.4	32	2 $\frac{1}{8}$	2	13	340	365
38	1168	106.4	106.4	179	994	965.2	1029	1092.2	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	13	320	...
40	1238	112.8	112.8	192	1048	1016.0	1086	1155.7	32	1 $\frac{3}{4}$	1 $\frac{5}{8}$	13	340	...
42	1289	117.6	117.6	199	1099	1066.8	1137	1206.5	32	1 $\frac{3}{4}$	1 $\frac{5}{8}$	13	350	...
44	1353	122.4	122.4	205	1149	1117.6	1194	1263.6	32	1 $\frac{7}{8}$	1 $\frac{3}{4}$	13	365	...
46	1416	127.0	127.0	214	1203	1168.4	1245	1320.8	28	2	1 $\frac{7}{8}$	13	380	...
48	1467	131.8	131.8	222	1254	1219.2	1302	1371.6	32	2	1 $\frac{7}{8}$	13	390	...
50	1530	138.2	138.2	230	1305	1270.0	1359	1428.8	32	2 $\frac{1}{8}$	2	13	410	...
52	1581	143.0	143.0	237	1356	1320.8	1410	1479.6	32	2 $\frac{1}{8}$	2	13	420	...
54	1657	150.9	150.9	251	1410	1371.6	1467	1549.4	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	13	450	...

**Table 33**  
**Dimensions of Class 300 Series A Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]			Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling				Length of Bolts, <i>L</i> [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Hub Diam. Top, <i>A</i> [Note (3)]				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, <i>r<sub>1</sub></i>	Raised Face 1.6 mm
56	1708	152.4	152.4	259	1464	1422.4	1518	1600.2	28	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	13	450	...
58	1759	157.2	157.2	265	1514	1473.2	1575	1651.0	32	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	13	465	...
60	1810	160.1	160.1	272	1565	1524.0	1626	1701.8	32	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	13	475	...

GENERAL NOTES:


- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 33C**  
**Dimensions of Class 300 Series A Flanges — U.S. Customary Units**

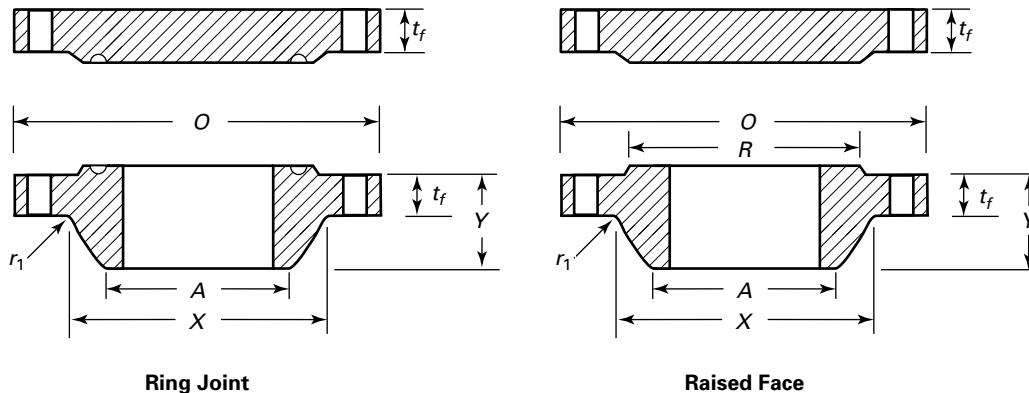

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]				Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]				
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]		Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$	Stud Bolts			
26	38.25	3.07	3.25	7.19	28.38	26.00	29.50	34.50	28	1 $\frac{3}{4}$	1 $\frac{5}{8}$	0.38	10.50	11.50		
28	40.75	3.32	3.50	7.69	30.50	28.00	31.50	37.00	28	1 $\frac{3}{4}$	1 $\frac{5}{8}$	0.44	11.00	12.00		
30	43.00	3.57	3.69	8.19	32.56	30.00	33.75	39.25	28	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.44	11.75	12.75		
32	45.25	3.82	3.88	8.69	34.69	32.00	36.00	41.50	28	2	1 $\frac{7}{8}$	0.44	12.75	13.75		
34	47.50	3.94	4.07	9.07	36.88	34.00	38.00	43.50	28	2	1 $\frac{7}{8}$	0.50	13.00	13.75		
36	50.00	4.07	4.32	9.44	39.00	36.00	40.25	46.00	32	2 $\frac{1}{8}$	2	0.50	13.50	14.25		
38	46.00	4.19	4.19	7.06	39.12	38.00	40.50	43.00	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.50	12.50	...		
40	48.75	4.44	4.44	7.56	41.25	40.00	42.75	45.50	32	1 $\frac{3}{4}$	1 $\frac{5}{8}$	0.50	13.25	...		
42	50.75	4.63	4.63	7.82	43.25	42.00	44.75	47.50	32	1 $\frac{3}{4}$	1 $\frac{5}{8}$	0.50	13.75	...		
44	53.25	4.82	4.82	8.06	45.25	44.00	47.00	49.75	32	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.50	14.50	...		
46	55.75	5.00	5.00	8.44	47.38	46.00	49.00	52.00	28	2	1 $\frac{7}{8}$	0.50	15.00	...		
48	57.75	5.19	5.19	8.75	49.38	48.00	51.25	54.00	32	2	1 $\frac{7}{8}$	0.50	15.50	...		
50	60.25	5.44	5.44	9.07	51.38	50.00	53.50	56.25	32	2 $\frac{1}{8}$	2	0.50	16.00	...		
52	62.25	5.63	5.63	9.32	53.38	52.00	55.50	58.25	32	2 $\frac{1}{8}$	2	0.50	16.50	...		
54	65.25	5.94	5.94	9.88	55.50	54.00	57.75	61.00	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.50	17.50	...		

**Table 33C**  
**Dimensions of Class 300 Series A Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]			Drilling										Length of Bolts, <i>L</i> [Notes (4), (5)]	
		Weld Neck Flange	Blind Flange	Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Diam. Top, <i>A</i> [Note (3)]	Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, <i>r<sub>1</sub></i>	Raised Face 0.06 in.	Ring Joint	Stud Bolts	Stud Bolts
56	67.25	6.00	6.00	10.19	57.62	56.00	59.75	63.00	28	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	0.50	17.75	...	...	
58	69.25	6.19	6.19	10.44	59.62	58.00	62.00	65.00	32	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	0.50	18.25	...	...	
60	71.25	6.38	6.38	10.69	61.62	60.00	64.00	67.00	32	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	0.50	18.75	...	...	

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3


Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 34**  
**Dimensions of Class 400 Series A Flanges — SI Units**

(25)

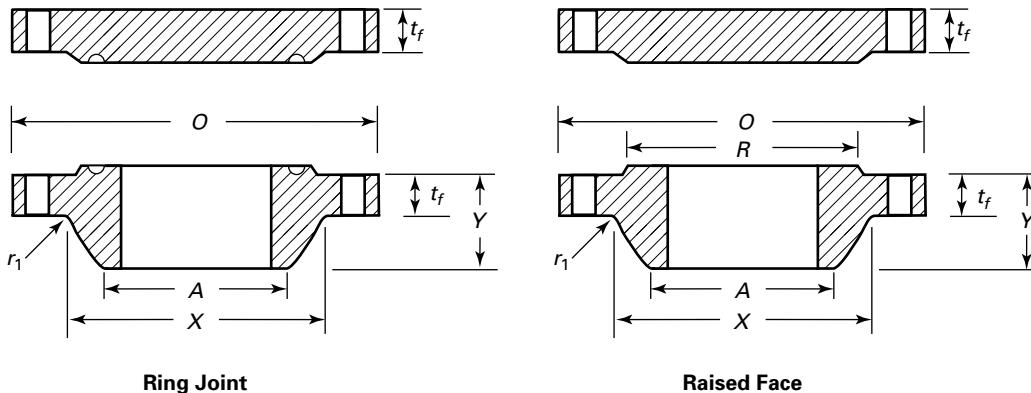

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, $r_1$	Raised Face 6.4 mm	Ring Joint
26	972	88.9	98.6	194	727	660.4	749	876.3	28	1 $\frac{7}{8}$	1 $\frac{3}{4}$	11	310	320	
28	1035	95.2	104.6	206	783	711.2	800	939.8	28	2	1 $\frac{7}{8}$	13	330	340	
30	1092	101.6	111.3	219	837	762.0	857	997.0	28	2 $\frac{1}{8}$	2	13	345	360	
32	1149	108.0	115.8	232	889	812.8	914	1054.1	28	2 $\frac{1}{8}$	2	13	360	375	
34	1206	111.3	122.2	241	945	863.6	965	1104.9	28	2 $\frac{1}{8}$	2	14	365	380	
36	1270	114.3	128.5	251	1000	914.4	1022	1168.4	32	2 $\frac{1}{8}$	2	14	375	385	
38	1206	124.0	124.0	206	1003	965.2	1035	1117.6	32	1 $\frac{7}{8}$	1 $\frac{3}{4}$	14	380	...	
40	1270	130.0	130.0	216	1054	1016.0	1092	1174.8	32	2	1 $\frac{7}{8}$	14	405	...	
42	1321	133.4	133.4	224	1108	1066.8	1143	1225.6	32	2	1 $\frac{7}{8}$	14	405	...	
44	1384	139.7	139.7	233	1159	1117.6	1200	1282.7	32	2 $\frac{1}{8}$	2	14	425	...	
46	1441	146.0	146.0	244	1213	1168.4	1257	1339.8	36	2 $\frac{1}{8}$	2	14	435	...	
48	1511	152.4	152.4	257	1267	1219.2	1308	1403.4	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	14	460	...	
50	1568	157.2	158.8	268	1321	1270.0	1362	1460.5	32	2 $\frac{3}{8}$	2 $\frac{1}{4}$	14	470	...	
52	1619	162.1	163.6	276	1372	1320.8	1413	1511.3	32	2 $\frac{3}{8}$	2 $\frac{1}{4}$	14	480	...	
54	1702	169.9	171.4	289	1425	1371.6	1470	1581.2	28	2 $\frac{5}{8}$	2 $\frac{1}{2}$	14	510	...	

**Table 34**  
**Dimensions of Class 400 Series A Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]			Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling				Length of Bolts, <i>L</i> [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Hub Diam. Top, <i>A</i> [Note (3)]				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, <i>r<sub>1</sub></i>	Raised Face 6.4 mm
56	1753	174.8	176.3	298	1480	1422.4	1527	1632.0	32	2 <sup>5</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>2</sub>	14	520	...
58	1803	177.8	180.8	306	1530	1473.2	1578	1682.8	32	2 <sup>5</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>2</sub>	14	530	...
60	1886	185.7	189.0	319	1584	1524.0	1635	1752.6	32	2 <sup>7</sup> / <sub>8</sub>	2 <sup>3</sup> / <sub>4</sub>	14	560	...

GENERAL NOTES:


- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 34C**  
**Dimensions of Class 400 Series A Flanges — U.S. Customary Units**

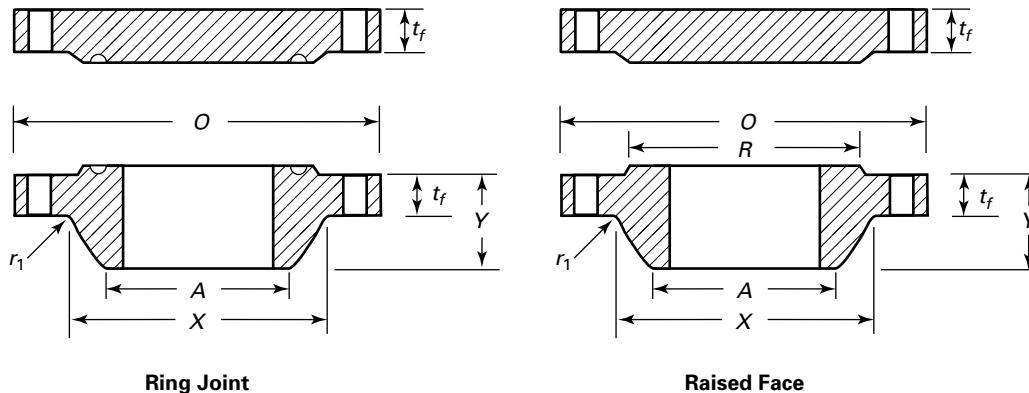

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]				Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]			
							Stud Bolts								
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]		Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$	Raised Face 0.25 in.	Ring Joint	
26	38.25	3.50	3.88	7.62	28.62	26.00	29.50	34.50	28	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.44	12.00	12.50	
28	40.75	3.75	4.12	8.12	30.81	28.00	31.50	37.00	28	2	1 $\frac{7}{8}$	0.50	13.00	13.50	
30	43.00	4.00	4.38	8.62	32.94	30.00	33.75	39.25	28	2 $\frac{1}{8}$	2	0.50	13.50	14.00	
32	45.25	4.25	4.56	9.12	35.00	32.00	36.00	41.50	28	2 $\frac{1}{8}$	2	0.50	14.00	14.75	
34	47.50	4.38	4.81	9.50	37.19	34.00	38.00	43.50	28	2 $\frac{1}{8}$	2	0.56	14.50	15.00	
36	50.00	4.50	5.06	9.88	39.38	36.00	40.25	46.00	32	2 $\frac{1}{8}$	2	0.56	14.50	15.25	
38	47.50	4.88	4.88	8.12	39.50	38.00	40.75	44.00	32	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.56	15.00	...	
40	50.00	5.12	5.12	8.50	41.50	40.00	43.00	46.25	32	2	1 $\frac{7}{8}$	0.56	15.50	...	
42	52.00	5.25	5.25	8.81	43.62	42.00	45.00	48.25	32	2	1 $\frac{7}{8}$	0.56	16.00	...	
44	54.50	5.50	5.50	9.18	45.62	44.00	47.25	50.50	32	2 $\frac{1}{8}$	2	0.56	16.50	...	
46	56.75	5.75	5.75	9.62	47.75	46.00	49.50	52.75	36	2 $\frac{1}{8}$	2	0.56	17.00	...	
48	59.50	6.00	6.00	10.12	49.88	48.00	51.50	55.25	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.56	18.00	...	
50	61.75	6.19	6.25	10.56	52.00	50.00	53.62	57.50	32	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.56	18.50	...	
52	63.75	6.38	6.44	10.88	54.00	52.00	55.62	59.50	32	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.56	19.00	...	
54	67.00	6.69	6.75	11.38	56.12	54.00	57.88	62.25	28	2 $\frac{5}{8}$	2 $\frac{1}{2}$	0.56	20.00	...	

**Table 34C**  
**Dimensions of Class 400 Series A Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]			Drilling										Length of Bolts, <i>L</i> [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, <i>r<sub>1</sub></i>	Raised Face 0.25 in.	Stud Bolts	Ring Joint		
56	69.00	6.88	6.94	11.75	58.25	56.00	60.12	64.25	32	2 <sup>5</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>2</sub>	0.56	20.50	...			
58	71.00	7.00	7.12	12.06	60.25	58.00	62.12	66.25	32	2 <sup>5</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>2</sub>	0.56	20.75	...			
60	74.25	7.31	7.44	12.56	62.38	60.00	64.38	69.00	32	2 <sup>7</sup> / <sub>8</sub>	2 <sup>3</sup> / <sub>4</sub>	0.56	21.75	...			

GENERAL NOTES:


- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 35**  
**Dimensions of Class 600 Series A Flanges — SI Units**

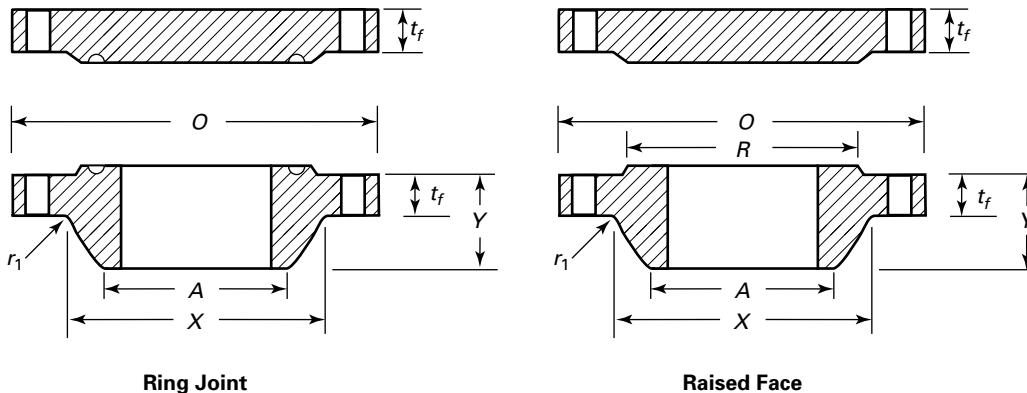

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]				Hub Diam. Top, <i>A</i> [Note (3)]	Raised Face Diam., <i>R</i>	Drilling				Length of Bolts, <i>L</i> [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Length Through Hub, <i>Y</i> [Note (2)]	Diam. of Hub, <i>X</i> [Note (2)]			Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, <i>r<sub>1</sub></i>	Stud Bolts	
												Raised Face 6.4 mm	Ring Joint	
26	1016	108.0	125.5	222	748	660.4	749	914.4	28	2	1 $\frac{7}{8}$	13	355	365
28	1073	111.3	131.8	235	803	711.2	800	965.2	28	2 $\frac{1}{8}$	2	13	365	375
30	1130	114.3	139.7	248	862	762.0	857	1022.4	28	2 $\frac{1}{8}$	2	13	375	385
32	1194	117.3	147.6	260	917	812.8	914	1079.5	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	13	390	405
34	1245	120.6	153.9	270	973	863.6	965	1130.3	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	14	400	410
36	1314	124.0	162.1	282	1032	914.4	1022	1193.8	28	2 $\frac{5}{8}$	2 $\frac{1}{2}$	14	415	430
38	1270	152.4	155.4	254	1022	965.2	1054	1162.0	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	14	465	...
40	1321	158.8	162.1	264	1073	1016.0	1111	1212.8	32	2 $\frac{5}{8}$	2 $\frac{1}{4}$	14	480	...
42	1403	168.1	171.4	279	1127	1066.8	1168	1282.7	28	2 $\frac{5}{8}$	2 $\frac{1}{2}$	14	510	...
44	1454	173.0	177.8	289	1181	1117.6	1226	1333.5	32	2 $\frac{5}{8}$	2 $\frac{1}{2}$	14	520	...
46	1511	179.3	185.7	300	1235	1168.4	1276	1390.6	32	2 $\frac{5}{8}$	2 $\frac{1}{2}$	14	530	...
48	1594	189.0	195.3	316	1289	1219.2	1334	1460.5	32	2 $\frac{7}{8}$	2 $\frac{3}{4}$	14	565	...
50	1670	196.8	203.2	329	1343	1270.0	1384	1524.0	28	3 $\frac{1}{8}$	3	14	595	...
52	1721	203.2	209.6	337	1394	1320.8	1435	1574.8	32	3 $\frac{1}{8}$	3	14	605	...
54	1778	209.6	217.4	349	1448	1371.6	1492	1632.0	32	3 $\frac{1}{8}$	3	14	620	...

**Table 35**  
**Dimensions of Class 600 Series A Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]			Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling				Length of Bolts, <i>L</i> [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Hub Diam. Top, <i>A</i> [Note (3)]				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, <i>r<sub>1</sub></i>	Raised Face 6.4 mm
56	1854	217.4	225.6	362	1502	1422.4	1543	1695.4	32	3 <sup>3</sup> / <sub>8</sub>	3 <sup>1</sup> / <sub>4</sub>	16	645	...
58	1905	222.2	231.6	370	1553	1473.2	1600	1746.2	32	3 <sup>3</sup> / <sub>8</sub>	3 <sup>1</sup> / <sub>4</sub>	16	655	...
60	1994	233.4	242.8	389	1610	1524.0	1657	1822.4	28	3 <sup>5</sup> / <sub>8</sub>	3 <sup>1</sup> / <sub>2</sub>	17	690	...

GENERAL NOTES:


- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 35C**  
**Dimensions of Class 600 Series A Flanges — U.S. Customary Units**

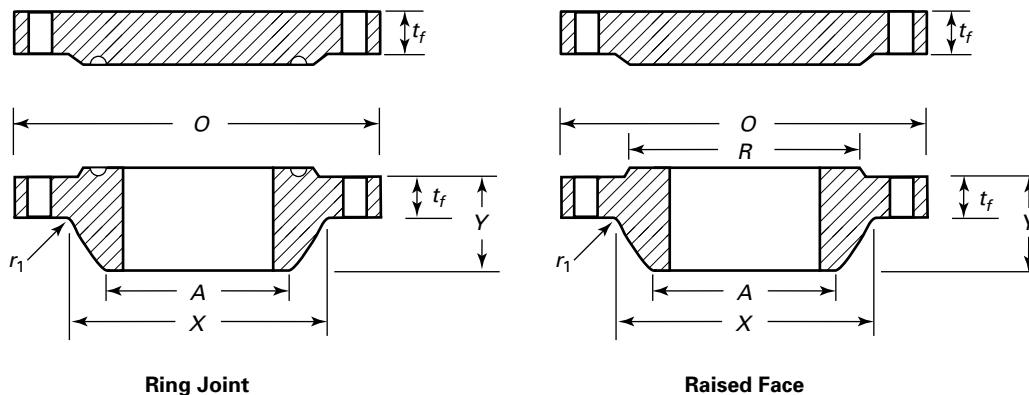

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Drilling								Length of Bolts, $L$ [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$	Raised Face 0.25 in.	Ring Joint	
26	40.00	4.25	4.94	8.75	29.44	26.00	29.50	36.00	28	2	1 $\frac{7}{8}$	0.50	14.00	14.25	
28	42.25	4.38	5.19	9.25	31.62	28.00	31.50	38.00	28	2 $\frac{1}{8}$	2	0.50	14.50	15.00	
30	44.50	4.50	5.50	9.75	33.94	30.00	33.75	40.25	28	2 $\frac{1}{8}$	2	0.50	14.50	15.00	
32	47.00	4.62	5.81	10.25	36.12	32.00	36.00	42.50	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.50	15.25	16.00	
34	49.00	4.75	6.06	10.62	38.31	34.00	38.00	44.50	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.56	15.50	16.25	
36	51.75	4.88	6.38	11.12	40.62	36.00	40.25	47.00	28	2 $\frac{5}{8}$	2 $\frac{1}{2}$	0.56	16.50	17.00	
38	50.00	6.00	6.12	10.00	40.25	38.00	41.50	45.75	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.56	18.25	...	
40	52.00	6.25	6.38	10.38	42.25	40.00	43.75	47.75	32	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.56	18.75	...	
42	55.25	6.62	6.75	11.00	44.38	42.00	46.00	50.50	28	2 $\frac{5}{8}$	2 $\frac{1}{2}$	0.56	20.00	...	
44	57.25	6.81	7.00	11.38	46.50	44.00	48.25	52.50	32	2 $\frac{5}{8}$	2 $\frac{1}{2}$	0.56	20.25	...	
46	59.50	7.06	7.31	11.81	48.62	46.00	50.25	54.75	32	2 $\frac{5}{8}$	2 $\frac{1}{2}$	0.56	20.75	...	
48	62.75	7.44	7.69	12.44	50.75	48.00	52.50	57.50	32	2 $\frac{7}{8}$	2 $\frac{3}{4}$	0.56	22.00	...	
50	65.75	7.75	8.00	12.94	52.88	50.00	54.50	60.00	28	3 $\frac{1}{8}$	3	0.56	23.25	...	
52	67.75	8.00	8.25	13.25	54.88	52.00	56.50	62.00	32	3 $\frac{1}{8}$	3	0.56	23.75	...	
54	70.00	8.25	8.56	13.75	57.00	54.00	58.75	64.25	32	3 $\frac{1}{8}$	3	0.56	24.25	...	

**Table 35C**  
**Dimensions of Class 600 Series A Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]		Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling		Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Length of Bolts, <i>L</i> [Notes (4), (5)]	
		Weld Neck Flange	Blind Flange				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle					Stud Bolts	Ring Joint
56	73.00	8.56	8.88	14.25	59.12	56.00	60.75	66.75	32	3 <sup>3</sup> / <sub>8</sub>	3 <sup>1</sup> / <sub>4</sub>	0.62	25.50	...
58	75.00	8.75	9.12	14.56	61.12	58.00	63.00	68.75	32	3 <sup>3</sup> / <sub>8</sub>	3 <sup>1</sup> / <sub>4</sub>	0.62	25.75	...
60	78.50	9.19	9.56	15.31	63.38	60.00	65.25	71.75	28	3 <sup>5</sup> / <sub>8</sub>	3 <sup>1</sup> / <sub>2</sub>	0.69	27.25	...

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3


Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 36**  
**Dimensions of Class 900 Series A Flanges — SI Units**

(25)

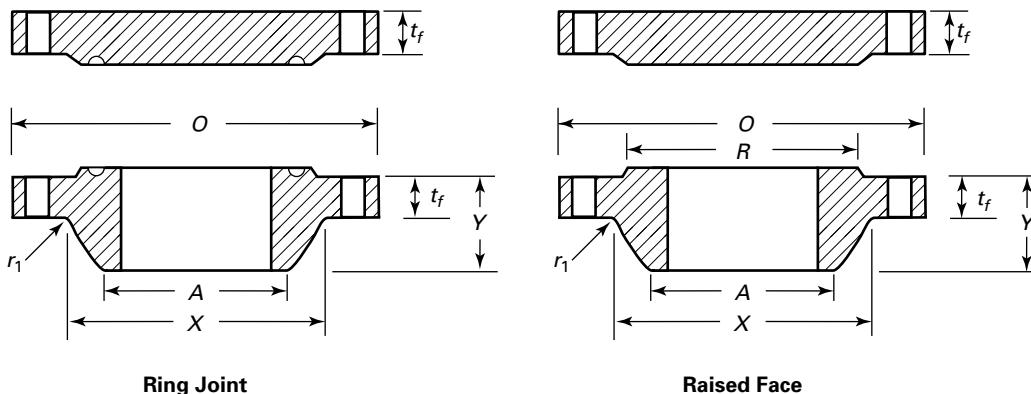

**Table 36**  
**Dimensions of Class 900 Series A Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling				Length of Bolts, $L$ [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Raised Face Diam., $R$				Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, $r_1$	Raised Face 6.4 mm	Stud Bolts
56	...	...	...	...	...	...	...	...	...	...	...	...	...	
58	...	...	...	...	...	...	...	...	...	...	...	...	...	
60	...	...	...	...	...	...	...	...	...	...	...	...	...	

GENERAL NOTES:

- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

86


Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 36C**  
**Dimensions of Class 900 Series A Flanges — U.S. Customary Units**

(25)

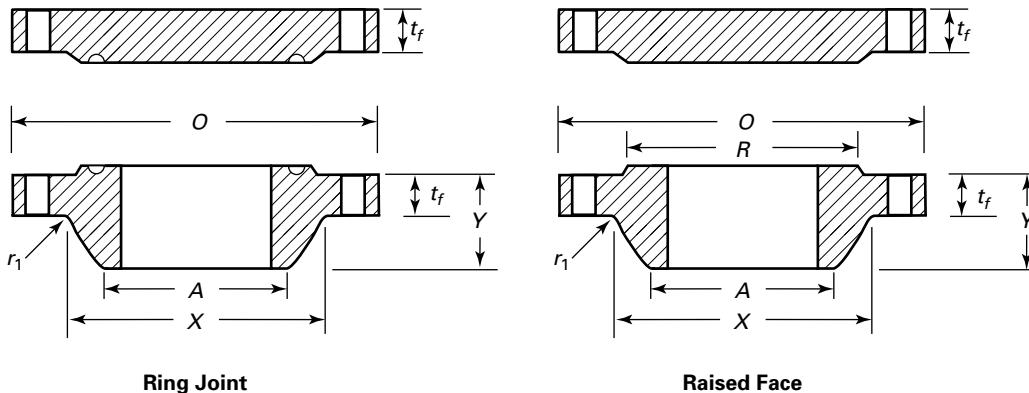

**Table 36C**  
**Dimensions of Class 900 Series A Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]			Drilling										Length of Bolts, <i>L</i> [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange	Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, <i>r<sub>1</sub></i>	Raised Face 0.25 in.	Stud Bolts	Ring Joint		
56	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...		
58	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...		
60	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...		

GENERAL NOTES:


- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 37**  
**Dimensions of Class 75 Series B Flanges — SI Units**

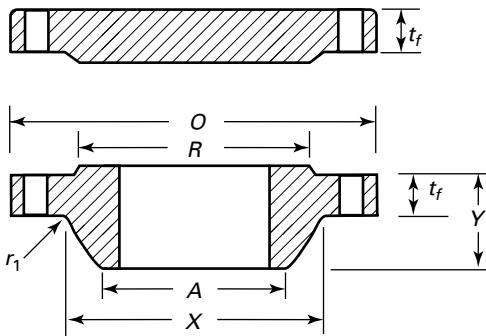

Nominal Pipe Size	Minimum Thickness of Flange, $t_f$ [Note (1)]				Hub Diam. Top, A [Note (3)]	Drilling						Length of Bolts, L [Notes (4), (5)]						
	O.D. of Flange, O	Weld Neck Flange	Blind Flange	Length Through Hub, Y		Diam. of Hub, X [Note (2)]		Diam. Top, A [Note (3)]		Raised Face Diam., R		Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt in.	Minimum Fillet Radius, $r_1$	Stud Bolts	
																Raised Face 1.6 mm		
26	760	31.8	31.8	57	676	661.9	705	723.9	36	$\frac{3}{4}$	$\frac{5}{8}$	8	8	115	115			
28	813	31.8	31.8	60	727	712.7	756	774.7	40	$\frac{3}{4}$	$\frac{5}{8}$	8	8	115	115			
30	864	31.8	31.8	64	778	763.5	806	825.5	44	$\frac{3}{4}$	$\frac{5}{8}$	8	8	115	115			
32	914	33.5	35.1	68	829	814.3	857	876.3	48	$\frac{3}{4}$	$\frac{5}{8}$	8	8	120	120			
34	965	33.5	36.6	72	879	865.1	908	927.1	52	$\frac{3}{4}$	$\frac{5}{8}$	8	8	120	120			
36	1034	35.1	40.9	84	935	915.9	965	992.1	40	$\frac{7}{8}$	$\frac{3}{4}$	10	10	130	130			
38	1084	36.6	42.9	87	986	966.7	1016	1042.9	40	$\frac{7}{8}$	$\frac{3}{4}$	10	10	130	130			
40	1135	36.6	42.9	91	1037	1017.5	1067	1093.7	44	$\frac{7}{8}$	$\frac{3}{4}$	10	10	130	130			
42	1186	38.1	46.2	94	1087	1068.3	1118	1144.5	48	$\frac{7}{8}$	$\frac{3}{4}$	10	10	135	135			
44	1251	41.4	47.8	103	1140	1119.1	1175	1203.5	36	1	$\frac{7}{8}$	10	10	150	150			
46	1302	42.9	49.3	106	1191	1169.9	1226	1254.3	40	1	$\frac{7}{8}$	10	10	150	150			
48	1353	44.6	52.6	110	1242	1220.7	1276	1305.1	44	1	$\frac{7}{8}$	10	10	160	160			
50	1403	46.2	54.1	114	1294	1271.5	1327	1355.9	44	1	$\frac{7}{8}$	10	10	160	160			
52	1457	46.2	55.6	119	1345	1322.3	1378	1409.7	48	1	$\frac{7}{8}$	10	10	160	160			
54	1508	47.8	58.9	124	1397	1373.1	1429	1460.5	48	1	$\frac{7}{8}$	10	10	160	160			

**Table 37**  
**Dimensions of Class 75 Series B Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]		Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Raised Face Diam., <i>R</i>	Drilling				Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, <i>r<sub>1</sub></i>	Length of Bolts, <i>L</i> [Notes (4), (5)]
		Weld Neck Flange	Blind Flange					Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Raised Face Diam., <i>R</i>						Length of Stud Bolts
56	1575	49.3	60.5	133	1451	1423.9	1486	1521.0	40	1 $\frac{1}{8}$	1	11	170				
58	1626	50.8	62.0	137	1502	1474.7	1537	1571.8	44	1 $\frac{1}{8}$	1	11	180				
60	1676	54.1	65.3	143	1553	1525.5	1588	1622.6	44	1 $\frac{1}{8}$	1	11	185				

GENERAL NOTES:


- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 37C**  
**Dimensions of Class 75 Series B Flanges — U.S. Customary Units**

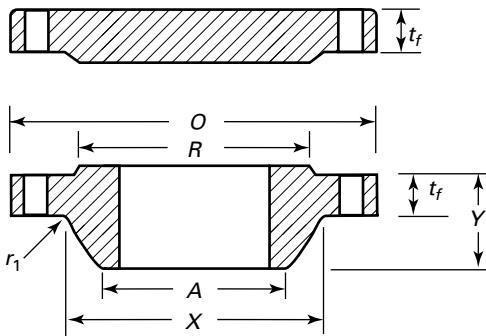

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]
		Weld Neck Flange	Blind Flange	Hub Diam. Top, $A$ [Note (3)]				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	
26	30.00	1.25	1.25	2.25	26.62	26.06	27.75	28.50	36	3/4	5/8	0.31	4.50
28	32.00	1.25	1.25	2.38	28.62	28.06	29.75	30.50	40	3/4	5/8	0.31	4.50
30	34.00	1.25	1.25	2.50	30.62	30.06	31.75	32.50	44	3/4	5/8	0.31	4.75
32	36.00	1.32	1.38	2.69	32.62	32.06	33.75	34.50	48	3/4	5/8	0.31	4.75
34	38.00	1.32	1.44	2.82	34.62	34.06	35.75	36.50	52	3/4	5/8	0.31	4.75
36	40.69	1.38	1.61	3.32	36.81	36.06	38.00	39.06	40	7/8	3/4	0.38	5.00
38	42.69	1.44	1.69	3.44	38.81	38.06	40.00	41.06	40	7/8	3/4	0.38	5.25
40	44.69	1.44	1.69	3.57	40.81	40.06	42.00	43.06	44	7/8	3/4	0.38	5.25
42	46.69	1.50	1.82	3.69	42.81	42.06	44.00	45.06	48	7/8	3/4	0.38	5.25
44	49.25	1.63	1.88	4.07	44.88	44.06	46.25	47.38	36	1	7/8	0.38	5.75
46	51.25	1.69	1.94	4.19	46.88	46.06	48.25	49.38	40	1	7/8	0.38	6.00
48	53.25	1.75	2.07	4.32	48.88	48.06	50.25	51.38	44	1	7/8	0.38	6.00
50	55.25	1.82	2.13	4.50	50.94	50.06	52.25	53.38	44	1	7/8	0.38	6.25
52	57.38	1.82	2.19	4.69	52.94	52.06	54.25	55.50	48	1	7/8	0.38	6.25
54	59.38	1.88	2.32	4.88	55.00	54.06	56.25	57.50	48	1	7/8	0.38	6.25

**Table 37C**  
**Dimensions of Class 75 Series B Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]		Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling				Minimum Fillet Radius, <i>r<sub>1</sub></i>	Length of Bolts, <i>L</i> [Notes (4), (5)]	Stud Bolts
		Weld Neck Flange	Blind Flange				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt		
56	62.00	1.94	2.38	5.25	57.12	56.06	58.50	59.88	40	1 $\frac{1}{8}$	1	0.44	6.75
58	64.00	2.00	2.44	5.38	59.12	58.06	60.50	61.88	44	1 $\frac{1}{8}$	1	0.44	7.00
60	66.00	2.13	2.57	5.63	61.12	60.06	62.50	63.88	44	1 $\frac{1}{8}$	1	0.44	7.25

GENERAL NOTES:


- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 38**  
**Dimensions of Class 150 Series B Flanges — SI Units**

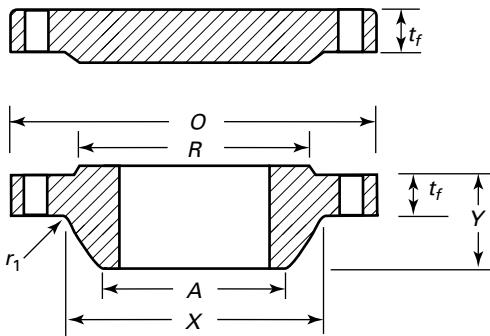

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$			Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	
26	786	39.9	42.9	87	684	661.9	711	744.5	36	7/8	3/4	10 140
28	837	42.9	46.2	94	735	712.7	762	795.3	40	7/8	3/4	10 145
30	887	42.9	49.3	98	787	763.5	813	846.1	44	7/8	3/4	10 145
32	941	44.4	52.6	106	840	814.3	864	900.2	48	7/8	3/4	10 150
34	1005	47.8	55.6	109	892	865.1	921	957.3	40	1	7/8	10 165
36	1057	50.8	57.2	116	945	915.9	972	1009.6	44	1	7/8	10 165
38	1124	52.6	62.0	122	997	968.2	1022	1069.8	40	1 1/8	1	10 185
40	1175	54.1	65.3	127	1049	1019.0	1080	1120.6	44	1 1/8	1	10 185
42	1226	57.2	66.8	132	1102	1069.8	1130	1171.4	48	1 1/8	1	11 190
44	1276	58.9	69.8	135	1153	1120.6	1181	1222.2	52	1 1/8	1	11 195
46	1341	60.5	73.2	143	1205	1171.4	1235	1284.2	40	1 1/4	1 1/8	11 205
48	1392	63.5	76.2	148	1257	1222.2	1289	1335.0	44	1 1/4	1 1/8	11 210
50	1443	66.8	79.5	152	1308	1273.0	1340	1385.8	48	1 1/4	1 1/8	11 215
52	1494	68.3	82.6	156	1360	1323.8	1391	1436.6	52	1 1/4	1 1/8	11 220
54	1549	69.8	85.9	161	1413	1374.6	1441	1492.2	56	1 1/4	1 1/8	11 225

**Table 38**  
**Dimensions of Class 150 Series B Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]		Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling				Length of Bolts, <i>L</i> [Notes (4), (5)]		
		Weld Neck Flange	Blind Flange				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, <i>r<sub>1</sub></i>	Stud Bolts
56	1600	71.6	88.9	165	1465	1425.4	1492	1543.0	60	1 $\frac{1}{4}$	1 $\frac{1}{8}$	14	225
58	1675	73.2	91.9	173	1516	1476.2	1543	1611.4	48	1 $\frac{3}{8}$	1 $\frac{1}{4}$	14	235
60	1726	74.7	95.2	178	1570	1527.0	1600	1662.2	52	1 $\frac{3}{8}$	1 $\frac{1}{4}$	14	240

GENERAL NOTES:


- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 38C**  
**Dimensions of Class 150 Series B Flanges — U.S. Customary Units**

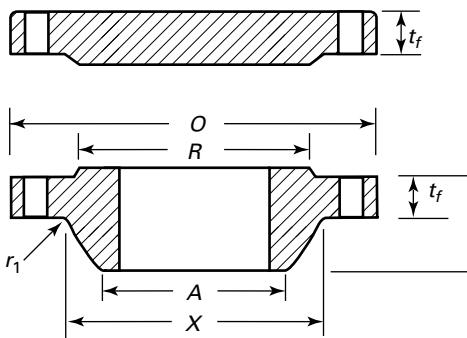

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]	
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$			Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$	
26	30.94	1.57	1.69	3.44	26.94	26.06	28.00	29.31	36	7/8	3/4	0.38	5.50
28	32.94	1.69	1.82	3.69	28.94	28.06	30.00	31.31	40	7/8	3/4	0.38	5.75
30	34.94	1.69	1.94	3.88	31.00	30.06	32.00	33.31	44	7/8	3/4	0.38	5.75
32	37.06	1.75	2.07	4.19	33.06	32.06	34.00	35.44	48	7/8	3/4	0.38	5.75
34	39.56	1.88	2.19	4.28	35.12	34.06	36.25	37.69	40	1	7/8	0.38	6.25
36	41.62	2.00	2.25	4.57	37.19	36.06	38.25	39.75	44	1	7/8	0.38	6.50
38	44.25	2.07	2.44	4.82	39.25	38.12	40.25	42.12	40	1 1/8	1	0.38	7.25
40	46.25	2.13	2.57	5.00	41.31	40.12	42.50	44.12	44	1 1/8	1	0.38	7.25
42	48.25	2.25	2.63	5.19	43.38	42.12	44.50	46.12	48	1 1/8	1	0.44	7.50
44	50.25	2.32	2.75	5.32	45.38	44.12	46.50	48.12	52	1 1/8	1	0.44	7.75
46	52.81	2.38	2.88	5.63	47.44	46.12	48.62	50.56	40	1 1/4	1 1/8	0.44	8.00
48	54.81	2.50	3.00	5.82	49.50	48.12	50.75	52.56	44	1 1/4	1 1/8	0.44	8.25
50	56.81	2.63	3.13	6.00	51.50	50.12	52.75	54.56	48	1 1/4	1 1/8	0.44	8.50
52	58.81	2.69	3.25	6.13	53.56	52.12	54.75	56.56	52	1 1/4	1 1/8	0.44	8.75
54	61.00	2.75	3.38	6.32	55.62	54.12	56.75	58.75	56	1 1/4	1 1/8	0.44	8.75

**Table 38C**  
**Dimensions of Class 150 Series B Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]		Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling				Length of Bolts, <i>L</i> [Notes (4), (5)]	Stud Bolts	
		Weld Neck Flange	Blind Flange				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt		
56	63.00	2.82	3.50	6.50	57.69	56.12	58.75	60.75	60	1 $\frac{1}{4}$	1 $\frac{1}{8}$	0.56	9.00
58	65.94	2.88	3.62	6.82	59.69	58.12	60.75	63.44	48	1 $\frac{3}{8}$	1 $\frac{1}{4}$	0.56	9.25
60	67.94	2.94	3.75	7.00	61.81	60.12	63.00	65.44	52	1 $\frac{3}{8}$	1 $\frac{1}{4}$	0.56	9.50

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3


Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 39**  
**Dimensions of Class 300 Series B Flanges — SI Units**

(25)

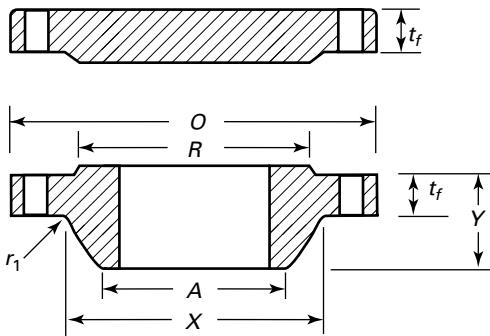

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]		Length Through Hub, $Y$ [Note (2)]	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling						Length of Bolts, $L$ [Notes (4), (5)]
		Weld Neck Flange	Blind Flange				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, $r_1$	Raised Face 1.6 mm
26	867	87.4	87.4	143	702	665.2	737	803.1	32	1 $\frac{3}{8}$	1 $\frac{1}{4}$	14	270
28	921	87.4	87.4	148	756	716.0	787	857.2	36	1 $\frac{3}{8}$	1 $\frac{1}{4}$	14	270
30	991	92.2	92.2	156	813	768.4	845	920.8	36	1 $\frac{1}{2}$	1 $\frac{3}{8}$	14	285
32	1054	101.6	101.6	167	864	819.2	902	977.9	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	16	310
34	1108	101.6	101.6	171	917	870.0	952	1031.7	36	1 $\frac{5}{8}$	1 $\frac{1}{2}$	16	310
36	1171	101.6	101.6	179	965	920.8	1010	1089.2	32	1 $\frac{3}{4}$	1 $\frac{5}{8}$	16	320
38	1222	109.5	109.5	190	1016	971.6	1060	1140.0	36	1 $\frac{3}{4}$	1 $\frac{5}{8}$	16	335
40	1273	114.3	114.3	197	1067	1022.4	1115	1190.8	40	1 $\frac{3}{4}$	1 $\frac{5}{8}$	16	345
42	1334	117.6	117.6	203	1118	1074.7	1168	1244.6	36	1 $\frac{7}{8}$	1 $\frac{3}{4}$	16	355
44	1384	125.5	125.5	213	1173	1125.5	1219	1295.4	40	1 $\frac{7}{8}$	1 $\frac{3}{4}$	16	370
46	1460	127.0	128.5	221	1229	1176.3	1270	1365.2	36	2	1 $\frac{7}{8}$	16	380
48	1511	127.0	133.4	222	1278	1227.1	1327	1416.0	40	2	1 $\frac{7}{8}$	16	380
50	1562	136.7	138.2	233	1330	1277.9	1378	1466.8	44	2	1 $\frac{7}{8}$	16	400
52	1613	141.2	142.5	241	1383	1328.7	1429	1517.6	48	2	1 $\frac{7}{8}$	16	410
54	1673	135.1	147.6	238	1435	1379.5	1480	1577.8	48	2	1 $\frac{7}{8}$	16	400

**Table 39**  
**Dimensions of Class 300 Series B Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]		Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling					Length of Bolts, <i>L</i> [Notes (4), (5)]	
		Weld Neck Flange	Blind Flange				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, <i>r<sub>1</sub></i>	
56	1765	152.4	155.4	267	1494	1430.3	1537	1651.0	36	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	17	450
58	1827	152.4	160.3	273	1548	1481.1	1594	1713.0	40	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	17	450
60	1878	149.4	165.1	270	1599	1531.9	1651	1763.8	40	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	17	450

GENERAL NOTES:


- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 39C**  
**Dimensions of Class 300 Series B Flanges — U.S. Customary Units**

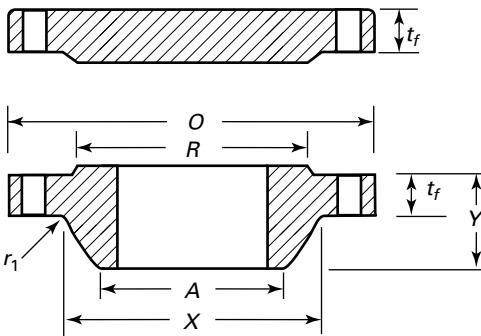

Nominal Pipe Size	O.D. of Flange, O	Minimum Thickness of Flange, $t_f$ [Note (1)]			Diam. of Hub, X [Note (2)]	Hub Diam. Top, A [Note (3)]	Drilling						Length of Bolts, L [Notes (4), (5)]
		Weld Neck Flange	Blind Flange	Length Through Hub, Y			Raised Face Diam., R	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$	Raised Face 0.06 in.
26	34.12	3.44	3.44	5.63	27.62	26.19	29.00	31.62	32	1 $\frac{3}{8}$	1 $\frac{1}{4}$	0.56	10.50
28	36.25	3.44	3.44	5.81	29.75	28.19	31.00	33.75	36	1 $\frac{3}{8}$	1 $\frac{1}{4}$	0.56	10.50
30	39.00	3.63	3.63	6.16	32.00	30.25	33.25	36.25	36	1 $\frac{1}{2}$	1 $\frac{3}{8}$	0.56	11.25
32	41.50	4.00	4.00	6.56	34.00	32.25	35.50	38.50	32	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.62	12.25
34	43.62	4.00	4.00	6.75	36.12	34.25	37.50	40.62	36	1 $\frac{5}{8}$	1 $\frac{1}{2}$	0.62	12.25
36	46.12	4.00	4.00	7.06	38.00	36.25	39.75	42.88	32	1 $\frac{3}{4}$	1 $\frac{5}{8}$	0.62	12.50
38	48.12	4.31	4.31	7.50	40.00	38.25	41.75	44.88	36	1 $\frac{3}{4}$	1 $\frac{5}{8}$	0.62	13.00
40	50.12	4.50	4.50	7.75	42.00	40.25	43.88	46.88	40	1 $\frac{3}{4}$	1 $\frac{5}{8}$	0.62	13.50
42	52.50	4.63	4.63	8.00	44.00	42.31	46.00	49.00	36	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.62	14.00
44	54.50	4.94	4.94	8.38	46.19	44.31	48.00	51.00	40	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.62	14.50
46	57.50	5.00	5.06	8.69	48.38	46.31	50.00	53.75	36	2	1 $\frac{7}{8}$	0.62	15.00
48	59.50	5.00	5.25	8.75	50.31	48.31	52.25	55.75	40	2	1 $\frac{7}{8}$	0.62	15.00
50	61.50	5.38	5.44	9.19	52.38	50.31	54.25	57.75	44	2	1 $\frac{7}{8}$	0.62	15.75
52	63.50	5.56	5.61	9.50	54.44	52.31	56.25	59.75	48	2	1 $\frac{7}{8}$	0.62	16.00
54	65.88	5.32	5.81	9.38	56.50	54.31	58.25	62.12	48	2	1 $\frac{7}{8}$	0.62	15.75

**Table 39C**  
**Dimensions of Class 300 Series B Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, <i>O</i>	Minimum Thickness of Flange, <i>t<sub>f</sub></i> [Note (1)]		Length Through Hub, <i>Y</i>	Diam. of Hub, <i>X</i> [Note (2)]	Hub Diam. Top, <i>A</i> [Note (3)]	Drilling				Length of Bolts, <i>L</i> [Notes (4), (5)]	Stud Bolts	
		Weld Neck Flange	Blind Flange				Raised Face Diam., <i>R</i>	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt		
56	69.50	6.00	6.12	10.50	58.81	56.31	60.50	65.00	36	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	0.69	17.75
58	71.94	6.00	6.31	10.75	60.94	58.31	62.75	67.44	40	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	0.69	17.75
60	73.94	5.88	6.50	10.63	62.94	60.31	65.00	69.44	40	2 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>4</sub>	0.69	17.50

GENERAL NOTES:


- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 40**  
**Dimensions of Class 400 Series B Flanges — SI Units**

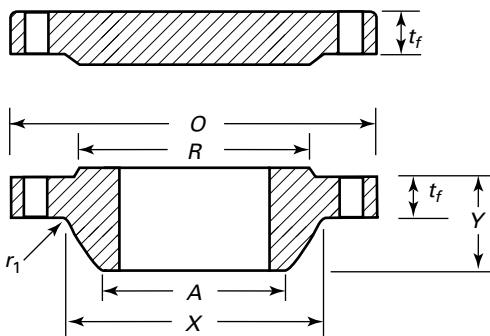

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]	
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$			Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, $r_1$	Stud Bolts
26	851	88.9	88.9	149	689	660.4	711	781.0	28	1½	1¾	11	290
28	914	95.2	95.2	159	740	711.2	762	838.2	24	1¾	1½	13	310
30	972	101.6	101.6	170	794	762.0	819	895.4	28	1¾	1½	13	320
32	1035	108.0	108.0	179	845	812.8	873	952.5	28	1¾	1¾	13	345
34	1086	111.3	111.3	187	899	863.6	927	1003.3	32	1¾	1¾	14	345
36	1156	119.1	119.1	200	952	914.4	981	1066.8	28	1¾	1¾	14	370
38	...	...	...	...	...	...	...	...	...	...	...	...	...
40	...	...	...	...	...	...	...	...	...	...	...	...	...
42	...	...	...	...	...	...	...	...	...	...	...	...	...
44	...	...	...	...	...	...	...	...	...	...	...	...	...
46	...	...	...	...	...	...	...	...	...	...	...	...	...
48	...	...	...	...	...	...	...	...	...	...	...	...	...
50	...	...	...	...	...	...	...	...	...	...	...	...	...
52	...	...	...	...	...	...	...	...	...	...	...	...	...
54	...	...	...	...	...	...	...	...	...	...	...	...	...

**Table 40**  
**Dimensions of Class 400 Series B Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]		Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]	
		Weld Neck Flange	Blind Flange				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt in.	Minimum Fillet Radius, $r_1$	Stud Bolts
56	...	...	...	...	...	...	...	...	...	...	...	...	...
58	...	...	...	...	...	...	...	...	...	...	...	...	...
60	...	...	...	...	...	...	...	...	...	...	...	...	...

GENERAL NOTES:

- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3


Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

- (h) Dimensions for Classes 400, 600, and 900 NPS 38 and larger for Series B flanges are the same as for the Series A flanges.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 40C**  
**Dimensions of Class 400 Series B Flanges — U.S. Customary Units**

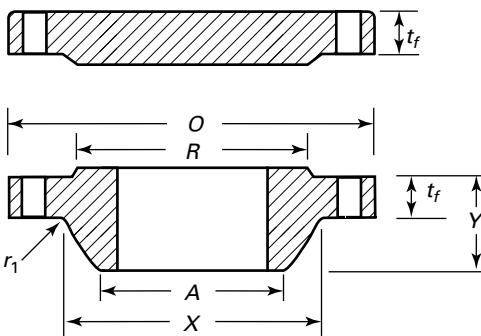

Nominal Pipe Size	Minimum Thickness of Flange, $t_f$ [Note (1)]				Drilling							Length of Bolts, $L$ [Notes (4), (5)]		
	O.D. of Flange, $O$	Weld Neck Flange	Blind Flange	Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub		Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$	Stud Bolts
						Diam. Top, $A$ [Note (3)]	Diam. Top, $A$ [Note (3)]							
26	33.50	3.50	3.50	5.88	27.12	26.00	28.00	30.75	28	1½	1¾	0.44	14.25	
28	36.00	3.75	3.75	6.25	29.12	28.00	30.00	33.00	24	1⅝	1½	0.50	14.75	
30	38.25	4.00	4.00	6.69	31.25	30.00	32.25	35.25	28	1⅝	1½	0.50	15.50	
32	40.75	4.25	4.25	7.06	33.25	32.00	34.38	37.50	28	1¾	1¾	0.50	16.25	
34	42.75	4.38	4.38	7.38	35.38	34.00	36.50	39.50	32	1¾	1¾	0.56	17.25	
36	45.50	4.69	4.69	7.88	37.50	36.00	38.62	42.00	28	1⅞	1¾	0.56	18.00	
38	...	...	...	...	...	...	...	...	...	...	...	...	...	
40	...	...	...	...	...	...	...	...	...	...	...	...	...	
42	...	...	...	...	...	...	...	...	...	...	...	...	...	
44	...	...	...	...	...	...	...	...	...	...	...	...	...	
46	...	...	...	...	...	...	...	...	...	...	...	...	...	
48	...	...	...	...	...	...	...	...	...	...	...	...	...	
50	...	...	...	...	...	...	...	...	...	...	...	...	...	
52	...	...	...	...	...	...	...	...	...	...	...	...	...	
54	...	...	...	...	...	...	...	...	...	...	...	...	...	

**Table 40C**  
**Dimensions of Class 400 Series B Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]	Stud Bolts	
		Weld Neck Flange	Blind Flange	Hub Diam. Top, $A$ [Note (3)]				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$		
56	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...
58	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...
60	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3


Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

- (h) Dimensions for Classes 400, 600, and 900 NPS 38 and larger for Series B flanges are the same as for the Series A flanges.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 41**  
**Dimensions of Class 600 Series B Flanges — SI Units**

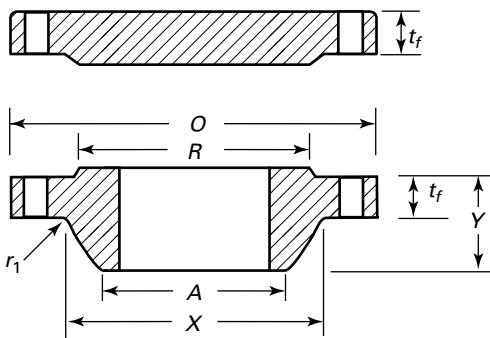

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]
		Weld Neck Flange	Blind Flange	Hub Diam., $R$				Raised Face Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, $r_1$	
26	889	111.3	111.3	181	698	660.4	727	806.4	28	1 $\frac{3}{4}$	1 $\frac{5}{8}$	13	360
28	952	115.8	115.8	190	752	711.2	784	863.6	28	1 $\frac{7}{8}$	1 $\frac{3}{4}$	13	375
30	1022	125.5	127.0	205	806	762.0	841	927.1	28	2	1 $\frac{7}{8}$	13	395
32	1086	130.0	134.9	216	861	812.8	895	984.2	28	2 $\frac{1}{8}$	2	13	415
34	1162	141.2	144.3	233	914	863.6	952	1054.1	24	2 $\frac{3}{8}$	2 $\frac{1}{4}$	14	440
36	1213	146.0	150.9	243	968	914.4	1010	1104.9	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	14	460
38	...	...	...	...	...	...	...	...	...	...	...	...	...
40	...	...	...	...	...	...	...	...	...	...	...	...	...
42	...	...	...	...	...	...	...	...	...	...	...	...	...
44	...	...	...	...	...	...	...	...	...	...	...	...	...
46	...	...	...	...	...	...	...	...	...	...	...	...	...
48	...	...	...	...	...	...	...	...	...	...	...	...	...
50	...	...	...	...	...	...	...	...	...	...	...	...	...
52	...	...	...	...	...	...	...	...	...	...	...	...	...
54	...	...	...	...	...	...	...	...	...	...	...	...	...

**Table 41**  
**Dimensions of Class 600 Series B Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]		Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]	Stud Bolts
		Weld Neck Flange	Blind Flange				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, $r_1$	
56	...	...	...	...	...	...	...	...	...	...	...	...	...
58	...	...	...	...	...	...	...	...	...	...	...	...	...
60	...	...	...	...	...	...	...	...	...	...	...	...	...

GENERAL NOTES:

- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3


Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

- (h) Dimensions for Classes 400, 600, and 900 NPS 38 and larger for Series B flanges are the same as for the Series A flanges.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 41C**  
**Dimensions of Class 600 Series B Flanges — U.S. Customary Units**

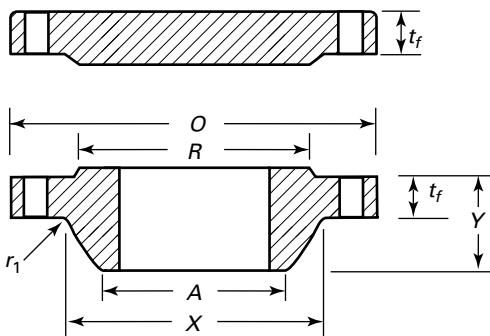

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]		Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling						Length of Bolts, $L$ [Notes (4), (5)]
		Weld Neck Flange	Blind Flange				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$	
26	35.00	4.38	4.38	7.12	27.50	26.00	28.62	31.75	28	1 $\frac{3}{4}$	1 $\frac{5}{8}$	0.50	14.25
28	37.50	4.56	4.56	7.50	29.62	28.00	30.88	34.00	28	1 $\frac{7}{8}$	1 $\frac{3}{4}$	0.50	14.75
30	40.25	4.94	5.00	8.06	31.75	30.00	33.12	36.50	28	2	1 $\frac{7}{8}$	0.50	15.50
32	42.75	5.12	5.31	8.50	33.88	32.00	35.25	38.75	28	2 $\frac{1}{8}$	2	0.50	16.25
34	45.75	5.56	5.68	9.19	36.00	34.00	37.50	41.50	24	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.56	17.25
36	47.75	5.75	5.94	9.56	38.12	36.00	39.75	43.50	28	2 $\frac{3}{8}$	2 $\frac{1}{4}$	0.56	18.00
38	...	...	...	...	...	...	...	...	...	...	...	...	...
40	...	...	...	...	...	...	...	...	...	...	...	...	...
42	...	...	...	...	...	...	...	...	...	...	...	...	...
44	...	...	...	...	...	...	...	...	...	...	...	...	...
46	...	...	...	...	...	...	...	...	...	...	...	...	...
48	...	...	...	...	...	...	...	...	...	...	...	...	...
50	...	...	...	...	...	...	...	...	...	...	...	...	...
52	...	...	...	...	...	...	...	...	...	...	...	...	...
54	...	...	...	...	...	...	...	...	...	...	...	...	...

**Table 41C**  
**Dimensions of Class 600 Series B Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]	Stud Bolts	
		Weld Neck Flange	Blind Flange	Hub Diam. Top, $A$ [Note (3)]				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$		
56	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...
58	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...
60	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3


Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

- (h) Dimensions for Classes 400, 600, and 900 NPS 38 and larger for Series B flanges are the same as for the Series A flanges.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 42**  
**Dimensions of Class 900 Series B Flanges — SI Units**

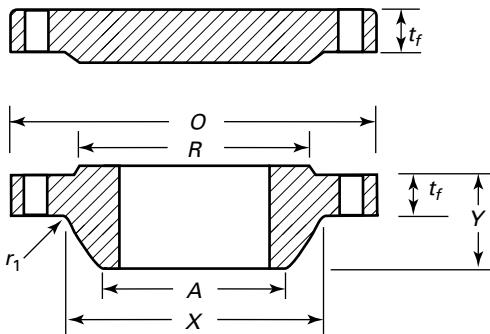

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Length Through Hub, $Y$ [Note (2)]	Diam. of Hub, $X$ [Note (2)]	Drilling						Length of Bolts, $L$ [Notes (4), (5)]
		Weld Neck Flange	Blind Flange	Hub Diam. Top, $A$ [Note (3)]			Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt, in.	Minimum Fillet Radius, $r_1$	Raised Face 6.4 mm
26	1022	134.9	153.9	259	743	660.4	762	901.7	20	2 $\frac{5}{8}$	2 $\frac{1}{2}$	11	450
28	1105	147.6	166.6	276	797	711.2	819	971.6	20	2 $\frac{7}{8}$	2 $\frac{3}{4}$	13	495
30	1181	155.4	176.0	289	851	762.0	876	1035.0	20	3 $\frac{1}{8}$	3	13	510
32	1238	160.3	185.7	303	908	812.8	927	1092.2	20	3 $\frac{1}{8}$	3	13	530
34	1314	171.4	195.0	319	962	863.6	991	1155.7	20	3 $\frac{3}{8}$	3 $\frac{1}{4}$	14	565
36	1346	173.0	201.7	325	1016	914.4	1029	1200.2	24	3 $\frac{1}{8}$	3	14	570
38	...	...	...	...	...	...	...	...	...	...	...	...	...
40	...	...	...	...	...	...	...	...	...	...	...	...	...
42	...	...	...	...	...	...	...	...	...	...	...	...	...
44	...	...	...	...	...	...	...	...	...	...	...	...	...
46	...	...	...	...	...	...	...	...	...	...	...	...	...
48	...	...	...	...	...	...	...	...	...	...	...	...	...
50	...	...	...	...	...	...	...	...	...	...	...	...	...
52	...	...	...	...	...	...	...	...	...	...	...	...	...
54	...	...	...	...	...	...	...	...	...	...	...	...	...

**Table 42**  
**Dimensions of Class 900 Series B Flanges — SI Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]
		Weld Neck Flange	Blind Flange	Hub Diam. Top, $A$ [Note (3)]				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole, in.	Diam. of Bolt in.	Minimum Fillet Radius, $r_1$
56	...	...	...	...	...	...	...	...	...	...	...	...	...
58	...	...	...	...	...	...	...	...	...	...	...	...	...
60	...	...	...	...	...	...	...	...	...	...	...	...	...

GENERAL NOTES:

- (a) Dimensions are in millimeters unless otherwise noted.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For sport facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3


Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

- (h) Dimensions for Classes 400, 600, and 900 NPS 38 and larger for Series B flanges are the same as for the Series A flanges.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 42C**  
**Dimensions of Class 900 Series B Flanges — U.S. Customary Units**

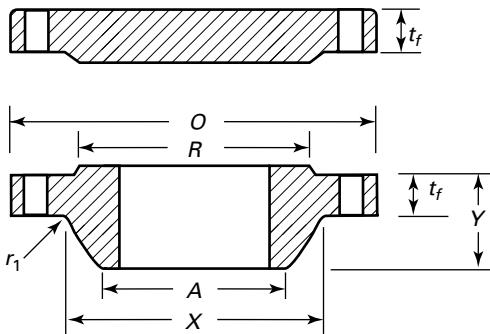

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling						Length of Bolts, $L$ [Notes (4), (5)]
		Weld Neck Flange	Blind Flange	Length Through Hub, $Y$			Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$	Stud Bolts
													Raised Face 0.25 in.
26	40.25	5.31	6.06	10.19	29.25	26.00	30.00	35.50	20	2 $\frac{5}{8}$	2 $\frac{1}{2}$	0.44	17.75
28	43.50	5.81	6.56	10.88	31.38	28.00	32.25	38.25	20	2 $\frac{7}{8}$	2 $\frac{3}{4}$	0.50	19.25
30	46.50	6.12	6.93	11.38	33.50	30.00	34.50	40.75	20	3 $\frac{1}{8}$	3	0.50	20.00
32	48.75	6.31	7.31	11.94	35.75	32.00	36.50	43.00	20	3 $\frac{1}{8}$	3	0.50	20.75
34	51.75	6.75	7.68	12.56	37.88	34.00	39.00	45.50	20	3 $\frac{3}{8}$	3 $\frac{1}{4}$	0.56	22.25
36	53.00	6.81	7.94	12.81	40.00	36.00	40.50	47.25	24	3 $\frac{1}{8}$	3	0.56	22.25
38	...	...	...	...	...	...	...	...	...	...	...	...	...
40	...	...	...	...	...	...	...	...	...	...	...	...	...
42	...	...	...	...	...	...	...	...	...	...	...	...	...
44	...	...	...	...	...	...	...	...	...	...	...	...	...
46	...	...	...	...	...	...	...	...	...	...	...	...	...
48	...	...	...	...	...	...	...	...	...	...	...	...	...
50	...	...	...	...	...	...	...	...	...	...	...	...	...
52	...	...	...	...	...	...	...	...	...	...	...	...	...
54	...	...	...	...	...	...	...	...	...	...	...	...	...

**Table 42C**  
**Dimensions of Class 900 Series B Flanges — U.S. Customary Units (Cont'd)**

Nominal Pipe Size	O.D. of Flange, $O$	Minimum Thickness of Flange, $t_f$ [Note (1)]			Length Through Hub, $Y$	Diam. of Hub, $X$ [Note (2)]	Hub Diam. Top, $A$ [Note (3)]	Drilling					Length of Bolts, $L$ [Notes (4), (5)]	Stud Bolts	
		Weld Neck Flange	Blind Flange	Hub Diam. Top, $A$ [Note (3)]				Raised Face Diam., $R$	Diam. of Bolt Circle	No. of Bolt Holes	Diam. of Bolt Hole	Diam. of Bolt	Minimum Fillet Radius, $r_1$		
56	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...
58	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...
60	...	...	...	...	...	...	...	...	...	...	...	...	...	...	...

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) For tolerances, see [section 7](#).
- (c) For facings, see [para. 6.1](#).
- (d) For flange bolt holes, see [para. 6.2](#).
- (e) For spot facing, see [para. 6.3](#).
- (f) The bore is to be specified by the purchaser. Tolerances in [para. 7.3.2](#) apply.
- (g) Blind flanges may be made with or without hubs at the manufacturer's option. The manufacturer or purchaser may modify blind flanges with the following features:
  - (1) a hole bored to match the ID of a slip-on flange up to NPS 3
  - (2) a socket equivalent to that provided for a socket-welding flange up to NPS 3
  - (3) an internal thread to ASME B1.20.1 up to NPS 3

Holes can be placed anywhere within the inside diameter of the mating pipe. When multiple holes are provided, they shall be separated by a distance at least equal to that of the diameter of the largest hole being added.

- (h) Dimensions for Classes 400, 600, and 900 NPS 38 and larger for Series B flanges are the same as for the Series A flanges.

NOTES:

- (1) The minimum flange thickness does not include the raised face thickness (see [para. 6.1.1](#)).
- (2) This dimension is for the large end of hub, which may be straight or tapered.
- (3) For welding and bevel, see [para. 6.4](#).
- (4) The length of the stud bolt does not include the height of the points (see [para. 6.5.2](#)).
- (5) Bolt lengths not shown in the table may be determined in accordance with [Nonmandatory Appendix D](#) (see [para. 6.5.2](#)).

**Table 43**  
**Flange Bolting Dimensional Recommendations**

<b>Product</b>	<b>Carbon Steel</b>	<b>Alloy Steel</b>
Bolts smaller than $\frac{3}{4}$ in.	ASME B18.2.1, square or heavy hex head	ASME B18.2.1, heavy hex head
Bolts equal to or larger than $\frac{3}{4}$ in.	ASME B18.2.1, square or heavy hex head	ASME B18.2.1, heavy hex head
Nuts smaller than $\frac{3}{4}$ in.	ASME B18.2.2, heavy hex	ASME B18.2.2, heavy hex
Nuts equal to or larger than $\frac{3}{4}$ in.	ASME B18.2.2, hex or heavy hex	ASME B18.2.2, heavy hex
Stud bolts	ASME B18.31.2	ASME B18.31.2
External threads	ASME B1.1, Cl. 2A coarse series	ASME B1.1, Cl. 2A coarse series up through 1 in.; eight thread series for larger bolts
Internal threads	ASME B1.1, Cl. 2B coarse series	ASME B1.1, Cl. 2B coarse series up through 1 in.; eight thread series for larger bolts

## MANDATORY APPENDIX I

### REFERENCES

(25)

The following is a list of standards and specifications referenced in this Standard. Products covered by each ASTM specification are listed for convenience. Unless otherwise specified, the latest edition of ASME publications shall apply. (See specifications for exact titles and detailed contents.) Materials manufactured to other editions of the referenced ASTM specifications may be used to manufacture fittings meeting the requirements of this Standard as long as the fitting manufacturer verifies that the material meets the requirements of the referenced edition of the ASTM specification.

ASME B1.1. Unified Inch Screw Threads (UN, UNR, and UNJ Thread Form). The American Society of Mechanical Engineers.

ASME B1.20.1. Pipe Threads, General Purpose (Inch). The American Society of Mechanical Engineers.

ASME B16.5. Pipe Flanges and Flanged Fittings: NPS  $\frac{1}{2}$  Through NPS 24. The American Society of Mechanical Engineers.

ASME B16.20. Metallic Gaskets for Pipe Flanges. The American Society of Mechanical Engineers.

ASME B16.21. Nonmetallic Flat Gaskets for Pipe Flanges. The American Society of Mechanical Engineers.

ASME B16.34. Valves — Flanged, Threaded, and Welding End. The American Society of Mechanical Engineers.

ASME B18.2.1. Square, Hex, Heavy Hex, and Askew Head Bolts and Hex, Heavy Hex, Hex Flange, Lobed Head, and Lag Screws (Inch Series). The American Society of Mechanical Engineers.

ASME B18.2.2. Nuts for General Applications: Machine Screw Nuts, Hex, Square, Hex Flange, and Coupling Nuts (Inch Series). The American Society of Mechanical Engineers.

ASME B18.31.2. Continuous and Double-End Studs (Inch Series). The American Society of Mechanical Engineers.

ASME B31.3. Process Piping. The American Society of Mechanical Engineers.

ASME B31T. Standard Toughness Requirements for Piping. The American Society of Mechanical Engineers.

ASME B46.1. Surface Texture (Surface Roughness, waviness, and Lay). The American Society of Mechanical Engineers.

ASME Boiler and Pressure Vessel Code, Section I. Rules for Construction of Power Boilers. The American Society of Mechanical Engineers.

ASME Boiler and Pressure Vessel Code, Section II. Materials. The American Society of Mechanical Engineers.

ASME Boiler and Pressure Vessel Code, Section III. Rules for Construction of Nuclear Facility Components. The American Society of Mechanical Engineers.

ASME Boiler and Pressure Vessel Code, Section VIII. Rules for Construction of Pressure Vessels — Division 1. The American Society of Mechanical Engineers.

ASME Boiler and Pressure Vessel Code, Section VIII. Rules for Construction of Pressure Vessels — Division 2, Alternative Rules. The American Society of Mechanical Engineers.

ASTM A105/A105M-23. Standard Specification for Carbon Steel Forgings for Piping Applications. ASTM International.

ASTM A182/A182M-23. Standard Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Forged Fittings, and Valves and Parts for High-Temperature Service. ASTM International.

ASTM A193/A193M-23. Standard Specification for Alloy-Steel and Stainless Steel Bolting for High Temperature or High Pressure Service and Other Special Purpose Applications. ASTM International.

ASTM A194/A194M-23. Standard Specification for Carbon and Alloy Steel Nuts for Bolts for High Pressure or High Temperature Service, or Both. ASTM International.

ASTM A203/A203M-23. Standard Specification for Pressure Vessel Plates, Alloy Steel, Nickel. ASTM International.

ASTM A204/A204M-17(2022). Standard Specification for Pressure Vessel Plates, Alloy Steel, Molybdenum. ASTM International.

ASTM A216/A216M-21. Standard Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High-Temperature Service. ASTM International.

ASTM A217/A217M-22. Standard Specification for Steel Castings, Martensitic Stainless and Alloy, for Pressure-Containing Parts, Suitable for High-Temperature Service. ASTM International.

ASTM A240/A240M-23. Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications. ASTM International.

ASTM A307-21. Standard Specification for Carbon Steel Bolts and Studs, 60,000 psi Tensile Strength. ASTM International.

ASTM A320/A320M-22a. Standard Specification for Alloy-Steel and Stainless Steel Bolting for Low-Temperature Service. ASTM International.

ASTM A350/A350M-23. Standard Specification for Carbon and Low-Alloy Steel forgings, Requiring Notch Toughness Testing for Piping Components. ASTM International.

ASTM A351/A351M-18<sup>e1</sup>. Standard Specification for Castings, Austenitic, for Pressure-Containing Parts. ASTM International.

ASTM A352/A352M-21. Standard Specification for Steel Castings, Ferritic and Martensitic, for Pressure-Containing Parts, Suitable for Low-Temperature Service. ASTM International.

ASTM A354-17<sup>e2</sup>. Standard Specification for Quenched and Tempered Alloy Steel Bolts, Studs, and Other Externally Threaded Fasteners. ASTM International.

ASTM A387/A387M-17a(2023). Standard Specification for Pressure Vessel Plates, Alloy Steel, Chromium-Molybdenum. ASTM International.

ASTM A449-10. Standard Specification for Hex Cap Screws, Bolts and Studs, Steel, Heat Treated, 120/105/90 ksi Minimum Tensile Strength, General Use. ASTM International.

ASTM A453/A453M-17. Standard Specification for High-Temperature Bolting, With Expansion Coefficients Comparable to Austenitic Stainless Steels. ASTM International.

ASTM A515/A515M-17(2022). Standard Specification for Pressure Vessel Plates, Carbon Steel, for Intermediate- and Higher-Temperature Service. ASTM International.

ASTM A516/A516M-17. Standard Specification for Pressure Vessel Plates, Carbon Steel, for Moderate- and Lower-Temperature Service. ASTM International.

ASTM A537/A537M-20. Standard Specification for Pressure Vessel Plates, Heat-Treated, Carbon-Manganese-Silicon Steel. ASTM International.

ASTM A540/A540M-15(2021). Standard Specification for Alloy-Steel Bolting for Special Applications. ASTM International.

ASTM E29-22. Standard Practice for Using Significant Digits in Test Data to Determine Conformance With Specifications. ASTM International.

ISO 9000:2005. Quality management systems — Fundamentals and vocabulary.<sup>1</sup> International Organization for Standardization.

ISO 9001:2015. Quality management systems — Requirements.<sup>1</sup> International Organization for Standardization.

ISO 9004:2018. Quality management — Quality of an organization — Guidance to achieve sustained success.<sup>1</sup> International Organization for Standardization.

MSS SP-9-2018. Spot-Facing for Bronze, Iron, and Steel Flanges. Manufacturers Standardization Society of the Valve and Fittings Industry.

MSS SP-25-2018. Standard Marking System for Valves, Fittings, Flanges, and Unions. Manufacturers Standardization Society of the Valve and Fittings Industry.

MSS SP-44-2019. Steel Pipe Line Flanges. Manufacturers Standardization Society of the Valve and Fittings Industry.

MSS SP-45-2020. Bypass and Drain Connections. Manufacturers Standardization Society of the Valve and Fittings Industry.

MSS SP-61-2019. Pressure Testing of Valves. Manufacturers Standardization Society of the Valve and Fittings Industry.

<sup>1</sup> This publication may also be obtained from the American National Standards Institute: [www.ansi.org](http://www.ansi.org).

# NONMANDATORY APPENDIX A

## METHODS USED FOR ESTABLISHING

## PRESSURE-TEMPERATURE RATINGS

### A-1 GENERAL CONSIDERATIONS

#### A-1.1 Introduction

Pressure-temperature ratings for this Standard have been determined by the procedures described in this Appendix. These procedures are counterpart to those identified in ASME B16.34. The primary considerations in establishing ratings are component dimensions and material properties to sustain pressure and other loads.<sup>1</sup> Other considerations affecting or limiting the ratings include

- (a) stresses in flanges resulting from bolt-up necessary to maintain a gasket seal
- (b) distortion of flanges and flanged fittings due to loads transmitted through attached piping
- (c) limitations applying primarily to flanged components (e.g., valves), but imposed also on flanges in order to preserve compatible ratings

#### A-1.2 Material Properties

The pressure-temperature rating method uses allowable stress, ultimate tensile strength, and yield strength values from ASME Boiler and Pressure Vessel Code, Section II, Part D. For materials listed herein that have ratings either at temperature values that are above those shown in a referenced Code Section or that are not listed in any of the referenced Code Sections, the allowable stress, ultimate tensile strength, and yield strength data have been provided directly by the ASME Boiler and Pressure Vessel Subcommittee on Materials.

#### A-1.3 Material Groups

Materials are grouped in [Table 1](#) based on identical or closely matched allowable stress and yield strength values. When these values are not identical for each material listed, the lowest value has been used. Note that material groups in this Standard are not numbered consecutively. The unlisted numbers, numbers that are not part of this Standard, may be found in the materials tables of ASME B16.34.

<sup>1</sup> This method is appropriate for materials listed in [Table 1](#). It may not be appropriate for other materials.

### A-2 PRESSURE-TEMPERATURE RATING METHOD

#### A-2.1 Rating Equation Class 300 and Higher

Pressure-temperature ratings for Class 300 and higher flanges manufactured from materials listed in [Table 1](#) were established by [eq. \(A-1\)](#).

$$p_t = \frac{C_1 S_1}{8750} P_r \leq p_c \quad (\text{A-1})$$

$C_1 = 10$  when  $S_1$  is expressed in MPa units and the resultant  $p_t$  will be in bar units ( $C_1 = 1$  when  $S_1$  is expressed in psi units and the resultant  $p_t$  will be in psi units)

$p_c$  = ceiling pressure, bar (psi), at temperature  $T$  as specified in [para. A-3](#)

$P_r$  = pressure rating class index. For all designations Class 300 and above,  $P_r$  is equal to the class designation (e.g., for Class 300,  $P_r = 300$ ). For Classes 75 and 150, see [para. A-2.4](#).

$p_t$  = rated working pressure, bar (psi), for the specified material at temperature  $T$

$S_1$  = selected stress, MPa (psi) for the specified material at temperature  $T$ . The value of  $S_1$  shall be established as described in [paras. A-2.2, A-2.3, and A-2.4](#).

#### A-2.2 Ratings for Group 1 Materials

The selected stress for Group 1 materials in [Table 1](#) is determined as follows:

(a) At temperatures below the creep range,  $S_1$  shall be equal to or less than

(1) 60% of the specified minimum yield strength at 38°C (100°F)

(2) 60% of the yield strength at temperature  $T$

(3) 1.25 times 25% of the ultimate tensile strength value at temperature  $T$ , as listed in ASME Boiler and Pressure Vessel Code, Section II, Part D, for either Section I or Section VIII, Division 1

(b) At temperatures in the creep range, the value of  $S_1$  shall be the allowable stress at temperature  $T$ , as listed in ASME Boiler and Pressure Vessel Code, Section II, Part D, for either Section I or Section VIII, Division 1. However, it

shall not exceed 60% of the listed yield strength at temperature.

(c) In no case shall the selected stress value increase with increasing temperature.

(d) The creep range is considered to be at temperatures in excess of 370°C (700°F) for Group 1 materials.

(e) When the allowable stresses listed for the referenced ASME Boiler and Pressure Vessel Code Section show a higher and lower value for allowable stress and the higher value is noted to the effect that these stress values exceed two-thirds of the yield strength at temperature, then the lower shall be used. If lower allowable stress values do not appear and it is noted in the allowable stress table that the allowable stress values exceed two-thirds of the yield strength at temperature, then the allowable stress values used shall be determined as two-thirds of the tabulated yield strength at temperature.

(f) Yield strength shall be as listed in ASME Boiler and Pressure Vessel Code, Section II, Part D, for either Section III or Section VIII, Division 2.

(g) Allowable stress values listed in ASME Boiler and Pressure Vessel Code, Section II, Part D, for Section III, Class 2 or Class 3 values may only be used for a material not listed for either Section I or Section VIII, Division 1.

### A-2.3 Method for Group 2 Materials

Pressure-temperature ratings for Class 300 and higher flanges manufactured from materials listed in [Table 1](#), Material Group 2 are established by the method of [paras. A-2.1](#) and [A-2.2](#), except that in [paras. A-2.2\(a\)\(1\)](#) and [A-2.2\(a\)\(2\)](#), the 60% factor shall be changed to 70%. For Group 2 materials, the creep range is considered to be at temperatures in excess of 510°C (950°F) unless the material properties indicate that lower temperatures should be used.

### A-2.4 Method for Class 75 and 150 — All Materials

Pressure-temperature ratings for Class 75 and 150 rating designations are established by the method given for the related materials in [paras. A-2.1](#), [A-2.2](#), and [A-2.3](#), subject to the following exceptions:

(a) the value of  $P_r$ , the pressure class rating index, in [eq. \(A-1\)](#) for Class 75 shall be 57.5 and for Class 150 shall be 115

(b) the value for  $S_1$ , the selected stress, MPa (psi), for the specific material at temperature  $T$  shall be in accordance with the requirements of either [para. A-2.1](#) or [A-2.2](#), as applicable

(c) the value of  $p_t$ , the rated working pressure, bar (psi), for Class 150 shall not exceed values at temperature  $T$  as given by [eq. \(A-2\)](#)

$$p_t \leq C_2 - C_3 T \quad (\text{A-2})$$

$T$  = material temperature, °C (°F)

For Class 150

$C_2 = 21.41$  with  $T$  expressed in °C, the resultant  $p_t$  will be in bar units

= 320 with  $T$  expressed in °F, the resultant  $p_t$  will be in psi units

$C_3 = 0.03724$  with  $T$  expressed in °C, the resultant  $p_t$  will be in bar units

= 0.3 with  $T$  expressed in °F, the resultant  $p_t$  will be in psi units

For Class 75

$C_2 = 10.71$  with  $T$  expressed in °C, the resultant  $p_t$  will be in bar units

= 160 with  $T$  expressed in °F, the resultant  $p_t$  will be in psi units

$C_3 = 0.01862$  with  $T$  expressed in °C, the resultant  $p_t$  will be in bar units

= 0.15 with  $T$  expressed in °F, the resultant  $p_t$  will be in psi units

The value of  $T$  in [eq. \(A-2\)](#) shall not exceed 538°C (1,000°F). For values of  $T$  less than 38°C (100°F), use  $T$  equal to 38°C (100°F) in [eq. \(A-2\)](#).

### A-3 MAXIMUM RATINGS

The rules for establishing pressure-temperature ratings include consideration of ceiling pressures that effectively set limits on the selected stress. The ceiling pressure-temperature values set an upper bound for high strength materials and are imposed to limit deflection. Ceiling pressure values are listed in [Tables A-1](#) and [A-2](#). Ratings in excess of these ceiling values are not permitted under this Standard.

(25)

**Table A-1**  
**Rating Ceiling Values — SI Units**

Temperature, °C	Ceiling Pressure by Classes, bar					
	75	150	300	400	600	900
38	10.0	20.0	51.7	68.9	103.4	155.1
50	9.8	19.5	51.7	68.9	103.4	155.1
100	8.9	17.7	51.5	68.7	103.0	154.6
150	7.9	15.8	50.3	67.0	100.3	150.6
200	6.9	13.8	48.6	64.8	97.2	145.8
250	6.1	12.1	46.3	61.8	92.7	139.0
300	5.1	10.2	45.0	60.0	90.0	135.0
325	4.7	9.3	43.3	57.6	86.3	129.6
350	4.2	8.4	41.9	55.8	83.6	125.5
375	[Note (1)]	7.4	40.5	53.9	80.7	121.2
400	...	6.5	38.0	50.7	76.2	114.2
425	...	5.5	36.8	48.9	73.2	109.8
450	...	4.6	35.4	47.3	71.1	106.5
475	...	3.7	34.4	45.9	68.8	103.2
500	...	2.8	32.1	42.9	64.4	96.6
525	...	1.9	29.4	39.2	58.8	88.2
538	...	1.4	29.0	38.5	57.5	86.5
550	...	[Note (2)]	28.8	38.3	57.3	86.0
575	...	...	27.8	37.1	55.6	83.3
600	...	...	25.3	33.6	50.2	75.1
625	...	...	21.5	28.7	43.0	64.5
650	...	...	16.6	22.1	33.2	50.2
675	...	...	14.8	19.9	30.0	44.7
700	...	...	12.1	16.1	24.0	35.8
725	...	...	9.6	12.6	18.6	28.1
750	...	...	7.3	9.7	14.4	21.6
775	...	...	5.6	7.4	11.0	16.7
800	...	...	4.3	5.8	8.7	13.0
816	...	...	3.5	4.8	7.4	10.8

## NOTES:

(1) Ratings for Class 75 terminate at 350°C.

(2) Ratings for Class 150 terminate at 538°C.

**Table A-1C**  
**Rating Ceiling Values — U.S. Customary Units**

(25)

Temperature, °F	Ceiling Pressure by Classes, psig					
	75	150	300	400	600	900
100	145	290	750	1,000	1,500	2,250
200	130	260	750	1,000	1,500	2,250
300	115	230	730	970	1,455	2,185
400	100	200	705	940	1,410	2,115
500	85	170	665	885	1,330	1,995
600	70	140	630	840	1,260	1,890
650	60	125	615	820	1,230	1,845
700	[Note (1)]	110	600	795	1,190	1,790
750		95	555	745	1,120	1,675
800	...	80	535	710	1,065	1,600
850	...	65	510	685	1,030	1,540
900	...	50	475	635	955	1,430
950	...	35	425	570	855	1,275
1,000	...	20	415	550	825	1,245
1,050	...	[Note (2)]	410	545	820	1,230
1,100	...		375	500	750	1,120
1,150	...	...	320	425	640	960
1,200	...	...	240	320	480	725
1,250	...	...	210	285	430	645
1,300	...	...	165	220	325	490
1,350	...	...	125	165	250	375
1,400	...	...	90	120	185	275
1,450	...	...	75	100	145	220
1,500	...	...	50	70	105	160

## NOTES:

(1) Ratings for Class 75 terminate at 650°F.

(2) Ratings for Class 150 terminate at 1,000°F.

## NONMANDATORY APPENDIX B

### GASKETS (OTHER THAN RING-JOINT)

#### B-1 GASKET MATERIALS AND CONSTRUCTION


Classification of gasket materials and types is shown in [Table B-1](#). Other gaskets that result in no increase in bolt loads or flange moment over those resulting from the gaskets included in the respective groups may be used. See [para. 5.4](#).

#### B-2 GASKET DIMENSIONS

Reference to a dimensional standard for gaskets, such as ASME B16.21, is recommended. In any case, selected dimensions should be based on the type of gasket and

its characteristics. These characteristics include density, flexibility, compatibility with the fluid being contained, and gasket compression needed to maintain sealing. Consideration should be given to the need for a "pocket" at the gasket inside diameter (between the flange facings) or of intrusion of the gasket into the flange bore. Consideration should also be given to the effects that the contained fluid may have upon the gasket, including damage that may result from partial disintegration of the gasket material.

**Table B-1**  
**Gasket Groups and Typical Materials**

Gasket Group Number	Gasket Material	Sketches
Ia	Self-energizing types: O-rings, metallic, elastomer, other gasket types considered self-sealing	...
	Elastomer without fabric	
	Compressed sheet suitable for the operating conditions	
	Fluoropolymer, elastomer with cotton fabric insertion	
	Elastomer with or without wire reinforcement	
	Vegetable fiber	
Ib	Spiral-wound metal, with nonmetallic filler	
	Corrugated aluminum, copper or copper alloy or corrugated aluminum, copper or copper alloy double jacketed with nonmetallic filler	
	Corrugated aluminum, copper, or brass	
IIa and IIb	Corrugated metal or corrugated metal double jacketed with nonmetallic filler	
	Corrugated metal	
	Flat metal jacketed with nonmetallic filler	
	Grooved metal	
IIIa and IIIb	Solid flat metal	
	Ring-joint	...

## NONMANDATORY APPENDIX C QUALITY SYSTEM PROGRAM

The products manufactured in accordance with this Standard shall be produced under a quality system program following the principles of an appropriate standard from the ISO 9000 series.<sup>1</sup> A determination of the need for registration and/or certification of the product manufacturer's quality system program by an independent organization shall be the responsibility of the manufacturer. The detailed documentation demon-

strating program compliance shall be available to the purchaser at the manufacturer's facility. A written summary description of the program utilized by the product manufacturer shall be available to the purchaser upon request. The product manufacturer is defined as the entity whose name or trademark appears on the product in accordance with the marking or identification requirements of this Standard.

---

<sup>1</sup> The series is also available from the American National Standards Institute (ANSI) and the American Society for Quality (ASQ) as American National Standards that are identified by the prefix "Q," replacing the prefix "ISO." Each applicable standard of the series is listed under References in [Mandatory Appendix I](#).

## NONMANDATORY APPENDIX D

### METHOD FOR CALCULATING BOLT LENGTHS<sup>1</sup>

The following equations were used in establishing dimension  $L$  as listed in various dimensional tables:

$$L_{CSB} = A + n$$

$$L_{CMB} = B + n$$

where

$A = 2(t_f + t + d) + G + F$  (i.e., stud bolt length exclusive of negative length tolerance,  $n$ )

$B = 2(t_f + t) + d + G + F + p$  (i.e., machine bolt length exclusive of negative tolerance,  $n$ )

$d$  = heavy nut thickness (equals nominal bolt diameter, see ASME B18.2.2)

$F$  = total height of facings or depth of ring joint groove for both flanges (see [Table D-1](#))

$G$  = 3.0 mm (0.12 in.) gasket thickness for raised face, approximate distance between ring joint flanges listed in [Table 6 \(Table 6C\)](#).

$L_{CMB}$  = calculated machine bolt length as measured from underside of head to end of point

$L_{CSB}$  = calculated stud bolt length (effective thread length, excluding end points)

$L_{SSB}$  = specified stud bolt length (effective thread length, excluding end points), which is  $L_{CSB}$  rounded off to the nearest 5 mm (0.25 in.) increment (see [Figure D-1](#))

$n$  = negative tolerance on bolt length (see [Table D-2](#))

$t$  = plus tolerance for flange thickness (see [para. 7.4](#))


$t_f$  = minimum flange thickness (see applicable dimensional tables)

**Table D-1**  
***F* Values**

(25)

Class	Type of Flange Facing	Total Height of Facings or Depth of Ring Joint Groove for Both Flanges, $F$ , mm (in.)
150 and 300, 400 to 2500	2-mm (0.06-in.) raised	4 (0.12)
	7-mm (0.25-in.) raised	14 (0.50)
	Ring joint	2 × groove depth

**Figure D-1**  
**Specified Stud Bolt Length**



**Table D-2**  
***n* Values for Stud Bolt Length,  $A$**

Negative Tolerance on Bolt Lengths, $n$ , mm (in.)	Length, mm (in.)
1.5 (0.06)	≤305 (≤12)
3.0 (0.12)	>305 (>12), ≤460 (≤18)
7.0 (0.25)	>460 (>18)

<sup>1</sup> The equations used in this Appendix are for calculated bolt lengths established to ensure full thread engagement of heavy hexagon nuts when worst case tolerances occur on all relevant dimensions of the flanged joint. The use of shorter bolt lengths is acceptable provided that full thread engagement is obtained at assembly (see [para. 6.5.2](#)).

INTENTIONALLY LEFT BLANK

# B16 AMERICAN NATIONAL STANDARDS FOR PIPING, PIPE FLANGES, FITTINGS, AND VALVES

B16.1-2020	Gray Iron Pipe Flanges and Flanged Fittings: Classes 25, 125, and 250
B16.3-2021	Malleable Iron Threaded Fittings: Classes 150 and 300
B16.4-2021	Gray Iron Threaded Fittings: Classes 125 and 250
B16.5-2025	Pipe Flanges and Flanged Fittings: NPS $\frac{1}{2}$ Through NPS 24 Metric/Inch Standard
B16.9-2024	Factory-Made Wrought Butt welding Fittings
B16.10-2022	Face-to-Face and End-to-End Dimensions of Valves
B16.11-2021	Forged Fittings, Socket-Welding and Threaded
B16.12-2025	Cast Iron Threaded Drainage Fittings
B16.14-2024	Ferrous Pipe Plugs, Bushings, and Locknuts With Pipe Threads
B16.15-2024	Cast Copper Alloy Threaded Fittings
B16.18-2021	Cast Copper Alloy Solder Joint Pressure Fittings
B16.20-2023	Metallic Gaskets for Pipe Flanges
B16.21-2021	Nonmetallic Flat Gaskets for Pipe Flanges
B16.22-2021	Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings
B16.23-2021	Cast Copper Alloy Solder Joint Drainage Fittings: DWV
B16.24-2021	Cast Copper Alloy Pipe Flanges, Flanged Fittings, and Valves: Classes 150, 300, 600, 900, 1500, and 2500
B16.25-2022	Butt welding Ends
B16.26-2024	Cast Copper Alloy Fittings for Flared Copper Tubes
B16.29-2022	Wrought Copper and Wrought Copper Alloy Solder-Joint Drainage Fittings — DWV
B16.33-2024	Manually Operated Metallic Gas Valves for Use in Gas Piping Systems Up to 175 psi (Sizes NPS $\frac{1}{2}$ Through NPS 2)
B16.34-2025	Valves — Flanged, Threaded, and Welding End
B16.36-2025	Orifice Flanges
B16.38-2023	Large Metallic Valves for Gas Distribution: Manually Operated, NPS $2\frac{1}{2}$ (DN 65) to NPS 12 (DN 300), 125 psig (8.6 bar) Maximum
B16.39-2025	Malleable Iron Threaded Pipe Unions: Classes 150, 250, and 300
B16.40-2024	Manually Operated Thermoplastic Gas Shutoffs and Valves in Gas Distribution Systems
B16.42-2021	Ductile Iron Pipe Flanges and Flanged Fittings: Classes 150 and 300
B16.44-2023	Manually Operated Metallic Gas Valves for Use in Aboveground Piping Systems Up to 5 psi
B16.47-2025	Large Diameter Steel Flanges: NPS 26 Through NPS 60 Metric/Inch Standard
B16.48-2025	Line Blanks
B16.49-2023	Factory-Made, Wrought Steel, Butt welding Induction Bends for Transportation and Distribution Systems
B16.50-2021	Wrought Copper and Copper Alloy Braze-Joint Pressure Fittings
B16.51-2021	Copper and Copper Alloy Press-Connect Pressure Fittings
B16.52-2024	Forged Nonferrous Fittings, Socket-Welding and Threaded (Titanium, Titanium Alloys, Aluminum, and Aluminum Alloys)

The ASME Publications Catalog shows a complete list of all the Standards published by the Society. For a complimentary catalog, or the latest information about our publications, call 1-800-THE-ASME (1-800-843-2763).

## ASME Services

ASME is committed to developing and delivering technical information. At ASME's Customer Care, we make every effort to answer your questions and expedite your orders. Our representatives are ready to assist you in the following areas:

ASME Press	Member Services & Benefits	Public Information
<i>Codes &amp; Standards</i>	Other ASME Programs	Self-Study Courses
Credit Card Orders	Payment Inquiries	Shipping Information
IMechE Publications	Professional Development	Subscriptions/Journals/Magazines
Meetings & Conferences	Short Courses	Symposia Volumes
Member Dues Status	Publications	Technical Papers

### How can you reach us? It's easier than ever!


There are four options for making inquiries\* or placing orders. Simply mail, phone, fax, or email us and a Customer Care representative will handle your request.

<i>Mail</i>	<i>Call Toll Free</i>	<i>Fax—24 hours</i>	<i>Email—24 hours</i>
<b>ASME</b> 150 Clove Road, 6th Floor Little Falls, New Jersey 07424-2139	<b>US &amp; Canada:</b> 800-THE-ASME (800-843-2763) <b>Mexico:</b> 95-800-THE-ASME (95-800-843-2763)	973-882-1717 973-882-5155	customercare@asme.org

\*Customer Care staff are not permitted to answer inquiries about the technical content of this code or standard. Information as to whether or not technical inquiries are issued to this code or standard is shown on the copyright page. All technical inquiries must be submitted in writing to the staff secretary. Additional procedures for inquiries may be listed within.

# ASME B16.47-2025

ISBN 978-0-7918-7687-9



9 780791 876879



J 1 2 9 2 5